


# John Cockerill Energy

## Heat Recovery Steam Generators

Reference List

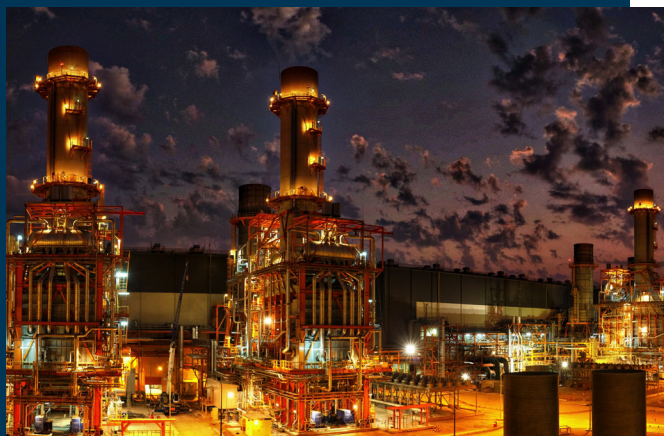

August 2025



| PROJECT | GT<br>Type | H.R.S.G |      |   | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |     | MW    | Layout |               |          |

### Baghdad | Iraq

|                                                                                   |         |    |     |    |     |   |     |           |      |             |
|-----------------------------------------------------------------------------------|---------|----|-----|----|-----|---|-----|-----------|------|-------------|
|  | MS9001E | HP | 184 | 83 | 515 | 2 | 375 | 1 (2-2-1) | 2026 | Natural gas |
|                                                                                   |         | LP | 48  | 6  | 234 |   |     |           |      |             |

### Bazyan II | Iraq

|                                                                                   |       |    |     |    |     |   |     |           |      |             |
|-----------------------------------------------------------------------------------|-------|----|-----|----|-----|---|-----|-----------|------|-------------|
|  | 9F.04 | HP | 335 | 97 | 567 | 2 | 800 | 1 (2-2-1) | 2028 | Natural gas |
|                                                                                   |       | LP | 36  | 8  | 253 |   |     |           |      |             |

### Brunei | Brunei

|                                                                                   |          |    |    |    |     |   |     |           |      |             |
|-----------------------------------------------------------------------------------|----------|----|----|----|-----|---|-----|-----------|------|-------------|
|  | SGT5-800 | HP | 63 | 84 | 543 | 2 | 120 | 1 (2-2-1) | 2027 | Natural gas |
|                                                                                   |          | LP | 11 | 7  | 261 |   |     |           |      |             |

### Jinhua | China

|                                                                                   |       |        |     |     |     |   |      |           |      |                     |
|-----------------------------------------------------------------------------------|-------|--------|-----|-----|-----|---|------|-----------|------|---------------------|
|  | M701J | HP     | 432 | 170 | 602 | 2 | 1470 | 2 (1-1-1) | 2026 | Natural gas         |
|                                                                                   |       | IP     | 64  | 37  | 325 |   |      |           |      | Natural circulation |
|                                                                                   |       | LP     | 62  | 4   | 293 |   |      |           |      | SS tubes            |
|                                                                                   |       | Reheat | 473 | 35  | 602 |   |      |           |      |                     |

### Wanglong | China

|                                                                                     |        |        |     |     |     |   |     |           |      |     |
|-------------------------------------------------------------------------------------|--------|--------|-----|-----|-----|---|-----|-----------|------|-----|
|  | M701F4 | HP     | 309 | 148 | 568 | 2 | 920 | 2 (1-1-1) | 2026 | SCR |
|                                                                                     |        | IP     | 64  | 34  | 315 |   |     |           |      |     |
|                                                                                     |        | LP     | 50  | 5   | 288 |   |     |           |      |     |
|                                                                                     |        | Reheat | 356 | 32  | 568 |   |     |           |      |     |

### Mintia | Romania

|                                                                                     |             |        |     |     |     |   |      |           |      |                        |
|-------------------------------------------------------------------------------------|-------------|--------|-----|-----|-----|---|------|-----------|------|------------------------|
|  | SGT5-9000HL | HP     | 549 | 177 | 599 | 2 | 1740 | 1 (2-2-1) | 2026 | SCR                    |
|                                                                                     |             | IP     | 52  | 43  | 355 |   |      |           |      | Natural gas            |
|                                                                                     |             | LP     | 43  | 5   | 261 |   |      |           |      | Once Through, ASME/PED |
|                                                                                     |             | Reheat | 588 | 41  | 610 |   |      |           |      |                        |

| PROJECT | GT<br>Type | H.R.S.G |      |   | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |     | MW    | Layout |               |          |

### Surkhandarya | Uzbekistan

|                                                                                   |             |        |     |     |     |   |      |           |      |                       |
|-----------------------------------------------------------------------------------|-------------|--------|-----|-----|-----|---|------|-----------|------|-----------------------|
|  | SGT5-9000HL | HP     | 529 | 169 | 601 | 2 | 1600 | 1 (2-2-1) | 2027 | ASME                  |
|                                                                                   |             | IP     | 41  | 42  | 358 |   |      |           |      | Natural gas           |
|                                                                                   |             | LP     | 52  | 6   | 305 |   |      |           |      | PED, UZ stamp,        |
|                                                                                   |             | Reheat | 558 | 40  | 611 |   |      |           |      | Stainless steel tubes |

### Adamow | Poland

|                                                                                   |            |        |     |     |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|------------|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | SGT5-4000F | HP     | 343 | 171 | 586 | 1 | 560 | 1 (1-1-1) | 2026 | SCR                 |
|                                                                                   |            | IP     | 75  | 39  | 338 |   |     |           |      | ASME                |
|                                                                                   |            | LP     | 46  | 5   | 251 |   |     |           |      | Natural gas         |
|                                                                                   |            | Reheat | 393 | 36  | 585 |   |     |           |      | Natural circulation |
|                                                                                   |            |        |     |     |     |   |     |           |      | Once Through Benson |

### Banyan CCP4 | Singapore

|                                                                                    |         |        |     |     |     |   |     |           |      |                       |
|------------------------------------------------------------------------------------|---------|--------|-----|-----|-----|---|-----|-----------|------|-----------------------|
|  | M701JAC |        |     |     |     | 1 | 600 | 1 (1-1-1) | 2025 | Cogen                 |
|                                                                                    |         |        |     |     |     |   |     |           |      | CO                    |
|                                                                                    |         | HP     | 423 | 162 | 601 |   |     |           |      | ASME                  |
|                                                                                    |         | IP     | 21  | 35  | 359 |   |     |           |      | NG/ NG + H2 /         |
|                                                                                    |         | LP     | 18  | 6   | 298 |   |     |           |      | Distillated oil       |
|                                                                                    |         | Reheat | 382 | 34  | 615 |   |     |           |      | Natural circulation   |
|                                                                                    |         |        |     |     |     |   |     |           |      | Stainless steel tubes |

### Syrdarya II | Uzbekistan

|                                                                                     |         |        |     |     |     |   |      |           |      |                       |
|-------------------------------------------------------------------------------------|---------|--------|-----|-----|-----|---|------|-----------|------|-----------------------|
|  | M701JAC | HP     | 487 | 169 | 602 | 2 | 1600 | 1 (2-2-1) | 2025 | SCR                   |
|                                                                                     |         | IP     | 66  | 42  | 324 |   |      |           |      | ASME                  |
|                                                                                     |         | LP     | 69  | 5   | 333 |   |      |           |      | Natural circulation   |
|                                                                                     |         | Reheat | 548 | 40  | 612 |   |      |           |      | Stainless steel tubes |

### Keppel | Singapore

|                                                                                     |         |        |     |     |     |                       |   |     |           |      |      |
|-------------------------------------------------------------------------------------|---------|--------|-----|-----|-----|-----------------------|---|-----|-----------|------|------|
|  | M701JAC |        |     |     |     |                       | 1 | 600 | 1 (1-1-1) | 2025 | ASME |
|                                                                                     |         | HP     | 435 | 167 | 579 | Natural gas /         |   |     |           |      |      |
|                                                                                     |         | IP     | 29  | 37  | 354 | Distillated oil       |   |     |           |      |      |
|                                                                                     |         | LP     | 40  | 6   | 265 | Natural circulation   |   |     |           |      |      |
|                                                                                     |         | Reheat | 448 | 36  | 578 | Stainless steel tubes |   |     |           |      |      |

### Flemalle | Belgium

|                                                                                     |             |        |     |     |     |   |     |           |      |                            |
|-------------------------------------------------------------------------------------|-------------|--------|-----|-----|-----|---|-----|-----------|------|----------------------------|
|  | SGT5-9000HL | HP     | 576 | 163 | 603 | 1 | 875 | 1 (1-1-1) | 2025 | SCR                        |
|                                                                                     |             | IP     | 36  | 42  | 355 |   |     |           |      | ASME                       |
|                                                                                     |             | LP     | 56  | 6   | 302 |   |     |           |      | Natural gas                |
|                                                                                     |             | Reheat | 594 | 40  | 610 |   |     |           |      | PED, Stainless steel tubes |

| PROJECT | GT<br>Type | H.R.S.G |      |   |  | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|--|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |  |     | MW    | Layout |               |          |

### Jiangyin New | China

|                                                                                   |          |        |     |     |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|----------|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | AE94.3 A | HP     | 309 | 145 | 567 | 2 | 985 | 2 (1-1-1) | 2024 | SCR                 |
|                                                                                   |          | IP     | 57  | 35  | 341 |   |     |           |      | Natural gas         |
|                                                                                   |          | LP     | 58  | 5   | 282 |   |     |           |      | Natural circulation |
|                                                                                   |          | Reheat | 343 | 33  | 567 |   |     |           |      |                     |

### Wangting | China

|                                                                                   |          |        |     |     |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|----------|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | AE94.3 A | HP     | 309 | 145 | 567 | 2 | 976 | 2 (1-1-1) | 2024 | SCR                 |
|                                                                                   |          | IP     | 57  | 34  | 341 |   |     |           |      | Natural gas         |
|                                                                                   |          | LP     | 56  | 5   | 281 |   |     |           |      | Natural circulation |
|                                                                                   |          | Reheat | 344 | 32  | 563 |   |     |           |      |                     |

### Wuxi | China

|                                                                                   |          |        |     |     |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|----------|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | AE94.3 A | HP     | 310 | 146 | 567 | 1 | 493 | 1 (1-1-1) | 2024 | SCR                 |
|                                                                                   |          | IP     | 57  | 35  | 341 |   |     |           |      | Natural gas         |
|                                                                                   |          | LP     | 57  | 5   | 282 |   |     |           |      | Natural circulation |
|                                                                                   |          | Reheat | 345 | 33  | 562 |   |     |           |      |                     |

### Manzanillo III | Mexico

|                                                                                     |       |        |     |     |     |   |     |           |      |                     |
|-------------------------------------------------------------------------------------|-------|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | 7F.05 | HP     | 266 | 158 | 582 | 1 | 347 | 1 (1-1-1) | 2024 | Natural gas         |
|                                                                                     |       | IP     | 28  | 33  | 349 |   |     |           |      | Natural circulation |
|                                                                                     |       | LP     | 29  | 4   | 313 |   |     |           |      |                     |
|                                                                                     |       | Reheat | 290 | 31  | 583 |   |     |           |      |                     |

### Dongjiang | China

|                                                                                     |        |        |     |     |     |   |      |           |      |                       |
|-------------------------------------------------------------------------------------|--------|--------|-----|-----|-----|---|------|-----------|------|-----------------------|
| Longyang   China                                                                    |        |        |     |     |     |   |      |           |      | SCR                   |
|  | M701F5 | HP     | 325 | 155 | 602 | 2 | 1039 | 1 (2-2-1) | 2023 | GB Code               |
|                                                                                     |        | IP     | 62  | 37  | 315 |   |      |           |      | Natural gas           |
|                                                                                     |        | LP     | 52  | 6   | 248 |   |      |           |      | Natural circulation   |
|                                                                                     |        | Reheat | 372 | 35  | 602 |   |      |           |      | Stainless Steel Tubes |

### Qingyuan | China

|                                                                                     |         |    |     |    |     |   |     |           |      |                     |  |
|-------------------------------------------------------------------------------------|---------|----|-----|----|-----|---|-----|-----------|------|---------------------|--|
|  | AE64.3A | HP | 107 | 72 | 567 | 2 | 225 | 1 (2-2-1) | 2023 | SCR                 |  |
|                                                                                     |         | LP | 18  | 7  | 266 |   |     |           |      | GB Code             |  |
|                                                                                     |         |    |     |    |     |   |     |           |      | Natural gas         |  |
|                                                                                     |         |    |     |    |     |   |     |           |      | Natural circulation |  |

| PROJECT                                                                             | GT Type    | H.R.S.G |      |     |     | Qty | PLANT  |           | Commissioning | Features            |
|-------------------------------------------------------------------------------------|------------|---------|------|-----|-----|-----|--------|-----------|---------------|---------------------|
|                                                                                     |            | t/h     | barA | C   |     | MW  | Layout |           |               |                     |
| Grudziadz   Poland                                                                  |            |         |      |     |     |     |        |           |               |                     |
|    | SGT5-4000F | HP      | 342  | 169 | 586 | 1   | 560    | 1 (1-1-1) | 2025          | SCR                 |
|                                                                                     |            | IP      | 75   | 37  | 336 |     |        |           |               | ASME                |
|                                                                                     |            | LP      | 45   | 4   | 247 |     |        |           |               | Natural gas         |
|                                                                                     |            | Reheat  | 392  | 35  | 585 |     |        |           |               | Once Through Benson |
| Rompetrol   Romania                                                                 |            |         |      |     |     |     |        |           |               |                     |
|    | SGT-750    | HP      | 96   | 41  | 383 | 2   | 70     | 1 (2-2-1) | 2023          | Add-on              |
|                                                                                     |            |         |      |     |     |     |        |           |               | District Heating    |
|                                                                                     |            |         |      |     |     |     |        |           |               | Post Combustion     |
|                                                                                     |            |         |      |     |     |     |        |           |               | SCR                 |
|                                                                                     |            |         |      |     |     |     |        |           |               | CO Prov.            |
|                                                                                     |            |         |      |     |     |     |        |           |               | Natural gas         |
|                                                                                     |            |         |      |     |     |     |        |           |               | Natural circulation |
| Huizhou Fengda   China                                                              |            |         |      |     |     |     |        |           |               |                     |
|    | SGT5-4000F | HP      | 301  | 160 | 567 | 2   | 910    | 1 (1-1-1) | 2023          | SCR                 |
|                                                                                     |            | IP      | 53   | 38  | 339 |     |        |           |               | GB Code             |
|                                                                                     |            | LP      | 45   | 5   | 246 |     |        |           |               |                     |
|                                                                                     |            | Reheat  | 339  | 36  | 587 |     |        |           |               |                     |
| Kazanorgsintez   Russia                                                             |            |         |      |     |     |     |        |           |               |                     |
|  | SGT5-2000E | HP      | 244  | 67  | 518 | 1   | 180    | 1 (1-1-1) | 2022          | Add-on              |
|                                                                                     |            | LP      | 64   | 8   | 244 |     |        |           |               | Natural gas         |
|                                                                                     |            |         |      |     |     |     |        |           |               | Natural circulation |
| Besmaya 3   Iraq                                                                    |            |         |      |     |     |     |        |           |               |                     |
|  | 9FA.04     | HP      | 392  | 82  | 539 | 4   | 1650   | 2 (2-2-1) | 2022          | ASME                |
|                                                                                     |            | LP      | 35   | 8   | 237 |     |        |           |               | Natural gas         |
|                                                                                     |            |         |      |     |     |     |        |           |               | Natural circulation |
| Termocandelaria   Colombia                                                          |            |         |      |     |     |     |        |           |               |                     |
|  | WH 501F    | HP      | 296  | 157 | 587 | 2   | 566    | 1 (2-2-1) | 2022          | Repowering          |
|                                                                                     |            | IP      | 20   | 41  | 363 |     |        |           |               | Post Combustion     |
|                                                                                     |            | LP      | 19   | 6   | 332 |     |        |           |               | ASME                |
|                                                                                     |            | Reheat  | 246  | 38  | 577 |     |        |           |               | Natural gas         |
|                                                                                     |            |         |      |     |     |     |        |           |               | Natural circulation |

| PROJECT                                                                             | GT<br>Type | H.R.S.G |                     |     |     |    | Qty  | PLANT     |      | Commissioning         | Features |
|-------------------------------------------------------------------------------------|------------|---------|---------------------|-----|-----|----|------|-----------|------|-----------------------|----------|
|                                                                                     |            | t/h     | barA                | C   |     | MW |      | Layout    |      |                       |          |
| Starch Cogen Plant   Australia                                                      |            |         |                     |     |     |    |      |           |      |                       |          |
|    | LM2500     | HP      | 106                 | 14  | 195 | 2  | 54   | 1 (2-2-1) | 2022 | Add-on                |          |
|                                                                                     |            |         |                     |     |     |    |      |           |      | Cogen                 |          |
|                                                                                     |            |         |                     |     |     |    |      |           |      | Post Combustion       |          |
|                                                                                     |            |         |                     |     |     |    |      |           |      | ASME                  |          |
|                                                                                     |            |         |                     |     |     |    |      |           |      | Fresh Air Fans        |          |
| SW Munchen South   Germany                                                          |            |         |                     |     |     |    |      |           |      |                       |          |
|    | 9E.04      | HP      | 189                 | 86  | 520 | 1  | 215  | 1 (1-1-1) | 2022 | District Heating      |          |
|                                                                                     |            | LP      | 32                  | 8   | 191 |    |      |           |      | SCR catalyst (option) |          |
|                                                                                     |            |         | CO                  |     |     |    |      |           |      |                       |          |
|                                                                                     |            |         | EN                  |     |     |    |      |           |      |                       |          |
|                                                                                     |            |         | Natural gas         |     |     |    |      |           |      |                       |          |
|                                                                                     |            |         | Natural circulation |     |     |    |      |           |      |                       |          |
| PED                                                                                 |            |         |                     |     |     |    |      |           |      |                       |          |
| Suncor Coke Boiler Replacement   Canada                                             |            |         |                     |     |     |    |      |           |      |                       |          |
|  | M501J      | HP      | 861                 | 57  | 399 | 2  | 800  | 1 (2-2-0) | 2022 | Cogen                 |          |
|                                                                                     |            |         |                     |     |     |    |      |           |      | Post Combustion       |          |
|                                                                                     |            |         |                     |     |     |    |      |           |      | SCR                   |          |
|                                                                                     |            |         |                     |     |     |    |      |           |      | Natural gas           |          |
|                                                                                     |            |         |                     |     |     |    |      |           |      | Natural circulation   |          |
| Nanjing Gaochun   China                                                             |            |         |                     |     |     |    |      |           |      |                       |          |
|  | AE64.3A    | HP      | 110                 | 72  | 543 | 2  | 116  | 2 (1-1-1) | 2022 | District Heating      |          |
|                                                                                     |            | LP      | 19                  | 7   | 241 |    |      |           |      | SCR                   |          |
|                                                                                     |            |         | GB Code             |     |     |    |      |           |      |                       |          |
| Shengze   China                                                                     |            |         |                     |     |     |    |      |           |      |                       |          |
|  | 6F.03      | HP      | 121                 | 83  | 542 | 2  | 242  | 2 (1-1-1) | 2021 | District Heating      |          |
|                                                                                     |            | LP      | 14                  | 11  | 290 |    |      |           |      | SCR                   |          |
|                                                                                     |            |         | GB Code             |     |     |    |      |           |      |                       |          |
| Jackson Generation   USA                                                            |            |         |                     |     |     |    |      |           |      |                       |          |
|  | M501J      | HP      | 512                 | 164 | 587 | 2  | 1200 | 2 (1-1-1) | 2021 | Post Combustion       |          |
|                                                                                     |            | IP      | 35                  | 39  | 321 |    |      |           |      | SCR                   |          |
|                                                                                     |            | LP      | 28                  | 7   | 316 |    |      |           |      | CO                    |          |
|                                                                                     |            | Reheat  | 521                 | 36  | 586 |    |      |           |      | ASME                  |          |
|                                                                                     |            |         | Natural gas         |     |     |    |      |           |      |                       |          |

| PROJECT | GT<br>Type | H.R.S.G |      |   |  | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|--|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |  |     | MW    | Layout |               |          |

### Toplarna | Slovenia

|                                                                                   |         |    |    |    |     |   |     |           |      |                                                                                                                                                    |
|-----------------------------------------------------------------------------------|---------|----|----|----|-----|---|-----|-----------|------|----------------------------------------------------------------------------------------------------------------------------------------------------|
|  | SGT-800 | HP | 63 | 97 | 524 | 2 | 110 | 1 (2-2-1) | 2021 | Add-on                                                                                                                                             |
|                                                                                   |         | LP | 12 | 9  | 252 |   |     |           |      | Cogen<br>District Heating<br>SCR Provi<br>EN<br>Natural gas<br>Natural circulation<br>Fast start-up, GT at full speed & full load w/o by-pass, PED |

### Yeosu | South Korea

|                                                                                   |     |    |     |     |     |   |    |           |      |                                                                                             |
|-----------------------------------------------------------------------------------|-----|----|-----|-----|-----|---|----|-----------|------|---------------------------------------------------------------------------------------------|
|  | H25 | HP | 150 | 104 | 515 | 2 | 96 | 1 (2-2-1) | 2020 | Post Combustion<br>SCR<br>ASME<br>Natural gas<br>Natural circulation<br>With fresh air fans |
|                                                                                   |     |    |     |     |     |   |    |           |      |                                                                                             |

### West Africa | Ghana

|                                                                                     |         |    |    |    |     |   |     |           |      |                                                         |
|-------------------------------------------------------------------------------------|---------|----|----|----|-----|---|-----|-----------|------|---------------------------------------------------------|
|  | TM 2500 | HP | 40 | 64 | 512 | 5 | 203 | 1 (5-5-1) | 2020 | Cogen<br>ASME<br>LPG, DO<br>Dry Running<br>Once Through |
|                                                                                     |         | LP | 6  | 8  | 232 |   |     |           |      |                                                         |

### Huaneng Jiangyin | China

|                                                                                     |            |        |     |     |     |   |     |           |      |                                                                                           |
|-------------------------------------------------------------------------------------|------------|--------|-----|-----|-----|---|-----|-----------|------|-------------------------------------------------------------------------------------------|
|  | SCC5-4000F | HP     | 309 | 139 | 567 | 2 | 484 | 2 (1-1-1) | 2020 | Cogen<br>SCR<br>Natural gas<br>Natural circulation<br>Cogeneration with cold reheat steam |
|                                                                                     |            | IP     | 55  | 37  | 319 |   |     |           |      |                                                                                           |
|                                                                                     |            | LP     | 39  | 5   | 246 |   |     |           |      |                                                                                           |
|                                                                                     |            | Reheat | 355 | 34  | 566 |   |     |           |      |                                                                                           |

### Jiangyin | China

|                                                                                     |       |    |     |    |     |   |     |           |      |                                               |
|-------------------------------------------------------------------------------------|-------|----|-----|----|-----|---|-----|-----------|------|-----------------------------------------------|
|  | 6F.03 | HP | 121 | 79 | 542 | 2 | 122 | 2 (1-1-1) | 2020 | GB Code<br>Natural gas<br>Natural circulation |
|                                                                                     |       | LP | 14  | 7  | 223 |   |     |           |      |                                               |

### Layyah | UAE

|                                                                                     |        |        |     |     |     |   |     |           |      |                                                                                          |
|-------------------------------------------------------------------------------------|--------|--------|-----|-----|-----|---|-----|-----------|------|------------------------------------------------------------------------------------------|
|  | M701F5 | HP     | 365 | 158 | 602 | 2 | 972 | 2 (1-1-1) | 2021 | Post Combustion<br>Natural gas<br>Natural circulation<br>Stainless Steel tubes (SHT/RHT) |
|                                                                                     |        | IP     | 49  | 41  | 335 |   |     |           |      |                                                                                          |
|                                                                                     |        | LP     | 38  | 8   | 321 |   |     |           |      |                                                                                          |
|                                                                                     |        | Reheat | 396 | 40  | 601 |   |     |           |      |                                                                                          |

| PROJECT                                                                             | GT Type    | H.R.S.G |      |     |     | Qty | PLANT  |           | Commissioning | Features              |
|-------------------------------------------------------------------------------------|------------|---------|------|-----|-----|-----|--------|-----------|---------------|-----------------------|
|                                                                                     |            | t/h     | barA | C   |     | MW  | Layout |           |               |                       |
| Nizhnekamsk   Russia                                                                |            |         |      |     |     |     |        |           |               |                       |
|    | SGT5-2000E | HP      | 222  | 100 | 507 | 2   | 495    | 1 (2-2-1) | 2021          | Natural gas / Syngas  |
|                                                                                     |            | LP      | 62   | 8   | 241 |     |        |           |               | Natural circulation   |
| Besmaya Phase 2   Iraq                                                              |            |         |      |     |     |     |        |           |               |                       |
|    | 9F.03      | HP      | 365  | 79  | 537 | 4   | 1590   | 2 (2-2-1) | 2018          | Natural circulation   |
|                                                                                     |            | LP      | 25   | 7   | 242 |     |        |           |               | ASME stamped          |
| Rades   Tunisia                                                                     |            |         |      |     |     |     |        |           |               |                       |
|    | M701F4     | HP      | 291  | 135 | 547 | 1   | 566    | 1 (1-1-1) | 2020          |                       |
|                                                                                     |            | IP      | 355  | 30  | 551 |     |        |           |               |                       |
|                                                                                     |            | LP      | 25   | 6   | 294 |     |        |           |               |                       |
| Tianjin Huadian   China                                                             |            |         |      |     |     |     |        |           |               |                       |
|    | 9HA 01     | HP      | 387  | 170 | 589 | 1   | 661    | 1 (1-1-1) | 2018          | SCR                   |
|                                                                                     |            | IP      | 59   | 39  | 329 |     |        |           |               | Natural circulation   |
|                                                                                     |            | LP      | 48   | 8   | 325 |     |        |           |               | Stainless steel tubes |
|                                                                                     |            | Reheat  | 440  | 36  | 588 |     |        |           |               |                       |
| Zeran   Poland                                                                      |            |         |      |     |     |     |        |           |               |                       |
|  | M701F5     | HP      | 360  | 158 | 567 | 1   | 566    | 1 (1-1-1) | 2019          | SCR                   |
|                                                                                     |            | IP      | 44   | 37  | 329 |     |        |           |               | CO                    |
|                                                                                     |            | LP      | 40   | 6   | 233 |     |        |           |               | EN                    |
|                                                                                     |            | Reheat  | 385  | 35  | 565 |     |        |           |               | Natural gas           |
|                                                                                     |            |         |      |     |     |     |        |           |               | Natural circulation   |
|                                                                                     |            |         |      |     |     |     |        |           |               | PED                   |
| Gaozhou   China                                                                     |            |         |      |     |     |     |        |           |               |                       |
|  | 6F.01      | HP      | 70   | 60  | 542 | 2   | 148    | 2 (1-1-1) | 2018          | Cogen                 |
|                                                                                     |            | LP      | 5    | 11  | 341 |     |        |           |               | District Heating      |
|                                                                                     |            |         |      |     |     |     |        |           |               | SCR Provi             |
|                                                                                     |            |         |      |     |     |     |        |           |               | Natural gas           |
|                                                                                     |            |         |      |     |     |     |        |           |               | Natural circulation   |

| PROJECT                                                                             | GT<br>Type | H.R.S.G |     |      |     | Qty | PLANT |           | Commissioning | Features              |
|-------------------------------------------------------------------------------------|------------|---------|-----|------|-----|-----|-------|-----------|---------------|-----------------------|
|                                                                                     |            |         | t/h | barA | C   |     | MW    | Layout    |               |                       |
| Liuyang   China                                                                     |            |         |     |      |     |     |       |           |               |                       |
|    | 6F.01      | HP      | 70  | 60   | 542 | 2   | 148   | 2 (1-1-1) | 2018          | Cogen                 |
|                                                                                     |            | LP      | 6   | 5    | 246 |     |       |           |               | District Heating      |
|                                                                                     |            |         |     |      |     |     |       |           |               | SCR Provi             |
|                                                                                     |            |         |     |      |     |     |       |           |               | Natural gas           |
|                                                                                     |            |         |     |      |     |     |       |           |               | Natural circulation   |
| Yibal Khuff   Oman                                                                  |            |         |     |      |     |     |       |           |               |                       |
|    | 6B         | HP      | 71  | 21   | 375 | 1   | 40    | 1 (1-1-1) | 2020          | Cogen                 |
|                                                                                     |            |         |     |      |     |     |       |           |               | Natural gas           |
|                                                                                     |            |         |     |      |     |     |       |           |               | Natural circulation   |
|                                                                                     |            |         |     |      |     |     |       |           |               | Modular Box Design    |
| Hickory Run   USA                                                                   |            |         |     |      |     |     |       |           |               |                       |
|    | SGT6-8000H | HP      | 318 | 176  | 587 | 2   | 1000  | 1 (2-2-1) | 2019          | SCR                   |
|                                                                                     |            | IP      | 36  | 33   | 270 |     |       |           |               | CO                    |
|                                                                                     |            | LP      | 27  | 7    | 265 |     |       |           |               | Natural gas           |
|                                                                                     |            | Reheat  | 347 | 32   | 585 |     |       |           |               | Natural circulation   |
|                                                                                     |            |         |     |      |     |     |       |           |               | Stainless steel tubes |
| Fairview   USA                                                                      |            |         |     |      |     |     |       |           |               |                       |
|  | 7HA.02     | HP      | 447 | 172  | 567 | 2   | 1050  | 1 (2-2-1) | 2019          | SCR                   |
|                                                                                     |            | IP      | 7   | 46   | 335 |     |       |           |               | CO                    |
|                                                                                     |            | LP      | 33  | 8    | 322 |     |       |           |               | Natural gas           |
|                                                                                     |            | Reheat  | 454 | 44   | 567 |     |       |           |               | Natural circulation   |
| Grati II Add-on   Indonesia                                                         |            |         |     |      |     |     |       |           |               |                       |
|  | M701D      | HP      | 169 | 130  | 525 | 3   | 450   | 1 (3-3-1) | 2019          | Add-on                |
|                                                                                     |            | LP      | 51  | 6    | 274 |     |       |           |               | Natural gas           |
|                                                                                     |            |         |     |      |     |     |       |           |               | Natural circulation   |
| Shatt-Al-Basra   Iraq                                                               |            |         |     |      |     |     |       |           |               |                       |
|  | PG9171E    | HP      | 188 | 85   | 509 | 10  | 2000  | 5 (2-2-1) | 2019          | Add-on                |
|                                                                                     |            | LP      | 35  | 8    | 251 |     |       |           |               | LDO / HFO             |
|                                                                                     |            |         |     |      |     |     |       |           |               | Natural circulation   |

| PROJECT | GT<br>Type | H.R.S.G |      |   |  | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|--|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |  |     | MW    | Layout |               |          |

### Chinook Power Station | Canada

|                                                                                   |            |        |     |     |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|------------|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | SGT6-5000F | HP     | 232 | 167 | 569 | 1 | 350 | 1 (1-1-1) | 2019 | Natural circulation |
|                                                                                   |            | IP     | 50  | 41  | 336 |   |     |           |      |                     |
|                                                                                   |            | LP     | 34  | 9   | 332 |   |     |           |      |                     |
|                                                                                   |            | Reheat | 277 | 39  | 567 |   |     |           |      |                     |

### Zhuhai Yuhai | China

|                                                                                   |          |        |     |     |     |   |     |           |      |                                           |
|-----------------------------------------------------------------------------------|----------|--------|-----|-----|-----|---|-----|-----------|------|-------------------------------------------|
|  | AE94.3 A | HP     | 294 | 136 | 561 | 2 | 461 | 2 (1-1-1) | 2018 | SCR<br>Natural gas<br>Natural circulation |
|                                                                                   |          | IP     | 60  | 33  | 335 |   |     |           |      |                                           |
|                                                                                   |          | LP     | 53  | 4   | 241 |   |     |           |      |                                           |
|                                                                                   |          | Reheat | 332 | 31  | 553 |   |     |           |      |                                           |

### Bibiyana III | Bangladesh

|                                                                                   |        |        |     |     |     |   |       |           |      |                                   |
|-----------------------------------------------------------------------------------|--------|--------|-----|-----|-----|---|-------|-----------|------|-----------------------------------|
|  | M701F4 | HP     | 400 | 125 | 538 | 1 | 418,5 | 1 (1-1-1) | 2018 | Natural circulation<br>ASME stamp |
|                                                                                   |        | IP     | 0   | 0   | 0   |   |       |           |      |                                   |
|                                                                                   |        | LP     | 21  | 5   | 243 |   |       |           |      |                                   |
|                                                                                   |        | Reheat | 0   | 0   | 0   |   |       |           |      |                                   |

### Noroeste (Topolobampo II) | Mexico

|                                                                                     |       |        |     |     |     |   |     |           |      |                                                                                     |
|-------------------------------------------------------------------------------------|-------|--------|-----|-----|-----|---|-----|-----------|------|-------------------------------------------------------------------------------------|
|  | M501J | HP     | 331 | 160 | 602 | 2 | 800 | 1 (2-2-1) | 2019 | Post Combustion<br>Natural circulation<br>Stainless steel tubes SHP/RHT, ASME stamp |
|                                                                                     |       | IP     | 83  | 42  | 341 |   |     |           |      |                                                                                     |
|                                                                                     |       | LP     | 25  | 7   | 253 |   |     |           |      |                                                                                     |
|                                                                                     |       | Reheat | 328 | 37  | 602 |   |     |           |      |                                                                                     |

### Nanjing GCL | China

|                                                                                     |    |        |     |    |     |   |     |           |      |                                                  |
|-------------------------------------------------------------------------------------|----|--------|-----|----|-----|---|-----|-----------|------|--------------------------------------------------|
|  | 9E | HP     | 188 | 74 | 523 | 2 | 388 | 1 (1-1-1) | 2017 | Cogen<br>District Heating<br>Natural circulation |
|                                                                                     |    | IP     | 28  | 14 | 298 |   |     |           |      |                                                  |
|                                                                                     |    | LP     | 15  | 4  | 203 |   |     |           |      |                                                  |
|                                                                                     |    | Reheat | 0   | 0  | 0   |   |     |           |      |                                                  |

### Fenchuganj | Bangladesh

|                                                                                     |       |        |     |     |     |   |     |           |      |                                   |
|-------------------------------------------------------------------------------------|-------|--------|-----|-----|-----|---|-----|-----------|------|-----------------------------------|
|  | 9E.04 | HP     | 181 | 103 | 536 | 1 | 163 | 1 (1-1-1) | 2017 | Natural circulation<br>ASME stamp |
|                                                                                     |       | IP     | 0   | 0   | 0   |   |     |           |      |                                   |
|                                                                                     |       | LP     | 40  | 7   | 281 |   |     |           |      |                                   |
|                                                                                     |       | Reheat | 0   | 0   | 0   |   |     |           |      |                                   |

| PROJECT | GT<br>Type | H.R.S.G |      |   |    | Qty | PLANT  |  | Commissioning | Features |
|---------|------------|---------|------|---|----|-----|--------|--|---------------|----------|
|         |            | t/h     | barA | C | MW |     | Layout |  |               |          |

### Mary | Turkmenistan

|                                                                                   |       |        |     |    |     |   |      |           |      |                                    |
|-----------------------------------------------------------------------------------|-------|--------|-----|----|-----|---|------|-----------|------|------------------------------------|
|  | 9F.03 | HP     | 361 | 89 | 538 | 4 | 1574 | 2 (2-2-1) | 2018 | ASME<br>Natural circulation<br>PED |
|                                                                                   |       | IP     | 0   | 0  | 0   |   |      |           |      |                                    |
|                                                                                   |       | LP     | 56  | 8  | 204 |   |      |           |      |                                    |
|                                                                                   |       | Reheat | 0   | 0  | 0   |   |      |           |      |                                    |

### Bibiyana South | Bangladesh

|                                                                                   |            |        |     |     |     |   |     |           |      |                                   |
|-----------------------------------------------------------------------------------|------------|--------|-----|-----|-----|---|-----|-----------|------|-----------------------------------|
|  | SGT5-4000F | HP     | 283 | 129 | 566 | 1 | 383 | 1 (1-1-1) | 2018 | Natural circulation<br>ASME stamp |
|                                                                                   |            | IP     | 50  | 32  | 316 |   |     |           |      |                                   |
|                                                                                   |            | LP     | 35  | 5   | 237 |   |     |           |      |                                   |
|                                                                                   |            | Reheat | 322 | 30  | 562 |   |     |           |      |                                   |

### CPV Towantic | USA

|                                                                                   |        |        |     |     |     |   |     |           |      |                                                     |
|-----------------------------------------------------------------------------------|--------|--------|-----|-----|-----|---|-----|-----------|------|-----------------------------------------------------|
|  | 7HA.01 | HP     | 313 | 173 | 567 | 2 | 785 | 1 (2-2-1) | 2018 | Post Combustion<br>SCR<br>CO<br>Natural circulation |
|                                                                                   |        | IP     | 29  | 37  | 321 |   |     |           |      |                                                     |
|                                                                                   |        | LP     | 23  | 5   | 316 |   |     |           |      |                                                     |
|                                                                                   |        | Reheat | 336 | 35  | 566 |   |     |           |      |                                                     |

### Yangzhou | China

|                                                                                     |        |        |     |     |     |   |     |           |      |                            |
|-------------------------------------------------------------------------------------|--------|--------|-----|-----|-----|---|-----|-----------|------|----------------------------|
|  | M701F4 | HP     | 294 | 126 | 568 | 2 | 950 | 2 (1-1-1) | 2017 | SCR<br>Natural circulation |
|                                                                                     |        | IP     | 71  | 31  | 290 |   |     |           |      |                            |
|                                                                                     |        | LP     | 52  | 5   | 248 |   |     |           |      |                            |
|                                                                                     |        | Reheat | 356 | 30  | 568 |   |     |           |      |                            |

### Moxie Freedom | USA

|                                                                                     |        |        |     |     |     |   |     |           |      |                                                     |
|-------------------------------------------------------------------------------------|--------|--------|-----|-----|-----|---|-----|-----------|------|-----------------------------------------------------|
|  | 7HA.02 | HP     | 407 | 168 | 567 | 2 | 950 | 2 (1-1-1) | 2017 | Post Combustion<br>SCR<br>CO<br>Natural circulation |
|                                                                                     |        | IP     | 25  | 41  | 316 |   |     |           |      |                                                     |
|                                                                                     |        | LP     | 38  | 6   | 310 |   |     |           |      |                                                     |
|                                                                                     |        | Reheat | 425 | 38  | 566 |   |     |           |      |                                                     |

### Klongluang Utilities | Thailand

|                                                                                     |        |        |    |    |     |   |     |           |      |                              |
|-------------------------------------------------------------------------------------|--------|--------|----|----|-----|---|-----|-----------|------|------------------------------|
|  | LM6000 | HP     | 46 | 44 | 437 | 2 | 110 | 1 (2-2-1) | 2017 | Cogen<br>Natural circulation |
|                                                                                     |        | IP     | 0  | 0  | 0   |   |     |           |      |                              |
|                                                                                     |        | LP     | 12 | 4  | 248 |   |     |           |      |                              |
|                                                                                     |        | Reheat | 0  | 0  | 0   |   |     |           |      |                              |

| PROJECT | GT<br>Type | H.R.S.G |      |   | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |     | MW    | Layout |               |          |

### CPV Valley Energy Center | USA

|                                                                                   |            |        |     |     |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|------------|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | SGT6-5000F | HP     | 391 | 167 | 568 | 2 | 650 | 1 (2-2-1) | 2017 | Post Combustion     |
|                                                                                   |            | IP     | 71  | 43  | 313 |   |     |           |      | SCR                 |
|                                                                                   |            | LP     | 0   | 7   | 249 |   |     |           |      | CO                  |
|                                                                                   |            | Reheat | 373 | 38  | 585 |   |     |           |      | Natural circulation |

### Genesee 4&5 | Canada

|                                                                                   |       |        |     |     |     |   |      |           |      |                     |
|-----------------------------------------------------------------------------------|-------|--------|-----|-----|-----|---|------|-----------|------|---------------------|
|  | M501J | HP     | 344 | 159 | 567 | 2 | 1060 | 2 (1-1-1) | 2017 | Post Combustion     |
|                                                                                   |       | IP     | 28  | 37  | 327 |   |      |           |      | SCR                 |
|                                                                                   |       | LP     | 17  | 5   | 263 |   |      |           |      | CO                  |
|                                                                                   |       | Reheat | 359 | 34  | 566 |   |      |           |      | Natural circulation |

### BIC2 | Thailand

|                                                                                   |        |        |    |    |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|--------|--------|----|----|-----|---|-----|-----------|------|---------------------|
|  | LM6000 | HP     | 42 | 43 | 430 | 2 | 120 | 1 (2-2-1) | 2017 | Cogen               |
|                                                                                   |        | IP     | 0  | 0  | 0   |   |     |           |      | Natural circulation |
|                                                                                   |        | LP     | 13 | 6  | 262 |   |     |           |      |                     |
|                                                                                   |        | Reheat | 0  | 0  | 0   |   |     |           |      |                     |

### Norte III | Mexico

|                                                                                     |     |        |     |     |     |   |     |           |      |                     |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | 7FA | HP     | 166 | 152 | 583 | 4 | 924 | 2 (2-2-1) | 2018 | Natural circulation |
|                                                                                     |     | IP     | 26  | 32  | 325 |   |     |           |      | ASME stamp          |
|                                                                                     |     | LP     | 19  | 5   | 302 |   |     |           |      |                     |
|                                                                                     |     | Reheat | 185 | 30  | 594 |   |     |           |      |                     |

### Wuxi South | China

|                                                                                     |    |        |     |    |     |   |     |           |      |                     |
|-------------------------------------------------------------------------------------|----|--------|-----|----|-----|---|-----|-----------|------|---------------------|
|  | 9E | HP     | 193 | 61 | 523 | 2 | 400 | 2 (1-1-1) | 2015 | Cogen               |
|                                                                                     |    | IP     | 0   | 0  | 0   |   |     |           |      | Natural circulation |
|                                                                                     |    | LP     | 38  | 6  | 253 |   |     |           |      |                     |
|                                                                                     |    | Reheat | 0   | 0  | 0   |   |     |           |      |                     |

### Lackawanna Energy Center | USA

|                                                                                     |        |        |     |     |     |   |      |           |      |                     |
|-------------------------------------------------------------------------------------|--------|--------|-----|-----|-----|---|------|-----------|------|---------------------|
|  | 7HA.02 | HP     | 499 | 179 | 567 | 3 | 1466 | 1 (3-3-1) | 2017 | Post Combustion     |
|                                                                                     |        | IP     | 5   | 43  | 332 |   |      |           |      | SCR                 |
|                                                                                     |        | LP     | 25  | 7   | 299 |   |      |           |      | CO                  |
|                                                                                     |        | Reheat | 494 | 39  | 566 |   |      |           |      | Natural circulation |

| PROJECT                                                                             | GT Type    | H.R.S.G |      |     |     | Qty | PLANT  |           | Commissioning | Features                            |
|-------------------------------------------------------------------------------------|------------|---------|------|-----|-----|-----|--------|-----------|---------------|-------------------------------------|
|                                                                                     |            | t/h     | barA | C   | MW  |     | Layout |           |               |                                     |
| Carroll County Energy Center USA                                                    |            |         |      |     |     |     |        |           |               |                                     |
|    | 7FA.05     | HP      | 350  | 171 | 567 | 2   | 700    | 1 (2-2-1) | 2017          | Post Combustion                     |
|                                                                                     |            | IP      | 23   | 38  | 388 |     |        |           |               | SCR                                 |
|                                                                                     |            | LP      | 25   | 5   | 325 |     |        |           |               | CO                                  |
|                                                                                     |            | Reheat  | 349  | 35  | 566 |     |        |           |               | Natural circulation                 |
| Hamitabat   Turkey                                                                  |            |         |      |     |     |     |        |           |               |                                     |
|    | SGT5-8000H | HP      | 391  | 170 | 602 | 2   | 1200   | 2 (1-1-1) | 2016          | ASME                                |
|                                                                                     |            | IP      | 52   | 37  | 338 |     |        |           |               | Natural circulation                 |
|                                                                                     |            | LP      | 56   | 5   | 241 |     |        |           |               | Stainless steel tubes SHP/RHT, PED  |
|                                                                                     |            | Reheat  | 421  | 35  | 600 |     |        |           |               |                                     |
| Wuxi West   China                                                                   |            |         |      |     |     |     |        |           |               |                                     |
|    | SGT5-4000F | HP      | 281  | 136 | 558 | 1   | 437    | 1 (1-1-1) | 2015          | Cogen                               |
|                                                                                     |            | IP      | 60   | 37  | 338 |     |        |           |               | Natural circulation                 |
|                                                                                     |            | LP      | 51   | 5   | 247 |     |        |           |               |                                     |
|                                                                                     |            | Reheat  | 0    | 0   | 0   |     |        |           |               |                                     |
| Hilli FLNG   Singapore                                                              |            |         |      |     |     |     |        |           |               |                                     |
|  | LM2500     | HP      | 39   | 46  | 398 | 4   | 196    | 1 (4-4-1) | 2015          | DNV                                 |
|                                                                                     |            | IP      | 0    | 0   | 0   |     |        |           |               | Assisted Circulation                |
|                                                                                     |            | LP      | 0    | 0   | 0   |     |        |           |               | Ship mounted, FLNG, Diverter damper |
|                                                                                     |            | Reheat  | 0    | 0   | 0   |     |        |           |               |                                     |
| Besmaya   Iraq                                                                      |            |         |      |     |     |     |        |           |               |                                     |
|  | 9FA        | HP      | 365  | 79  | 537 | 4   | 1200   | 2 (2-2-1) | 2015          | Natural circulation                 |
|                                                                                     |            | IP      | 26   | 7   | 242 |     |        |           |               | Diverter damper                     |
|                                                                                     |            | LP      | 0    | 0   | 0   |     |        |           |               |                                     |
|                                                                                     |            | Reheat  | 0    | 0   | 0   |     |        |           |               |                                     |
| Qassim   Saudi Arabia                                                               |            |         |      |     |     |     |        |           |               |                                     |
|  | 7EA        | HP      | 107  | 98  | 533 | 12  | 1100   | 3 (4-4-1) | 2016          | Crude Oil                           |
|                                                                                     |            | IP      | 28   | 6   | 242 |     |        |           |               | Natural circulation                 |
|                                                                                     |            | LP      | 0    | 0   | 0   |     |        |           |               | ASME stamp                          |
|                                                                                     |            | Reheat  | 0    | 0   | 0   |     |        |           |               |                                     |

| PROJECT | GT<br>Type | H.R.S.G |      |   |    | Qty | PLANT  |  | Commissioning | Features |
|---------|------------|---------|------|---|----|-----|--------|--|---------------|----------|
|         |            | t/h     | barA | C | MW |     | Layout |  |               |          |

### Sikalbaha | Bangladesh

|                                                                                   |            |        |     |    |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|------------|--------|-----|----|-----|---|-----|-----------|------|---------------------|
|  | SGT5-2000E | HP     | 238 | 80 | 532 | 1 | 225 | 1 (1-1-1) | 2016 | Natural circulation |
|                                                                                   |            | IP     | 0   | 0  | 0   |   |     |           |      |                     |
|                                                                                   |            | LP     | 0   | 0  | 0   |   |     |           |      |                     |
|                                                                                   |            | Reheat | 0   | 0  | 0   |   |     |           |      |                     |

### St. Charles | USA

|                                                                                   |        |        |     |     |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|--------|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | 7FA.05 | HP     | 361 | 135 | 567 | 2 | 700 | 1 (2-2-1) | 2016 | Natural circulation |
|                                                                                   |        | IP     | 15  | 39  | 346 |   |     |           |      |                     |
|                                                                                   |        | LP     | 20  | 6   | 311 |   |     |           |      |                     |
|                                                                                   |        | Reheat | 371 | 36  | 507 |   |     |           |      |                     |

### Bheramara | Bangladesh

|                                                                                   |        |        |     |     |     |   |     |           |      |                                   |
|-----------------------------------------------------------------------------------|--------|--------|-----|-----|-----|---|-----|-----------|------|-----------------------------------|
|  | M701F4 | HP     | 320 | 119 | 540 | 1 | 360 | 1 (1-1-1) | 2016 | Natural circulation<br>ASME stamp |
|                                                                                   |        | IP     | 347 | 39  | 568 |   |     |           |      |                                   |
|                                                                                   |        | LP     | 42  | 7   | 250 |   |     |           |      |                                   |
|                                                                                   |        | Reheat | 0   | 0   | 0   |   |     |           |      |                                   |

### Kazan | Russia

|                                                                                     |        |        |     |     |     |   |     |           |      |                                                                          |
|-------------------------------------------------------------------------------------|--------|--------|-----|-----|-----|---|-----|-----------|------|--------------------------------------------------------------------------|
|  | 9HA 01 | HP     | 411 | 147 | 562 | 1 | 540 | 1 (1-1-1) | 2016 | Cogen<br>District heating<br>R-GOST<br>Natural circulation<br>ASME stamp |
|                                                                                     |        | IP     | 121 | 51  | 305 |   |     |           |      |                                                                          |
|                                                                                     |        | LP     | 0   | 0   | 0   |   |     |           |      |                                                                          |
|                                                                                     |        | Reheat | 0   | 0   | 0   |   |     |           |      |                                                                          |

### Duhouk | Iraq

|                                                                                     |    |        |     |    |     |   |      |           |      |                                                                 |
|-------------------------------------------------------------------------------------|----|--------|-----|----|-----|---|------|-----------|------|-----------------------------------------------------------------|
|  | 9E | HP     | 175 | 75 | 524 | 8 | 1300 | 2 (4-4-1) | 2015 | Add-on<br>Natural circulation<br>Diverter damper,<br>ASME stamp |
|                                                                                     |    | IP     | 37  | 8  | 220 |   |      |           |      |                                                                 |
|                                                                                     |    | LP     | 0   | 0  | 0   |   |      |           |      |                                                                 |
|                                                                                     |    | Reheat | 0   | 0  | 0   |   |      |           |      |                                                                 |

### Woodbridge Energy Center | USA

|                                                                                     |        |        |     |     |     |   |     |           |      |                                                                   |
|-------------------------------------------------------------------------------------|--------|--------|-----|-----|-----|---|-----|-----------|------|-------------------------------------------------------------------|
|  | 7FA.05 | HP     | 361 | 135 | 567 | 2 | 700 | 1 (2-2-1) | 2015 | Post Combustion<br>SCR<br>CO<br>Natural circulation<br>ASME stamp |
|                                                                                     |        | IP     | 15  | 39  | 346 |   |     |           |      |                                                                   |
|                                                                                     |        | LP     | 20  | 6   | 311 |   |     |           |      |                                                                   |
|                                                                                     |        | Reheat | 371 | 36  | 507 |   |     |           |      |                                                                   |

| PROJECT | GT<br>Type | H.R.S.G |      |   | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |     | MW    | Layout |               |          |

### Sulaymaniyah | Iraq

|                                                                                   |    |        |     |    |     |   |      |           |      |                             |
|-----------------------------------------------------------------------------------|----|--------|-----|----|-----|---|------|-----------|------|-----------------------------|
|  | 9E | HP     | 175 | 75 | 524 | 8 | 1300 | 2 (4-4-1) | 2015 | Add-on                      |
|                                                                                   |    | IP     | 37  | 8  | 220 |   |      |           |      | Natural circulation         |
|                                                                                   |    | LP     | 0   | 0  | 0   |   |      |           |      | Diverter damper, ASME stamp |
|                                                                                   |    | Reheat | 0   | 0  | 0   |   |      |           |      |                             |

### Tashkent | Uzbekistan

|                                                                                   |     |        |     |     |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | 9FA | HP     | 262 | 107 | 568 | 1 | 370 | 1 (1-1-1) | 2014 | District Heating    |
|                                                                                   |     | IP     | 45  | 24  | 308 |   |     |           |      | ASME                |
|                                                                                   |     | LP     | 46  | 4   | 290 |   |     |           |      | Natural circulation |
|                                                                                   |     | Reheat | 290 | 21  | 567 |   |     |           |      | CE, U-GOST, PED     |

### Sousse D | Tunisia

|                                                                                   |          |        |     |     |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|----------|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | AE94.3 A | HP     | 190 | 132 | 567 | 1 | 400 | 1 (1-1-1) | 2013 | Natural circulation |
|                                                                                   |          | IP     | 29  | 39  | 330 |   |     |           |      |                     |
|                                                                                   |          | LP     | 22  | 6   | 245 |   |     |           |      |                     |
|                                                                                   |          | Reheat | 214 | 36  | 567 |   |     |           |      |                     |

### Siddhirganj | Bangladesh

|                                                                                     |     |        |     |     |     |   |     |           |      |                     |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | 9FA | HP     | 272 | 141 | 567 | 1 | 450 | 1 (1-1-1) | 2014 | Natural circulation |
|                                                                                     |     | IP     | 52  | 24  | 303 |   |     |           |      | ASME stamp          |
|                                                                                     |     | LP     | 46  | 3   | 299 |   |     |           |      |                     |
|                                                                                     |     | Reheat | 318 | 21  | 566 |   |     |           |      |                     |

### Yixing | China

|                                                                                     |            |        |     |     |     |   |     |           |      |                     |
|-------------------------------------------------------------------------------------|------------|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | SGT5-4000F | HP     | 280 | 136 | 557 | 2 | 864 | 2 (1-1-1) | 2014 | Natural circulation |
|                                                                                     |            | IP     | 58  | 37  | 339 |   |     |           |      |                     |
|                                                                                     |            | LP     | 51  | 5   | 248 |   |     |           |      |                     |
|                                                                                     |            | Reheat | 311 | 36  | 552 |   |     |           |      |                     |

### Cerro Dragon | Argentina

|                                                                                     |    |        |     |     |     |   |     |           |      |                             |
|-------------------------------------------------------------------------------------|----|--------|-----|-----|-----|---|-----|-----------|------|-----------------------------|
|  | 6B | HP     | 134 | 101 | 542 | 2 | 250 | 1 (2-2-1) | 2015 | Natural circulation         |
|                                                                                     |    | IP     | 0   | 0   | 0   |   |     |           |      | Diverter damper, ASME stamp |
|                                                                                     |    | LP     | 0   | 0   | 0   |   |     |           |      |                             |
|                                                                                     |    | Reheat | 0   | 0   | 0   |   |     |           |      |                             |

| PROJECT | GT<br>Type | H.R.S.G |      |   | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |     | MW    | Layout |               |          |

### Manaus | Brazil

|                                                                                   |            |        |     |     |     |   |     |           |      |                                   |
|-----------------------------------------------------------------------------------|------------|--------|-----|-----|-----|---|-----|-----------|------|-----------------------------------|
|  | SGT6-5000F | HP     | 215 | 131 | 567 | 2 | 580 | 1 (2-2-1) | 2014 | Natural circulation<br>ASME stamp |
|                                                                                   |            | IP     | 35  | 25  | 272 |   |     |           |      |                                   |
|                                                                                   |            | LP     | 22  | 4   | 257 |   |     |           |      |                                   |
|                                                                                   |            | Reheat | 242 | 26  | 566 |   |     |           |      |                                   |

### Ashuganj South | Bangladesh

|                                                                                   |            |        |     |     |     |   |     |           |      |                                                       |
|-----------------------------------------------------------------------------------|------------|--------|-----|-----|-----|---|-----|-----------|------|-------------------------------------------------------|
|  | SGT5-4000F | HP     | 275 | 129 | 568 | 1 | 450 | 1 (1-1-1) | 2016 | Natural circulation<br>Diverter damper,<br>ASME stamp |
|                                                                                   |            | IP     | 50  | 28  | 320 |   |     |           |      |                                                       |
|                                                                                   |            | LP     | 35  | 5   | 236 |   |     |           |      |                                                       |
|                                                                                   |            | Reheat | 309 | 30  | 567 |   |     |           |      |                                                       |

### Haidian | China

|                                                                                   |        |        |     |    |     |   |     |           |      |                            |
|-----------------------------------------------------------------------------------|--------|--------|-----|----|-----|---|-----|-----------|------|----------------------------|
|  | AE94.2 | HP     | 227 | 78 | 518 | 1 | 200 | 1 (1-1-1) | 2014 | SCR<br>Natural circulation |
|                                                                                   |        | IP     | 56  | 7  | 223 |   |     |           |      |                            |
|                                                                                   |        | LP     | 0   | 0  | 0   |   |     |           |      |                            |
|                                                                                   |        | Reheat | 0   | 0  | 0   |   |     |           |      |                            |

### Jingxi | China

|                                                                                     |            |        |     |     |     |   |      |                        |      |                            |
|-------------------------------------------------------------------------------------|------------|--------|-----|-----|-----|---|------|------------------------|------|----------------------------|
|  | SGT5-4000F | HP     | 257 | 125 | 532 | 3 | 1307 | 1 (2-2-1)<br>1 (1-1-1) | 2013 | SCR<br>Natural circulation |
|                                                                                     |            | IP     | 67  | 32  | 324 |   |      |                        |      |                            |
|                                                                                     |            | LP     | 50  | 5   | 237 |   |      |                        |      |                            |
|                                                                                     |            | Reheat | 314 | 31  | 524 |   |      |                        |      |                            |

### Erbil Gas Power Station | Iraq

|                                                                                     |    |        |     |    |     |   |      |           |      |                                                                 |
|-------------------------------------------------------------------------------------|----|--------|-----|----|-----|---|------|-----------|------|-----------------------------------------------------------------|
|  | 9E | HP     | 175 | 75 | 524 | 8 | 1300 | 2 (4-4-1) | 2014 | Add-on<br>Natural circulation<br>Diverter damper,<br>ASME stamp |
|                                                                                     |    | IP     | 37  | 8  | 220 |   |      |           |      |                                                                 |
|                                                                                     |    | LP     | 0   | 0  | 0   |   |      |           |      |                                                                 |
|                                                                                     |    | Reheat | 0   | 0  | 0   |   |      |           |      |                                                                 |

### Bouchain | France

|                                                                                     |        |        |     |     |     |   |     |           |      |                                                                           |
|-------------------------------------------------------------------------------------|--------|--------|-----|-----|-----|---|-----|-----------|------|---------------------------------------------------------------------------|
|  | 9HA 01 | HP     | 325 | 158 | 584 | 1 | 605 | 1 (1-1-1) | 2015 | SCR Provi<br>ASME<br>Natural circulation<br>Stainless steel<br>tubes, PED |
|                                                                                     |        | IP     | 56  | 30  | 320 |   |     |           |      |                                                                           |
|                                                                                     |        | LP     | 49  | 5   | 315 |   |     |           |      |                                                                           |
|                                                                                     |        | Reheat | 376 | 28  | 583 |   |     |           |      |                                                                           |

| PROJECT | GT Type | H.R.S.G |      |   |  | Qty | PLANT |        | Commissioning | Features |
|---------|---------|---------|------|---|--|-----|-------|--------|---------------|----------|
|         |         | t/h     | barA | C |  |     | MW    | Layout |               |          |

### Aliaga | Turkey

|                                                                                   |     |        |     |     |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | 9FA | HP     | 276 | 124 | 567 | 2 | 800 | 1 (2-2-1) | 2015 | Natural circulation |
|                                                                                   |     | IP     | 46  | 29  | 308 |   |     |           |      |                     |
|                                                                                   |     | LP     | 37  | 5   | 299 |   |     |           |      |                     |
|                                                                                   |     | Reheat | 313 | 26  | 564 |   |     |           |      |                     |

### Changping | China

|                                                                                   |            |        |     |    |     |   |     |           |      |                            |
|-----------------------------------------------------------------------------------|------------|--------|-----|----|-----|---|-----|-----------|------|----------------------------|
|  | SGT5-2000E | HP     | 228 | 78 | 518 | 1 | 200 | 1 (1-1-1) | 2013 | SCR<br>Natural circulation |
|                                                                                   |            | IP     | 56  | 6  | 223 |   |     |           |      |                            |
|                                                                                   |            | LP     | 0   | 0  | 0   |   |     |           |      |                            |
|                                                                                   |            | Reheat | 0   | 0  | 0   |   |     |           |      |                            |

### Suzhou | China

|                                                                                   |    |        |     |    |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|----|--------|-----|----|-----|---|-----|-----------|------|---------------------|
|  | 9E | HP     | 189 | 60 | 530 | 2 | 360 | 1 (2-2-1) | 2012 | Natural circulation |
|                                                                                   |    | IP     | 36  | 6  | 254 |   |     |           |      |                     |
|                                                                                   |    | LP     | 0   | 0  | 0   |   |     |           |      |                     |
|                                                                                   |    | Reheat | 0   | 0  | 0   |   |     |           |      |                     |

### West Deptford | USA

|                                                                                     |            |        |     |     |     |   |     |           |      |                                          |
|-------------------------------------------------------------------------------------|------------|--------|-----|-----|-----|---|-----|-----------|------|------------------------------------------|
|  | SGT6-5000F | HP     | 330 | 165 | 568 | 2 | 740 | 1 (2-2-1) | 2014 | SCR<br>Natural circulation<br>ASME stamp |
|                                                                                     |            | IP     | 58  | 42  | 322 |   |     |           |      |                                          |
|                                                                                     |            | LP     | 42  | 5   | 280 |   |     |           |      |                                          |
|                                                                                     |            | Reheat | 366 | 39  | 565 |   |     |           |      |                                          |

### Shoaiba II | Saudi Arabia

|                                                                                     |            |    |     |    |     |    |      |           |      |                                                |
|-------------------------------------------------------------------------------------|------------|----|-----|----|-----|----|------|-----------|------|------------------------------------------------|
|  | SGT6-2000E | HP | 142 | 75 | 523 | 10 | 1200 | 2 (5-5-1) | 2014 | Crude Oil<br>Natural circulation<br>ASME stamp |
|                                                                                     |            | LP | 29  | 5  | 149 |    |      |           |      |                                                |

### Pioneer, Bhagad | India

|                                                                                     |     |        |     |     |     |   |     |           |      |                     |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | 9FA | HP     | 273 | 107 | 568 | 1 | 388 | 1 (1-1-1) | 2014 | Natural circulation |
|                                                                                     |     | IP     | 45  | 23  | 291 |   |     |           |      |                     |
|                                                                                     |     | LP     | 31  | 4   | 284 |   |     |           |      |                     |
|                                                                                     |     | Reheat | 313 | 25  | 568 |   |     |           |      |                     |

| PROJECT | GT<br>Type | H.R.S.G |      |   | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |     | MW    | Layout |               |          |

### PPN II Pilaiperumalnallur | India

|                                                                                   |        |        |     |     |     |   |      |           |      |                     |
|-----------------------------------------------------------------------------------|--------|--------|-----|-----|-----|---|------|-----------|------|---------------------|
|  | M701F3 | HP     | 273 | 107 | 568 | 3 | 1080 | 3 (1-1-1) | 2013 | Natural circulation |
|                                                                                   |        | IP     | 45  | 23  | 291 |   |      |           |      |                     |
|                                                                                   |        | LP     | 31  | 4   | 284 |   |      |           |      |                     |
|                                                                                   |        | Reheat | 313 | 25  | 568 |   |      |           |      |                     |

### Amercoeur 2 | Belgium

|                                                                                   |          |        |     |     |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|----------|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | AE94.3 A | HP     | 280 | 117 | 544 | 1 | 400 | 1 (1-1-1) | 2016 | SCR Provi           |
|                                                                                   |          | IP     | 67  | 26  | 321 |   |     |           |      | EN                  |
|                                                                                   |          | LP     | 53  | 3   | 187 |   |     |           |      | Natural circulation |
|                                                                                   |          | Reheat | 338 | 27  | 543 |   |     |           |      | PED                 |

### Changyang | China

|                                                                                   |            |        |     |     |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|------------|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | SGT5-4000F | HP     | 268 | 132 | 550 | 2 | 836 | 1 (2-2-1) | 2013 | Cogen               |
|                                                                                   |            | IP     | 60  | 33  | 326 |   |     |           |      | SCR                 |
|                                                                                   |            | LP     | 43  | 7   | 242 |   |     |           |      | Natural circulation |
|                                                                                   |            | Reheat | 318 | 32  | 542 |   |     |           |      |                     |

### Dhuvaran III | India

|                                                                                     |            |        |     |     |     |   |     |           |      |                     |
|-------------------------------------------------------------------------------------|------------|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | SGT5-4000F | HP     | 265 | 123 | 567 | 1 | 375 | 1 (1-1-1) | 2013 | Natural circulation |
|                                                                                     |            | IP     | 51  | 31  | 305 |   |     |           |      |                     |
|                                                                                     |            | LP     | 35  | 4   | 237 |   |     |           |      |                     |
|                                                                                     |            | Reheat | 305 | 29  | 565 |   |     |           |      |                     |

### Sousse C | Tunisia

|                                                                                     |        |        |     |     |     |   |     |           |      |                     |
|-------------------------------------------------------------------------------------|--------|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | V94.3A | HP     | 190 | 132 | 567 | 1 | 400 | 1 (1-1-1) | 2013 | Natural circulation |
|                                                                                     |        | IP     | 29  | 39  | 330 |   |     |           |      |                     |
|                                                                                     |        | LP     | 22  | 6   | 245 |   |     |           |      |                     |
|                                                                                     |        | Reheat | 214 | 36  | 567 |   |     |           |      |                     |

### Qurayyah Ext. 1, Block6 | Saudi Arabia

|                                                                                     |     |        |     |     |     |   |     |           |      |                     |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | 7FA | HP     | 190 | 132 | 567 | 3 | 820 | 1 (3-3-1) | 2013 | ASME                |
|                                                                                     |     | IP     | 29  | 39  | 330 |   |     |           |      | Natural circulation |
|                                                                                     |     | LP     | 22  | 6   | 245 |   |     |           |      | PED                 |
|                                                                                     |     | Reheat | 214 | 36  | 567 |   |     |           |      |                     |

| PROJECT | GT Type | H.R.S.G |      |   |  | Qty | PLANT |        | Commissioning | Features |
|---------|---------|---------|------|---|--|-----|-------|--------|---------------|----------|
|         |         | t/h     | barA | C |  |     | MW    | Layout |               |          |

### Samalkot | India

|                                                                                   |     |        |     |     |     |   |      |           |      |                     |
|-----------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|------|-----------|------|---------------------|
|  | 9FA | HP     | 272 | 122 | 567 | 6 | 2500 | 3 (2-2-1) | 2012 | Natural circulation |
|                                                                                   |     | IP     | 45  | 28  | 310 |   |      |           |      |                     |
|                                                                                   |     | LP     | 39  | 7   | 310 |   |      |           |      |                     |
|                                                                                   |     | Reheat | 309 | 25  | 567 |   |      |           |      |                     |

### Caoqiao | China

|                                                                                   |            |        |     |     |     |   |     |           |      |                                      |
|-----------------------------------------------------------------------------------|------------|--------|-----|-----|-----|---|-----|-----------|------|--------------------------------------|
|  | SGT5-4000F | HP     | 262 | 131 | 549 | 2 | 835 | 1 (2-2-1) | 2012 | Cogen<br>SCR<br>Assisted circulation |
|                                                                                   |            | IP     | 64  | 33  | 312 |   |     |           |      |                                      |
|                                                                                   |            | LP     | 40  | 6   | 241 |   |     |           |      |                                      |
|                                                                                   |            | Reheat | 318 | 31  | 543 |   |     |           |      |                                      |

### Elektrenai | Lithuania

|                                                                                   |     |        |     |     |     |   |     |           |      |                                    |
|-----------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|------------------------------------|
|  | 9FB | HP     | 317 | 123 | 561 | 1 | 444 | 1 (1-1-1) | 2012 | ASME<br>Natural circulation<br>PED |
|                                                                                   |     | IP     | 37  | 26  | 298 |   |     |           |      |                                    |
|                                                                                   |     | LP     | 43  | 3   | 302 |   |     |           |      |                                    |
|                                                                                   |     | Reheat | 296 | 25  | 565 |   |     |           |      |                                    |

### Vemagiri 2 | India

|                                                                                     |     |        |     |     |     |   |     |           |      |                                         |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|-----------------------------------------|
|  | 9FA | HP     | 296 | 140 | 567 | 2 | 768 | 2 (1-1-1) | 2012 | Post Combustion<br>Assisted circulation |
|                                                                                     |     | IP     | 43  | 36  | 283 |   |     |           |      |                                         |
|                                                                                     |     | LP     | 31  | 4   | 285 |   |     |           |      |                                         |
|                                                                                     |     | Reheat | 341 | 33  | 568 |   |     |           |      |                                         |

### Belgian Refining Corporation | Belgium

|                                                                                     |           |        |    |    |     |   |     |           |      |                                                                                    |
|-------------------------------------------------------------------------------------|-----------|--------|----|----|-----|---|-----|-----------|------|------------------------------------------------------------------------------------|
|  | TITAN 130 | HP     | 45 | 23 | 340 | 1 | 120 | 1 (1-1-1) | 2010 | Post Combustion<br>Fresh Air, Flying<br>Take Over,<br>Recirculation of<br>Flue Gas |
|                                                                                     |           | IP     | 0  | 0  | 0   |   |     |           |      |                                                                                    |
|                                                                                     |           | LP     | 0  | 0  | 0   |   |     |           |      |                                                                                    |
|                                                                                     |           | Reheat | 0  | 0  | 0   |   |     |           |      |                                                                                    |

### Fenix, Chilca | Peru

|                                                                                     |     |        |     |     |     |   |     |           |      |                     |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | 7FA | HP     | 186 | 131 | 562 | 2 | 544 | 1 (2-2-1) | 2012 | Natural circulation |
|                                                                                     |     | IP     | 35  | 25  | 315 |   |     |           |      |                     |
|                                                                                     |     | LP     | 26  | 3   | 274 |   |     |           |      |                     |
|                                                                                     |     | Reheat | 216 | 24  | 562 |   |     |           |      |                     |

| PROJECT | GT<br>Type | H.R.S.G |      |   | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |     | MW    | Layout |               |          |

### Martigues | France

|                                                                                   |     |        |     |     |     |   |     |           |      |                            |
|-----------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|----------------------------|
|  | 9FB | HP     | 452 | 114 | 566 | 2 | 880 | 2 (1-1-1) | 2011 | Repowering                 |
|                                                                                   |     | IP     | 12  | 29  | 295 |   |     |           |      | Post Combustion            |
|                                                                                   |     | LP     | 11  | 3   | 122 |   |     |           |      | ASME                       |
|                                                                                   |     | Reheat | 462 | 27  | 565 |   |     |           |      | Natural circulation<br>PED |

### Blenod | France

|                                                                                   |     |        |     |     |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | 9FB | HP     | 315 | 130 | 567 | 1 | 440 | 1 (1-1-1) | 2011 | ASME                |
|                                                                                   |     | IP     | 41  | 27  | 315 |   |     |           |      | Natural circulation |
|                                                                                   |     | LP     | 20  | 5   | 271 |   |     |           |      | PED                 |
|                                                                                   |     | Reheat | 353 | 25  | 565 |   |     |           |      |                     |

### Yayvinskaya, Yajva | Russia

|                                                                                   |            |        |     |     |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|------------|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | SGT5-4000F | HP     | 261 | 119 | 544 | 1 | 450 | 1 (1-1-1) | 2011 | ASME                |
|                                                                                   |            | IP     | 55  | 30  | 306 |   |     |           |      | Natural circulation |
|                                                                                   |            | LP     | 45  | 4   | 284 |   |     |           |      | PED                 |
|                                                                                   |            | Reheat | 306 | 29  | 540 |   |     |           |      |                     |

### Dunamenti 3 | Hungary

|                                                                                     |        |        |     |     |     |   |     |           |      |                            |
|-------------------------------------------------------------------------------------|--------|--------|-----|-----|-----|---|-----|-----------|------|----------------------------|
|  | V94.3A | HP     | 248 | 115 | 545 | 1 | 380 | 1 (1-1-1) | 2011 | Repowering                 |
|                                                                                     |        | IP     | 49  | 21  | 312 |   |     |           |      | District Heating           |
|                                                                                     |        | LP     | 54  | 6   | 270 |   |     |           |      | ASME                       |
|                                                                                     |        | Reheat | 291 | 19  | 540 |   |     |           |      | Natural circulation<br>PED |

### Uskmouth - Severn | UK

|                                                                                     |            |        |     |     |     |   |     |           |      |                        |
|-------------------------------------------------------------------------------------|------------|--------|-----|-----|-----|---|-----|-----------|------|------------------------|
|  | SGT5-4000F | HP     | 260 | 129 | 563 | 2 | 850 | 2 (1-1-1) | 2010 | SCR Provi              |
|                                                                                     |            | IP     | 60  | 32  | 321 |   |     |           |      | ASME                   |
|                                                                                     |            | LP     | 42  | 4   | 234 |   |     |           |      | Natural circulation    |
|                                                                                     |            | Reheat | 318 | 30  | 560 |   |     |           |      | Once Through<br>Benson |

### Papalanto CCPP | NIGERIA

|                                                                                     |    |        |     |    |     |   |     |           |      |                     |
|-------------------------------------------------------------------------------------|----|--------|-----|----|-----|---|-----|-----------|------|---------------------|
|  | 9E | HP     | 179 | 73 | 523 | 4 | 750 | 2 (2-2-1) | 2010 | Natural circulation |
|                                                                                     |    | IP     | 39  | 7  | 257 |   |     |           |      | Diverter damper     |
|                                                                                     |    | LP     | 0   | 0  | 0   |   |     |           |      |                     |
|                                                                                     |    | Reheat | 0   | 0  | 0   |   |     |           |      |                     |

| PROJECT | GT<br>Type | H.R.S.G |      |   |  | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|--|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |  |     | MW    | Layout |               |          |

### Nandipur | Pakistan

|                                                                                   |    |        |     |    |     |   |     |           |      |                                    |
|-----------------------------------------------------------------------------------|----|--------|-----|----|-----|---|-----|-----------|------|------------------------------------|
|  | 9E | HP     | 147 | 71 | 480 | 3 | 480 | 1 (3-3-1) | 2010 | Heavy Fuel<br>Assisted Circulation |
|                                                                                   |    | IP     | 14  | 1  | 295 |   |     |           |      |                                    |
|                                                                                   |    | LP     | 0   | 0  | 0   |   |     |           |      |                                    |
|                                                                                   |    | Reheat | 0   | 0  | 0   |   |     |           |      |                                    |

### Victorville | USA

|                                                                                   |     |        |     |     |     |   |     |           |      |                                                                                           |
|-----------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|-------------------------------------------------------------------------------------------|
|  | 7FA | HP     | 320 | 131 | 567 | 2 | 570 | 1 (2-2-1) | 2010 | Post Combustion<br>SCR<br>CO<br>Natural circulation<br>Integrated Solar<br>Combined Cycle |
|                                                                                   |     | IP     | 9   | 35  | 310 |   |     |           |      |                                                                                           |
|                                                                                   |     | LP     | 9   | 4   | 317 |   |     |           |      |                                                                                           |
|                                                                                   |     | Reheat | 347 | 32  | 566 |   |     |           |      |                                                                                           |

### Emile Huchet St Avoird | France

|                                                                                   |            |        |     |     |     |   |     |           |      |                                    |
|-----------------------------------------------------------------------------------|------------|--------|-----|-----|-----|---|-----|-----------|------|------------------------------------|
|  | SGT5-4000F | HP     | 299 | 130 | 567 | 2 | 860 | 2 (1-1-1) | 2010 | ASME<br>Natural circulation<br>PED |
|                                                                                   |            | IP     | 55  | 32  | 320 |   |     |           |      |                                    |
|                                                                                   |            | LP     | 39  | 4   | 234 |   |     |           |      |                                    |
|                                                                                   |            | Reheat | 328 | 31  | 565 |   |     |           |      |                                    |

### Nevinnomyssk | Russia

|                                                                                     |            |        |     |     |     |   |     |           |      |                     |
|-------------------------------------------------------------------------------------|------------|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | SGT5-4000F | HP     | 259 | 125 | 551 | 1 | 450 | 1 (1-1-1) | 2010 | Natural circulation |
|                                                                                     |            | IP     | 44  | 32  | 309 |   |     |           |      |                     |
|                                                                                     |            | LP     | 49  | 5   | 285 |   |     |           |      |                     |
|                                                                                     |            | Reheat | 301 | 28  | 545 |   |     |           |      |                     |

### Surgut | Russia

|                                                                                     |     |        |     |     |     |   |     |           |      |                     |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | 9FA | HP     | 285 | 104 | 556 | 2 | 800 | 2 (1-1-1) | 2010 | Natural circulation |
|                                                                                     |     | IP     | 43  | 25  | 300 |   |     |           |      |                     |
|                                                                                     |     | LP     | 41  | 5   | 294 |   |     |           |      |                     |
|                                                                                     |     | Reheat | 316 | 23  | 556 |   |     |           |      |                     |

### Az Zour | Kuwait

|                                                                                     |            |        |     |    |     |   |      |           |      |                               |
|-------------------------------------------------------------------------------------|------------|--------|-----|----|-----|---|------|-----------|------|-------------------------------|
|  | SGT5-2000E | HP     | 222 | 80 | 538 | 8 | 1560 | 2 (4-4-1) | 2010 | Add-on<br>Natural circulation |
|                                                                                     |            | IP     | 29  | 5  | 213 |   |      |           |      |                               |
|                                                                                     |            | LP     | 0   | 0  | 0   |   |      |           |      |                               |
|                                                                                     |            | Reheat | 0   | 0  | 0   |   |      |           |      |                               |

| PROJECT | GT<br>Type | H.R.S.G |      |   | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |     | MW    | Layout |               |          |

### Gunsan | South Korea

|                                                                                   |       |        |     |     |     |   |     |           |      |                                  |
|-----------------------------------------------------------------------------------|-------|--------|-----|-----|-----|---|-----|-----------|------|----------------------------------|
|  | M701G | HP     | 259 | 126 | 567 | 2 | 700 | 1 (2-2-1) | 2009 | SCR Provi<br>Natural circulation |
|                                                                                   |       | IP     | 57  | 44  | 235 |   |     |           |      |                                  |
|                                                                                   |       | LP     | 39  | 6   | 253 |   |     |           |      |                                  |
|                                                                                   |       | Reheat | 259 | 35  | 568 |   |     |           |      |                                  |

### Whitegate | Ireland

|                                                                                   |     |        |     |     |     |   |     |           |      |                                        |
|-----------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|----------------------------------------|
|  | 9FB | HP     | 421 | 169 | 554 | 1 | 450 | 1 (1-1-1) | 2009 | Post Combustion<br>Natural circulation |
|                                                                                   |     | IP     | 14  | 33  | 316 |   |     |           |      |                                        |
|                                                                                   |     | LP     | 30  | 5   | 316 |   |     |           |      |                                        |
|                                                                                   |     | Reheat | 427 | 31  | 542 |   |     |           |      |                                        |

### Sloe | Netherlands

|                                                                                   |            |        |     |     |     |   |     |           |      |                                                                    |
|-----------------------------------------------------------------------------------|------------|--------|-----|-----|-----|---|-----|-----------|------|--------------------------------------------------------------------|
|  | SGT5-4000F | HP     | 260 | 129 | 563 | 2 | 850 | 2 (1-1-1) | 2009 | SCR Provi<br>ASME<br>Natural circulation<br>Once Through<br>Benson |
|                                                                                   |            | IP     | 60  | 32  | 321 |   |     |           |      |                                                                    |
|                                                                                   |            | LP     | 42  | 4   | 234 |   |     |           |      |                                                                    |
|                                                                                   |            | Reheat | 318 | 30  | 560 |   |     |           |      |                                                                    |

### Putian | China

|                                                                                     |       |        |     |     |     |   |      |           |      |                     |
|-------------------------------------------------------------------------------------|-------|--------|-----|-----|-----|---|------|-----------|------|---------------------|
|  | M701F | HP     | 283 | 105 | 540 | 4 | 1400 | 4 (1-1-1) | 2009 | Natural circulation |
|                                                                                     |       | IP     | 42  | 37  | 274 |   |      |           |      |                     |
|                                                                                     |       | LP     | 43  | 4   | 245 |   |      |           |      |                     |
|                                                                                     |       | Reheat | 313 | 35  | 568 |   |      |           |      |                     |

### North Bangkok | Thailand

|                                                                                     |     |        |     |     |     |   |     |           |      |                                   |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|-----------------------------------|
|  | 9FA | HP     | 267 | 135 | 569 | 2 | 730 | 1 (2-2-1) | 2009 | Natural circulation<br>ASME stamp |
|                                                                                     |     | IP     | 49  | 26  | 305 |   |     |           |      |                                   |
|                                                                                     |     | LP     | 29  | 6   | 293 |   |     |           |      |                                   |
|                                                                                     |     | Reheat | 310 | 24  | 569 |   |     |           |      |                                   |

### Shatura | Russia

|                                                                                     |     |        |     |     |     |   |     |           |      |                     |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | 9FA | HP     | 285 | 104 | 556 | 1 | 400 | 1 (1-1-1) | 2009 | Natural circulation |
|                                                                                     |     | IP     | 43  | 25  | 300 |   |     |           |      |                     |
|                                                                                     |     | LP     | 41  | 5   | 294 |   |     |           |      |                     |
|                                                                                     |     | Reheat | 316 | 23  | 556 |   |     |           |      |                     |

| PROJECT | GT<br>Type | H.R.S.G |      |   | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |     | MW    | Layout |               |          |

### Dubai Aluminium Smelter Complex, GTX Jebel Ali | UAE

|                                                                                   |        |        |     |    |     |   |     |           |      |                              |
|-----------------------------------------------------------------------------------|--------|--------|-----|----|-----|---|-----|-----------|------|------------------------------|
|  | GT13E2 | HP     | 216 | 70 | 517 | 1 | 320 | 1 (1-1-1) | 2009 | Cogen<br>Natural circulation |
|                                                                                   |        | IP     | 54  | 6  | 267 |   |     |           |      |                              |
|                                                                                   |        | LP     | 0   | 0  | 0   |   |     |           |      |                              |
|                                                                                   |        | Reheat | 0   | 0  | 0   |   |     |           |      |                              |

### El Kureimat III | Egypt

|                                                                                   |     |        |     |     |     |   |     |           |      |                                   |
|-----------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|-----------------------------------|
|  | 9FA | HP     | 253 | 130 | 568 | 2 | 750 | 1 (2-2-1) | 2010 | Natural circulation<br>ASME stamp |
|                                                                                   |     | IP     | 50  | 26  | 312 |   |     |           |      |                                   |
|                                                                                   |     | LP     | 37  | 5   | 300 |   |     |           |      |                                   |
|                                                                                   |     | Reheat | 303 | 24  | 565 |   |     |           |      |                                   |

### Hobbs Generating Station | USA

|                                                                                   |        |        |     |     |     |   |     |           |      |                                                     |
|-----------------------------------------------------------------------------------|--------|--------|-----|-----|-----|---|-----|-----------|------|-----------------------------------------------------|
|  | M501FD | HP     | 271 | 129 | 568 | 2 | 600 | 1 (2-2-1) | 2008 | Post Combustion<br>SCR<br>CO<br>Natural circulation |
|                                                                                   |        | IP     | 15  | 36  | 340 |   |     |           |      |                                                     |
|                                                                                   |        | LP     | 17  | 5   | 311 |   |     |           |      |                                                     |
|                                                                                   |        | Reheat | 288 | 34  | 566 |   |     |           |      |                                                     |

### Dell Power Plant | USA

|                                                                                     |     |        |     |     |     |   |     |           |      |                                               |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|-----------------------------------------------|
|  | 7FA | HP     | 286 | 128 | 565 | 2 | 590 | 1 (2-2-1) | 2007 | Post Combustion<br>SCR<br>Natural circulation |
|                                                                                     |     | IP     | 20  | 35  | 339 |   |     |           |      |                                               |
|                                                                                     |     | LP     | 19  | 4   | 313 |   |     |           |      |                                               |
|                                                                                     |     | Reheat | 302 | 33  | 566 |   |     |           |      |                                               |

### Deir Ali | Syria

|                                                                                     |            |        |     |     |     |   |     |           |      |                     |
|-------------------------------------------------------------------------------------|------------|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | SGT5-4000F | HP     | 243 | 127 | 567 | 2 | 800 | 1 (2-2-1) | 2009 | Natural circulation |
|                                                                                     |            | IP     | 54  | 31  | 331 |   |     |           |      |                     |
|                                                                                     |            | LP     | 30  | 6   | 238 |   |     |           |      |                     |
|                                                                                     |            | Reheat | 287 | 30  | 565 |   |     |           |      |                     |

### Amercoeur | Belgium

|                                                                                     |     |        |     |     |     |   |     |           |      |                                                               |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|---------------------------------------------------------------|
|  | 9FB | HP     | 297 | 122 | 565 | 1 | 420 | 1 (1-1-1) | 2008 | Repowering<br>SCR Provi<br>ASME<br>Natural circulation<br>PED |
|                                                                                     |     | IP     | 56  | 29  | 363 |   |     |           |      |                                                               |
|                                                                                     |     | LP     | 33  | 3   | 182 |   |     |           |      |                                                               |
|                                                                                     |     | Reheat | 348 | 27  | 565 |   |     |           |      |                                                               |

| PROJECT | GT Type | H.R.S.G |      |   |  | Qty | PLANT |        | Commissioning | Features |
|---------|---------|---------|------|---|--|-----|-------|--------|---------------|----------|
|         |         | t/h     | barA | C |  |     | MW    | Layout |               |          |

### Manuel Belgrano | Argentina

|                                                                                   |            |        |     |     |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|------------|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | SGT5-4000F | HP     | 299 | 130 | 567 | 2 | 800 | 1 (2-2-1) | 2008 | Natural circulation |
|                                                                                   |            | IP     | 55  | 32  | 320 |   |     |           |      |                     |
|                                                                                   |            | LP     | 39  | 4   | 234 |   |     |           |      |                     |
|                                                                                   |            | Reheat | 328 | 31  | 565 |   |     |           |      |                     |

### San Martin | Argentina

|                                                                                   |            |        |     |     |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|------------|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | SGT5-4000F | HP     | 299 | 130 | 567 | 2 | 800 | 1 (2-2-1) | 2008 | Natural circulation |
|                                                                                   |            | IP     | 55  | 32  | 320 |   |     |           |      |                     |
|                                                                                   |            | LP     | 39  | 4   | 234 |   |     |           |      |                     |
|                                                                                   |            | Reheat | 328 | 31  | 565 |   |     |           |      |                     |

### Pont-sur-Sambre | France

|                                                                                   |            |        |     |     |     |   |     |           |      |                                    |
|-----------------------------------------------------------------------------------|------------|--------|-----|-----|-----|---|-----|-----------|------|------------------------------------|
|  | SGT5-4000F | HP     | 299 | 130 | 567 | 1 | 400 | 1 (1-1-1) | 2008 | ASME<br>Natural circulation<br>PED |
|                                                                                   |            | IP     | 55  | 32  | 320 |   |     |           |      |                                    |
|                                                                                   |            | LP     | 39  | 4   | 234 |   |     |           |      |                                    |
|                                                                                   |            | Reheat | 328 | 31  | 565 |   |     |           |      |                                    |

### Grays Harbor Energy Facility Satsop | USA

|                                                                                     |     |        |     |     |     |   |     |           |      |                                               |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|-----------------------------------------------|
|  | 7FA | HP     | 371 | 129 | 568 | 2 | 620 | 1 (2-2-1) | 2008 | Post Combustion<br>SCR<br>Natural circulation |
|                                                                                     |     | IP     | 7   | 42  | 347 |   |     |           |      |                                               |
|                                                                                     |     | LP     | 1   | 6   | 347 |   |     |           |      |                                               |
|                                                                                     |     | Reheat | 374 | 39  | 557 |   |     |           |      |                                               |

### Baotou | China

|                                                                                     |       |        |     |    |     |   |     |           |      |                                  |
|-------------------------------------------------------------------------------------|-------|--------|-----|----|-----|---|-----|-----------|------|----------------------------------|
|  | M701D | HP     | 161 | 69 | 533 | 2 | 280 | 2 (1-1-1) | 2008 | Natural circulation<br>BFG & COG |
|                                                                                     |       | IP     | 22  | 7  | 275 |   |     |           |      |                                  |
|                                                                                     |       | LP     | 0   | 0  | 0   |   |     |           |      |                                  |
|                                                                                     |       | Reheat | 0   | 0  | 0   |   |     |           |      |                                  |

### Exxon Antwerp | Belgium

|                                                                                     |         |        |     |    |     |   |     |           |      |                                                                                              |
|-------------------------------------------------------------------------------------|---------|--------|-----|----|-----|---|-----|-----------|------|----------------------------------------------------------------------------------------------|
|  | PG9171E | HP     | 170 | 43 | 420 | 1 | 123 | 1 (1-1-0) | 2008 | Cogen<br>Post Combustion<br>SCR Provi<br>ASME<br>Crude Oil<br>Assisted<br>Circulation<br>PED |
|                                                                                     |         | IP     | 0   | 0  | 0   |   |     |           |      |                                                                                              |
|                                                                                     |         | LP     | 0   | 0  | 0   |   |     |           |      |                                                                                              |
|                                                                                     |         | Reheat | 0   | 0  | 0   |   |     |           |      |                                                                                              |
|                                                                                     |         |        |     |    |     |   |     |           |      |                                                                                              |

| PROJECT | GT Type | H.R.S.G |      |   |  | Qty | PLANT |        | Commissioning | Features |
|---------|---------|---------|------|---|--|-----|-------|--------|---------------|----------|
|         |         | t/h     | barA | C |  |     | MW    | Layout |               |          |

### AGD II Asab Gas Development | UAE

|                                                                                   |         |        |    |    |     |   |    |           |      |                                       |
|-----------------------------------------------------------------------------------|---------|--------|----|----|-----|---|----|-----------|------|---------------------------------------|
|  | Frame 5 | HP     | 45 | 49 | 374 | 2 | 66 | 1 (2-2-0) | 2007 | Natural circulation<br>Louvre dampers |
|                                                                                   |         | IP     | 0  | 0  | 0   |   |    |           |      |                                       |
|                                                                                   |         | LP     | 0  | 0  | 0   |   |    |           |      |                                       |
|                                                                                   |         | Reheat | 0  | 0  | 0   |   |    |           |      |                                       |

### El Kureimat II | Egypt

|                                                                                   |            |        |     |     |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|------------|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | SGT5-4000F | HP     | 253 | 130 | 568 | 2 | 750 | 1 (2-2-1) | 2008 | Natural circulation |
|                                                                                   |            | IP     | 50  | 26  | 312 |   |     |           |      |                     |
|                                                                                   |            | LP     | 37  | 5   | 300 |   |     |           |      |                     |
|                                                                                   |            | Reheat | 303 | 24  | 565 |   |     |           |      |                     |

### New Talkha | Egypt

|                                                                                   |            |        |     |     |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|------------|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | SGT5-4000F | HP     | 253 | 130 | 567 | 2 | 750 | 1 (2-2-1) | 2008 | Natural circulation |
|                                                                                   |            | IP     | 50  | 26  | 311 |   |     |           |      |                     |
|                                                                                   |            | LP     | 37  | 5   | 300 |   |     |           |      |                     |
|                                                                                   |            | Reheat | 302 | 24  | 565 |   |     |           |      |                     |

### Luna Energy Facility | USA

|                                                                                     |     |        |     |     |     |   |     |           |      |                                                                        |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|------------------------------------------------------------------------|
|  | 7FA | HP     | 371 | 128 | 567 | 2 | 570 | 1 (2-2-1) | 2007 | Post Combustion<br>SCR<br>CO<br>Natural circulation<br>Diverter damper |
|                                                                                     |     | IP     | 0   | 0   | 0   |   |     |           |      |                                                                        |
|                                                                                     |     | LP     | 0   | 0   | 0   |   |     |           |      |                                                                        |
|                                                                                     |     | Reheat | 0   | 0   | 0   |   |     |           |      |                                                                        |

### Faribault Energy Park | USA

|                                                                                     |     |        |     |    |     |   |     |           |      |                                               |
|-------------------------------------------------------------------------------------|-----|--------|-----|----|-----|---|-----|-----------|------|-----------------------------------------------|
|  | 7FA | HP     | 153 | 91 | 566 | 1 | 250 | 1 (1-1-1) | 2007 | Post Combustion<br>SCR<br>Natural circulation |
|                                                                                     |     | IP     | 28  | 23 | 305 |   |     |           |      |                                               |
|                                                                                     |     | LP     | 23  | 3  | 277 |   |     |           |      |                                               |
|                                                                                     |     | Reheat | 210 | 22 | 566 |   |     |           |      |                                               |

### Afton | USA

|                                                                                     |     |        |     |    |     |   |     |           |      |                                               |
|-------------------------------------------------------------------------------------|-----|--------|-----|----|-----|---|-----|-----------|------|-----------------------------------------------|
|  | 7FA | HP     | 153 | 91 | 566 | 1 | 250 | 1 (1-1-1) | 2007 | Post Combustion<br>SCR<br>Natural circulation |
|                                                                                     |     | IP     | 28  | 23 | 305 |   |     |           |      |                                               |
|                                                                                     |     | LP     | 23  | 3  | 277 |   |     |           |      |                                               |
|                                                                                     |     | Reheat | 210 | 22 | 566 |   |     |           |      |                                               |

| PROJECT | GT Type | H.R.S.G |      |   | Qty | PLANT |        | Commissioning | Features |
|---------|---------|---------|------|---|-----|-------|--------|---------------|----------|
|         |         | t/h     | barA | C |     | MW    | Layout |               |          |

### Sumgait | Azerbaijan

|                                                                                   |            |        |     |    |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|------------|--------|-----|----|-----|---|-----|-----------|------|---------------------|
|  | SGT5-2000E | HP     | 243 | 84 | 529 | 2 | 400 | 1 (2-2-1) | 2007 | Natural circulation |
|                                                                                   |            | IP     | 57  | 5  | 201 |   |     |           |      |                     |
|                                                                                   |            | LP     | 0   | 0  | 0   |   |     |           |      |                     |
|                                                                                   |            | Reheat | 0   | 0  | 0   |   |     |           |      |                     |

### Keppel Merlimau | Singapore

|                                                                                   |        |        |     |    |     |   |     |           |      |                                        |
|-----------------------------------------------------------------------------------|--------|--------|-----|----|-----|---|-----|-----------|------|----------------------------------------|
|  | GT13E2 | HP     | 219 | 75 | 521 | 2 | 480 | 1 (2-2-1) | 2007 | Post Combustion<br>Natural circulation |
|                                                                                   |        | LP     | 54  | 6  | 273 |   |     |           |      |                                        |
|                                                                                   |        | Reheat | 0   | 0  | 0   |   |     |           |      |                                        |

### Dubai Aluminium Smelter Complex, CCPP22 Jebel Ali | UAE

|                                                                                   |        |        |     |    |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|--------|--------|-----|----|-----|---|-----|-----------|------|---------------------|
|  | GT13E2 | HP     | 216 | 70 | 517 | 2 | 470 | 1 (2-2-1) | 2007 | Natural circulation |
|                                                                                   |        | IP     | 54  | 6  | 267 |   |     |           |      |                     |
|                                                                                   |        | LP     | 0   | 0  | 0   |   |     |           |      |                     |
|                                                                                   |        | Reheat | 0   | 0  | 0   |   |     |           |      |                     |

### Amata | Thailand

|                                                                                    |    |        |    |    |     |   |    |           |      |                                        |
|------------------------------------------------------------------------------------|----|--------|----|----|-----|---|----|-----------|------|----------------------------------------|
|  | 6B | HP     | 68 | 56 | 528 | 1 | 55 | 1 (1-1-1) | 2007 | Natural circulation<br>Diverter damper |
|                                                                                    |    | IP     | 10 | 6  | 263 |   |    |           |      |                                        |
|                                                                                    |    | LP     | 3  | 0  | 0   |   |    |           |      |                                        |
|                                                                                    |    | Reheat | 0  | 0  | 0   |   |    |           |      |                                        |

### OGD, III Onshore Gas Development | UAE

|                                                                                     |         |        |    |    |     |   |     |  |      |                                                           |
|-------------------------------------------------------------------------------------|---------|--------|----|----|-----|---|-----|--|------|-----------------------------------------------------------|
|  | Frame 5 | HP     | 80 | 40 | 420 | 8 | 760 |  | 2007 | Post Combustion<br>Natural circulation<br>Diverter damper |
|                                                                                     |         | IP     | 0  | 0  | 0   |   |     |  |      |                                                           |
|                                                                                     |         | LP     | 0  | 0  | 0   |   |     |  |      |                                                           |
|                                                                                     |         | Reheat | 0  | 0  | 0   |   |     |  |      |                                                           |

### Chuck Lenzie Generating Station Las Vegas | USA

|                                                                                     |     |        |     |     |     |   |      |           |      |                                                     |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|------|-----------|------|-----------------------------------------------------|
|  | 7FA | HP     | 371 | 128 | 567 | 4 | 1200 | 2 (2-2-1) | 2007 | Post Combustion<br>SCR<br>CO<br>Natural circulation |
|                                                                                     |     | IP     | 6   | 41  | 346 |   |      |           |      |                                                     |
|                                                                                     |     | LP     | 1   | 5   | 316 |   |      |           |      |                                                     |
|                                                                                     |     | Reheat | 374 | 37  | 557 |   |      |           |      |                                                     |

| PROJECT | GT Type | H.R.S.G |      |   | Qty | PLANT |        | Commissioning | Features |
|---------|---------|---------|------|---|-----|-------|--------|---------------|----------|
|         |         | t/h     | barA | C |     | MW    | Layout |               |          |

### Jack County Generation Facility Bridgeport| USA

|                                                                                   |     |        |     |     |     |   |     |           |      |                                               |
|-----------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|-----------------------------------------------|
|  | 7FA | HP     | 371 | 128 | 567 | 2 | 620 | 1 (2-2-1) | 2007 | Post Combustion<br>SCR<br>Natural circulation |
|                                                                                   |     | IP     | 6   | 41  | 346 |   |     |           |      |                                               |
|                                                                                   |     | LP     | 1   | 5   | 316 |   |     |           |      |                                               |
|                                                                                   |     | Reheat | 374 | 37  | 557 |   |     |           |      |                                               |

### Castelnou | Spain

|                                                                                   |       |        |     |     |     |   |     |           |      |                                    |
|-----------------------------------------------------------------------------------|-------|--------|-----|-----|-----|---|-----|-----------|------|------------------------------------|
|  | M701F | HP     | 271 | 124 | 540 | 2 | 800 | 1 (2-2-1) | 2006 | ASME<br>Natural circulation<br>PED |
|                                                                                   |       | IP     | 46  | 37  | 283 |   |     |           |      |                                    |
|                                                                                   |       | LP     | 41  | 6   | 250 |   |     |           |      |                                    |
|                                                                                   |       | Reheat | 310 | 35  | 568 |   |     |           |      |                                    |

### Konaseema | India

|                                                                                   |       |        |     |     |     |   |     |           |      |                      |
|-----------------------------------------------------------------------------------|-------|--------|-----|-----|-----|---|-----|-----------|------|----------------------|
|  | V94.2 | HP     | 215 | 112 | 524 | 2 | 445 | 1 (2-2-1) | 2006 | Assisted Circulation |
|                                                                                   |       | IP     | 38  | 23  | 323 |   |     |           |      |                      |
|                                                                                   |       | LP     | 19  | 4   | 223 |   |     |           |      |                      |
|                                                                                   |       | Reheat | 0   | 0   | 0   |   |     |           |      |                      |

### Vemagiri | India

|                                                                                     |     |        |     |     |     |   |     |           |      |                                         |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|-----------------------------------------|
|  | 9FA | HP     | 323 | 127 | 568 | 1 | 388 | 1 (1-1-1) | 2005 | Post Combustion<br>Assisted Circulation |
|                                                                                     |     | IP     | 39  | 27  | 339 |   |     |           |      |                                         |
|                                                                                     |     | LP     | 31  | 4   | 260 |   |     |           |      |                                         |
|                                                                                     |     | Reheat | 360 | 26  | 568 |   |     |           |      |                                         |

### New Bangkok International Airport | Thailand

|                                                                                     |         |        |    |    |     |   |    |           |      |                     |
|-------------------------------------------------------------------------------------|---------|--------|----|----|-----|---|----|-----------|------|---------------------|
|  | Frame 5 | HP     | 42 | 62 | 460 | 2 | 60 | 1 (2-2-1) | 2005 | Natural circulation |
|                                                                                     |         | IP     | 0  | 0  | 0   |   |    |           |      |                     |
|                                                                                     |         | LP     | 0  | 0  | 0   |   |    |           |      |                     |
|                                                                                     |         | Reheat | 0  | 0  | 0   |   |    |           |      |                     |

### Thessaloniki | Greece

|                                                                                     |     |        |     |     |     |   |     |           |      |                                    |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|------------------------------------|
|  | 9FA | HP     | 272 | 124 | 566 | 1 | 390 | 1 (1-1-1) | 2005 | ASME<br>Natural circulation<br>PED |
|                                                                                     |     | IP     | 55  | 27  | 332 |   |     |           |      |                                    |
|                                                                                     |     | LP     | 33  | 4   | 276 |   |     |           |      |                                    |
|                                                                                     |     | Reheat | 319 | 26  | 566 |   |     |           |      |                                    |

| PROJECT | GT Type | H.R.S.G |      |   | Qty | PLANT |        | Commissioning | Features |
|---------|---------|---------|------|---|-----|-------|--------|---------------|----------|
|         |         | t/h     | barA | C |     | MW    | Layout |               |          |

### Yulchon | South Korea

|                                                                                   |         |        |     |     |     |   |     |           |      |                                        |
|-----------------------------------------------------------------------------------|---------|--------|-----|-----|-----|---|-----|-----------|------|----------------------------------------|
|  | W501FD2 | HP     | 223 | 153 | 567 | 2 | 550 | 1 (2-2-1) | 2005 | Post Combustion<br>Natural circulation |
|                                                                                   |         | IP     | 77  | 29  | 312 |   |     |           |      |                                        |
|                                                                                   |         | LP     | 26  | 3   | 240 |   |     |           |      |                                        |
|                                                                                   |         | Reheat | 247 | 27  | 565 |   |     |           |      |                                        |

### Dubai Aluminium Smelter Complex, Kestrel Jebel Ali, DubaÄ | UAE

|                                                                                   |         |        |     |    |     |   |     |           |      |                      |
|-----------------------------------------------------------------------------------|---------|--------|-----|----|-----|---|-----|-----------|------|----------------------|
|  | PG9171E | HP     | 180 | 73 | 521 | 2 | 332 | 1 (2-2-1) | 2005 | Assisted Circulation |
|                                                                                   |         | IP     | 36  | 6  | 207 |   |     |           |      |                      |
|                                                                                   |         | LP     | 0   | 0  | 0   |   |     |           |      |                      |
|                                                                                   |         | Reheat | 0   | 0  | 0   |   |     |           |      |                      |

### Uralsk Power Plant | Kazakhstan

|                                                                                   |     |        |    |    |     |   |    |           |      |                     |
|-----------------------------------------------------------------------------------|-----|--------|----|----|-----|---|----|-----------|------|---------------------|
|  | H25 | HP     | 48 | 38 | 437 | 1 | 25 | 1 (1-1-1) | 2004 | Natural circulation |
|                                                                                   |     | IP     | 0  | 0  | 0   |   |    |           |      |                     |
|                                                                                   |     | LP     | 0  | 0  | 0   |   |    |           |      |                     |
|                                                                                   |     | Reheat | 0  | 0  | 0   |   |    |           |      |                     |

### Rio Bravo 4 | Mexico

|                                                                                     |       |        |     |     |     |   |     |           |      |                                         |
|-------------------------------------------------------------------------------------|-------|--------|-----|-----|-----|---|-----|-----------|------|-----------------------------------------|
|  | W501F | HP     | 189 | 133 | 556 | 2 | 500 | 1 (2-2-1) | 2005 | Post Combustion<br>Assisted Circulation |
|                                                                                     |       | IP     | 33  | 32  | 315 |   |     |           |      |                                         |
|                                                                                     |       | LP     | 37  | 5   | 291 |   |     |           |      |                                         |
|                                                                                     |       | Reheat | 215 | 29  | 555 |   |     |           |      |                                         |

### Senoko Stage 1 Phase 2 | Singapore

|                                                                                     |      |        |     |     |     |   |     |           |      |                                   |
|-------------------------------------------------------------------------------------|------|--------|-----|-----|-----|---|-----|-----------|------|-----------------------------------|
|  | GT26 | HP     | 322 | 128 | 568 | 2 | 720 | 1 (2-2-1) | 2004 | Repowering<br>Natural circulation |
|                                                                                     |      | IP     | 27  | 41  | 320 |   |     |           |      |                                   |
|                                                                                     |      | LP     | 17  | 6   | 237 |   |     |           |      |                                   |
|                                                                                     |      | Reheat | 332 | 39  | 568 |   |     |           |      |                                   |

### Nehuenco II | Chile

|                                                                                     |     |        |     |     |     |   |     |           |      |                               |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|-------------------------------|
|  | 9FA | HP     | 283 | 118 | 566 | 1 | 360 | 1 (1-1-1) | 2004 | Add-on<br>Natural circulation |
|                                                                                     |     | IP     | 36  | 32  | 311 |   |     |           |      |                               |
|                                                                                     |     | LP     | 46  | 4   | 279 |   |     |           |      |                               |
|                                                                                     |     | Reheat | 314 | 30  | 565 |   |     |           |      |                               |

| PROJECT | GT<br>Type | H.R.S.G |      |   | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |     | MW    | Layout |               |          |

### Imperial Oil Limited Cogeneration Sarnia | Canada

|                                                                                   |     |        |     |    |     |   |    |           |      |                                                 |
|-----------------------------------------------------------------------------------|-----|--------|-----|----|-----|---|----|-----------|------|-------------------------------------------------|
|  | 7EA | HP     | 326 | 46 | 400 | 1 | 85 | 1 (1-1-1) | 2003 | Cogen<br>Post Combustion<br>Natural circulation |
|                                                                                   |     | IP     | 0   | 0  | 0   |   |    |           |      |                                                 |
|                                                                                   |     | LP     | 0   | 0  | 0   |   |    |           |      |                                                 |
|                                                                                   |     | Reheat | 0   | 0  | 0   |   |    |           |      |                                                 |

### TermoRio Ph. II and III Reduc | Brazil

|                                                                                   |       |        |     |    |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|-------|--------|-----|----|-----|---|-----|-----------|------|---------------------|
|  | GT11N | HP     | 169 | 73 | 523 | 4 | 660 | 2 (2-2-1) | 2004 | Natural circulation |
|                                                                                   |       | IP     | 37  | 6  | 270 |   |     |           |      |                     |
|                                                                                   |       | LP     | 0   | 0  | 0   |   |     |           |      |                     |
|                                                                                   |       | Reheat | 0   | 0  | 0   |   |     |           |      |                     |

### TermoRio | Brazil

|                                                                                   |       |        |     |     |     |   |     |           |      |                                                 |
|-----------------------------------------------------------------------------------|-------|--------|-----|-----|-----|---|-----|-----------|------|-------------------------------------------------|
|  | GT11N | HP     | 343 | 124 | 567 | 2 | 295 | 1 (2-2-1) | 2004 | Cogen<br>Post Combustion<br>Natural circulation |
|                                                                                   |       | IP     | 0   | 0   | 0   |   |     |           |      |                                                 |
|                                                                                   |       | LP     | 0   | 0   | 0   |   |     |           |      |                                                 |
|                                                                                   |       | Reheat | 0   | 0   | 0   |   |     |           |      |                                                 |

### Ankara | Turkey

|                                                                                     |     |        |     |     |     |   |     |           |      |                                        |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|----------------------------------------|
|  | 9FA | HP     | 320 | 124 | 567 | 2 | 770 | 1 (2-2-1) | 2003 | Post Combustion<br>Natural circulation |
|                                                                                     |     | IP     | 35  | 28  | 320 |   |     |           |      |                                        |
|                                                                                     |     | LP     | 12  | 4   | 289 |   |     |           |      |                                        |
|                                                                                     |     | Reheat | 359 | 26  | 567 |   |     |           |      |                                        |

### Rio Bravo 3 | Mexico

|                                                                                     |       |        |     |     |     |   |     |           |      |                                         |
|-------------------------------------------------------------------------------------|-------|--------|-----|-----|-----|---|-----|-----------|------|-----------------------------------------|
|  | W501F | HP     | 187 | 133 | 558 | 2 | 495 | 1 (2-2-1) | 2003 | Post Combustion<br>Assisted Circulation |
|                                                                                     |       | IP     | 33  | 32  | 315 |   |     |           |      |                                         |
|                                                                                     |       | LP     | 37  | 5   | 294 |   |     |           |      |                                         |
|                                                                                     |       | Reheat | 213 | 29  | 554 |   |     |           |      |                                         |

### Forney Power Project | USA

|                                                                                     |     |        |     |     |     |   |      |           |      |                                        |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|------|-----------|------|----------------------------------------|
|  | 7FA | HP     | 327 | 142 | 568 | 6 | 1789 | 2 (3-3-1) | 2003 | Post Combustion<br>Natural circulation |
|                                                                                     |     | IP     | 10  | 45  | 355 |   |      |           |      |                                        |
|                                                                                     |     | LP     | 0   | 5   | 0   |   |      |           |      |                                        |
|                                                                                     |     | Reheat | 316 | 46  | 566 |   |      |           |      |                                        |

| PROJECT | GT Type | H.R.S.G |      |   |  | Qty | PLANT |        | Commissioning | Features |
|---------|---------|---------|------|---|--|-----|-------|--------|---------------|----------|
|         |         | t/h     | barA | C |  |     | MW    | Layout |               |          |

### Lawrenceburg Cogen | USA

|                                                                                   |     |        |     |     |     |   |      |           |      |                     |
|-----------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|------|-----------|------|---------------------|
|  | 7FA | HP     | 292 | 134 | 566 | 4 | 1164 | 2 (2-2-1) | 2003 | Cogen               |
|                                                                                   |     | IP     | 20  | 37  | 320 |   |      |           |      | Post Combustion     |
|                                                                                   |     | LP     | 6   | 4   | 346 |   |      |           |      | SCR                 |
|                                                                                   |     | Reheat | 309 | 35  | 567 |   |      |           |      | Natural circulation |

### Caledonia Operating Services Steens | USA

|                                                                                   |     |        |     |     |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | 7FA | HP     | 257 | 132 | 566 | 3 | 820 | 1 (3-3-1) | 2003 | Post Combustion     |
|                                                                                   |     | IP     | 20  | 32  | 338 |   |     |           |      | SCR                 |
|                                                                                   |     | LP     | 16  | 2   | 305 |   |     |           |      | Natural circulation |
|                                                                                   |     | Reheat | 283 | 30  | 566 |   |     |           |      |                     |

### Southaven Generating Plant | USA

|                                                                                   |     |        |     |     |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | 7FA | HP     | 257 | 132 | 566 | 3 | 820 | 1 (3-3-1) | 2003 | Post Combustion     |
|                                                                                   |     | IP     | 20  | 32  | 338 |   |     |           |      | SCR                 |
|                                                                                   |     | LP     | 16  | 2   | 305 |   |     |           |      | Natural circulation |
|                                                                                   |     | Reheat | 283 | 30  | 566 |   |     |           |      |                     |

### Hanging Rock Energy Facility | USA

|                                                                                     |     |        |     |     |     |   |     |           |      |                     |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | 7FA | HP     | 371 | 128 | 567 | 2 | 620 | 1 (2-2-1) | 2003 | Post Combustion     |
|                                                                                     |     | IP     | 6   | 41  | 346 |   |     |           |      | SCR                 |
|                                                                                     |     | LP     | 1   | 5   | 346 |   |     |           |      | Natural circulation |
|                                                                                     |     | Reheat | 374 | 37  | 557 |   |     |           |      |                     |

### Fayette Energy Facility Masontown | USA

|                                                                                     |     |        |     |     |     |   |     |           |      |                     |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | 7FA | HP     | 371 | 128 | 567 | 2 | 620 | 1 (2-2-1) | 2003 | Post Combustion     |
|                                                                                     |     | IP     | 6   | 41  | 346 |   |     |           |      | SCR                 |
|                                                                                     |     | LP     | 1   | 5   | 346 |   |     |           |      | Natural circulation |
|                                                                                     |     | Reheat | 374 | 37  | 557 |   |     |           |      |                     |

### Hanging Rock Energy Facility | USA

|                                                                                     |     |        |     |     |     |   |     |           |      |                     |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | 7FA | HP     | 371 | 128 | 567 | 2 | 620 | 1 (2-2-1) | 2003 | Post Combustion     |
|                                                                                     |     | IP     | 6   | 41  | 346 |   |     |           |      | SCR                 |
|                                                                                     |     | LP     | 1   | 5   | 346 |   |     |           |      | Natural circulation |
|                                                                                     |     | Reheat | 374 | 37  | 557 |   |     |           |      |                     |

| PROJECT | GT Type | H.R.S.G |      |   |  | Qty | PLANT |        | Commissioning | Features |
|---------|---------|---------|------|---|--|-----|-------|--------|---------------|----------|
|         |         | t/h     | barA | C |  |     | MW    | Layout |               |          |

### Gonfreville | France

|                                                                                   |    |        |     |    |     |   |     |           |      |                      |
|-----------------------------------------------------------------------------------|----|--------|-----|----|-----|---|-----|-----------|------|----------------------|
|  | 9E | HP     | 225 | 71 | 495 | 2 | 250 | 1 (2-2-1) | 2003 | Cogen                |
|                                                                                   |    | IP     | 0   | 0  | 0   |   |     |           |      | Post Combustion      |
|                                                                                   |    | LP     | 0   | 0  | 0   |   |     |           |      | Assisted Circulation |
|                                                                                   |    | Reheat | 0   | 0  | 0   |   |     |           |      | With fresh air fans  |

### Kelanitissa | Sri Lanka

|                                                                                   |    |        |     |     |     |   |     |           |      |                      |
|-----------------------------------------------------------------------------------|----|--------|-----|-----|-----|---|-----|-----------|------|----------------------|
|  | 9E | HP     | 186 | 105 | 525 | 1 | 168 | 1 (1-1-1) | 2003 | Assisted Circulation |
|                                                                                   |    | IP     | 23  | 14  | 270 |   |     |           |      |                      |
|                                                                                   |    | LP     | 0   | 0   | 0   |   |     |           |      |                      |
|                                                                                   |    | Reheat | 0   | 0   | 0   |   |     |           |      |                      |

### TermoBahia | Brazil

|                                                                                   |      |        |     |     |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|------|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | GT24 | HP     | 387 | 124 | 567 | 1 | 275 | 1 (1-1-1) | 2002 | Cogen               |
|                                                                                   |      | IP     | 0   | 0   | 0   |   |     |           |      | Post Combustion     |
|                                                                                   |      | LP     | 0   | 0   | 0   |   |     |           |      | Natural circulation |
|                                                                                   |      | Reheat | 0   | 0   | 0   |   |     |           |      |                     |

### Araucaria | Brazil

|                                                                                     |        |        |     |     |     |   |     |           |      |                     |
|-------------------------------------------------------------------------------------|--------|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | W501FD | HP     | 225 | 103 | 540 | 2 | 260 | 1 (2-2-1) | 2003 | Natural circulation |
|                                                                                     |        | IP     | 37  | 4   | 265 |   |     |           |      |                     |
|                                                                                     |        | LP     | 0   | 0   | 0   |   |     |           |      |                     |
|                                                                                     |        | Reheat | 0   | 0   | 0   |   |     |           |      |                     |

### OxyChem Taft | USA

|                                                                                     |     |        |     |     |     |   |     |           |      |                     |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | 7FA | HP     | 305 | 131 | 567 | 2 | 235 | 1 (2-2-1) | 2003 | Post Combustion     |
|                                                                                     |     | IP     | 14  | 33  | 342 |   |     |           |      | Natural circulation |
|                                                                                     |     | LP     | 11  | 4   | 255 |   |     |           |      |                     |
|                                                                                     |     | Reheat | 251 | 31  | 566 |   |     |           |      |                     |

### Severnaya | Azerbaijan

|                                                                                     |       |        |     |     |     |   |     |           |      |                     |
|-------------------------------------------------------------------------------------|-------|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | M701F | HP     | 277 | 107 | 540 | 1 | 400 | 1 (1-1-1) | 2002 | Natural circulation |
|                                                                                     |       | IP     | 42  | 37  | 269 |   |     |           |      |                     |
|                                                                                     |       | LP     | 47  | 5   | 251 |   |     |           |      |                     |
|                                                                                     |       | Reheat | 306 | 35  | 567 |   |     |           |      |                     |

| PROJECT | GT<br>Type | H.R.S.G |      |   |  | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|--|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |  |     | MW    | Layout |               |          |

### Ouachita Generating Plant Sterlington| USA

|                                                                                   |     |        |     |     |     |   |     |           |      |                                               |
|-----------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|-----------------------------------------------|
|  | 7FA | HP     | 257 | 132 | 566 | 3 | 820 | 1 (3-3-1) | 2002 | Post Combustion<br>SCR<br>Natural circulation |
|                                                                                   |     | IP     | 20  | 32  | 338 |   |     |           |      |                                               |
|                                                                                   |     | LP     | 16  | 4   | 305 |   |     |           |      |                                               |
|                                                                                   |     | Reheat | 283 | 30  | 566 |   |     |           |      |                                               |

### Kgen Hot Springs LLC Malvern| USA

|                                                                                   |     |        |     |     |     |   |     |           |      |                                               |
|-----------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|-----------------------------------------------|
|  | 7FA | HP     | 371 | 128 | 567 | 2 | 620 | 1 (2-2-1) | 2002 | Post Combustion<br>SCR<br>Natural circulation |
|                                                                                   |     | IP     | 6   | 41  | 346 |   |     |           |      |                                               |
|                                                                                   |     | LP     | 1   | 5   | 346 |   |     |           |      |                                               |
|                                                                                   |     | Reheat | 374 | 37  | 557 |   |     |           |      |                                               |

### Kgen Murray I and II LLC Dalton| USA

|                                                                                   |     |        |     |     |     |   |     |           |      |                                               |
|-----------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|-----------------------------------------------|
|  | 7FA | HP     | 371 | 128 | 567 | 2 | 620 | 1 (2-2-1) | 2002 | Post Combustion<br>SCR<br>Natural circulation |
|                                                                                   |     | IP     | 6   | 41  | 346 |   |     |           |      |                                               |
|                                                                                   |     | LP     | 1   | 5   | 346 |   |     |           |      |                                               |
|                                                                                   |     | Reheat | 374 | 37  | 557 |   |     |           |      |                                               |

### Kgen Murray I and II LLC Dalton| USA

|                                                                                     |     |        |     |     |     |   |     |           |      |                                               |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|-----------------------------------------------|
|  | 7FA | HP     | 371 | 128 | 567 | 2 | 620 | 1 (2-2-1) | 2002 | Post Combustion<br>SCR<br>Natural circulation |
|                                                                                     |     | IP     | 6   | 41  | 346 |   |     |           |      |                                               |
|                                                                                     |     | LP     | 1   | 5   | 346 |   |     |           |      |                                               |
|                                                                                     |     | Reheat | 374 | 37  | 557 |   |     |           |      |                                               |

### Washington Energy Facility| USA

|                                                                                     |     |        |     |     |     |   |     |           |      |                                               |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|-----------------------------------------------|
|  | 7FA | HP     | 371 | 128 | 567 | 2 | 620 | 1 (2-2-1) | 2002 | Post Combustion<br>SCR<br>Natural circulation |
|                                                                                     |     | IP     | 6   | 41  | 346 |   |     |           |      |                                               |
|                                                                                     |     | LP     | 1   | 5   | 346 |   |     |           |      |                                               |
|                                                                                     |     | Reheat | 374 | 37  | 557 |   |     |           |      |                                               |

### Arlington Valley Energy Facility| USA

|                                                                                     |     |        |     |     |     |   |     |           |      |                                               |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|-----------------------------------------------|
|  | 7FA | HP     | 273 | 128 | 567 | 2 | 570 | 1 (2-2-1) | 2002 | Post Combustion<br>SCR<br>Natural circulation |
|                                                                                     |     | IP     | 51  | 38  | 364 |   |     |           |      |                                               |
|                                                                                     |     | LP     | 20  | 5   | 353 |   |     |           |      |                                               |
|                                                                                     |     | Reheat | 318 | 35  | 557 |   |     |           |      |                                               |

| PROJECT | GT Type | H.R.S.G |      |   | Qty | PLANT |        | Commissioning | Features |
|---------|---------|---------|------|---|-----|-------|--------|---------------|----------|
|         |         | t/h     | barA | C |     | MW    | Layout |               |          |

### Eddystone | USA

|                                                                                   |     |        |     |     |     |   |     |           |      |                                               |
|-----------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|-----------------------------------------------|
|  | 7FA | HP     | 267 | 130 | 557 | 1 | 550 | 1 (1-1-1) | 2002 | Post Combustion<br>SCR<br>Natural circulation |
|                                                                                   |     | IP     | 23  | 33  | 340 |   |     |           |      |                                               |
|                                                                                   |     | LP     | 12  | 3   | 336 |   |     |           |      |                                               |
|                                                                                   |     | Reheat | 282 | 31  | 552 |   |     |           |      |                                               |

### Bastrop Energy Center | USA

|                                                                                   |     |        |     |     |     |   |     |           |      |                                        |
|-----------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|----------------------------------------|
|  | 7FA | HP     | 264 | 134 | 563 | 2 | 534 | 1 (2-2-1) | 2002 | Post Combustion<br>Natural circulation |
|                                                                                   |     | IP     | 22  | 34  | 343 |   |     |           |      |                                        |
|                                                                                   |     | LP     | 12  | 4   | 338 |   |     |           |      |                                        |
|                                                                                   |     | Reheat | 279 | 32  | 567 |   |     |           |      |                                        |

### Son Reus | Spain

|                                                                                   |       |        |    |    |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|-------|--------|----|----|-----|---|-----|-----------|------|---------------------|
|  | GT8C2 | HP     | 76 | 72 | 488 | 3 | 226 | 1 (3-3-1) | 2002 | Natural circulation |
|                                                                                   |       | IP     | 21 | 6  | 241 |   |     |           |      |                     |
|                                                                                   |       | LP     | 0  | 0  | 0   |   |     |           |      |                     |
|                                                                                   |       | Reheat | 0  | 0  | 0   |   |     |           |      |                     |

### Rayong | Thailand

|                                                                                     |                 |        |    |    |     |   |    |           |      |                                        |
|-------------------------------------------------------------------------------------|-----------------|--------|----|----|-----|---|----|-----------|------|----------------------------------------|
|  | Coberra<br>2656 | HP     | 70 | 40 | 450 | 1 | 30 | 1 (1-1-1) | 2002 | Post Combustion<br>Natural circulation |
|                                                                                     |                 | IP     | 0  | 0  | 0   |   |    |           |      |                                        |
|                                                                                     |                 | LP     | 0  | 0  | 0   |   |    |           |      |                                        |
|                                                                                     |                 | Reheat | 0  | 0  | 0   |   |    |           |      |                                        |

### San Andrian del Besos | Spain

|                                                                                     |      |        |     |     |     |   |     |           |      |                     |
|-------------------------------------------------------------------------------------|------|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | GT26 | HP     | 301 | 118 | 568 | 2 | 800 | 2 (1-1-1) | 2002 | Natural circulation |
|                                                                                     |      | IP     | 37  | 29  | 318 |   |     |           |      |                     |
|                                                                                     |      | LP     | 30  | 5   | 0   |   |     |           |      |                     |
|                                                                                     |      | Reheat | 332 | 27  | 568 |   |     |           |      |                     |

### San Roque | Spain

|                                                                                     |      |        |     |     |     |   |     |           |      |                     |
|-------------------------------------------------------------------------------------|------|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | GT26 | HP     | 301 | 118 | 568 | 2 | 800 | 2 (1-1-1) | 2002 | Natural circulation |
|                                                                                     |      | IP     | 37  | 29  | 318 |   |     |           |      |                     |
|                                                                                     |      | LP     | 30  | 5   | 0   |   |     |           |      |                     |
|                                                                                     |      | Reheat | 332 | 27  | 568 |   |     |           |      |                     |

| PROJECT | GT Type | H.R.S.G |      |   |  | Qty | PLANT |        | Commissioning | Features |
|---------|---------|---------|------|---|--|-----|-------|--------|---------------|----------|
|         |         | t/h     | barA | C |  |     | MW    | Layout |               |          |

### Castejon | Spain

|                                                                                   |      |        |     |     |     |   |     |           |      |                            |
|-----------------------------------------------------------------------------------|------|--------|-----|-----|-----|---|-----|-----------|------|----------------------------|
|  | GT26 | HP     | 293 | 115 | 568 | 1 | 400 | 1 (1-1-1) | 2002 | <u>Natural circulation</u> |
|                                                                                   |      | IP     | 36  | 30  | 318 |   |     |           |      |                            |
|                                                                                   |      | LP     | 28  | 5   | 0   |   |     |           |      |                            |
|                                                                                   |      | Reheat | 323 | 28  | 568 |   |     |           |      |                            |

### Gebze | Turkey

|                                                                                   |     |        |     |     |     |   |      |           |      |                             |
|-----------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|------|-----------|------|-----------------------------|
|  | 9FA | HP     | 277 | 132 | 565 | 4 | 1560 | 2 (2-2-1) | 2002 | <u>Assisted Circulation</u> |
|                                                                                   |     | IP     | 39  | 30  | 314 |   |      |           |      |                             |
|                                                                                   |     | LP     | 39  | 5   | 288 |   |      |           |      |                             |
|                                                                                   |     | Reheat | 39  | 5   | 288 |   |      |           |      |                             |

### Izmir | Turkey

|                                                                                   |     |        |     |     |     |   |      |           |      |                             |
|-----------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|------|-----------|------|-----------------------------|
|  | 9FA | HP     | 275 | 129 | 568 | 4 | 1530 | 2 (2-2-1) | 2002 | <u>Assisted Circulation</u> |
|                                                                                   |     | IP     | 38  | 30  | 312 |   |      |           |      |                             |
|                                                                                   |     | LP     | 38  | 5   | 287 |   |      |           |      |                             |
|                                                                                   |     | Reheat | 312 | 27  | 565 |   |      |           |      |                             |

### Adapazari | Turkey

|                                                                                     |     |        |     |     |     |   |     |           |      |                             |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|-----------------------------|
|  | 9FA | HP     | 277 | 132 | 565 | 2 | 770 | 1 (2-2-1) | 2002 | <u>Assisted Circulation</u> |
|                                                                                     |     | IP     | 39  | 30  | 314 |   |     |           |      |                             |
|                                                                                     |     | LP     | 39  | 5   | 288 |   |     |           |      |                             |
|                                                                                     |     | Reheat | 315 | 28  | 563 |   |     |           |      |                             |

### Rades II C.C.P.P. Tunis | Tunisia

|                                                                                     |    |        |     |    |     |   |     |           |      |                                                                                |
|-------------------------------------------------------------------------------------|----|--------|-----|----|-----|---|-----|-----------|------|--------------------------------------------------------------------------------|
|  | 9E | HP     | 370 | 96 | 540 | 2 | 472 | 1 (2-2-1) | 2002 | <u>Post Combustion</u><br><u>Natural circulation</u><br><u>Diverter damper</u> |
|                                                                                     |    | IP     | 2   | 4  | 214 |   |     |           |      |                                                                                |
|                                                                                     |    | LP     | 0   | 0  | 0   |   |     |           |      |                                                                                |
|                                                                                     |    | Reheat | 0   | 0  | 0   |   |     |           |      |                                                                                |

### Senoko Stage 1 Phase 1 | Singapore

|                                                                                     |      |        |     |     |     |   |     |           |      |                                                 |
|-------------------------------------------------------------------------------------|------|--------|-----|-----|-----|---|-----|-----------|------|-------------------------------------------------|
|  | GT26 | HP     | 322 | 128 | 568 | 1 | 360 | 1 (1-1-1) | 2001 | <u>Repowering</u><br><u>Natural circulation</u> |
|                                                                                     |      | IP     | 27  | 41  | 320 |   |     |           |      |                                                 |
|                                                                                     |      | LP     | 17  | 6   | 237 |   |     |           |      |                                                 |
|                                                                                     |      | Reheat | 332 | 39  | 568 |   |     |           |      |                                                 |

| PROJECT | GT<br>Type | H.R.S.G |      |   | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |     | MW    | Layout |               |          |

### Rio Bravo | Mexico

|                                                                                   |       |        |     |     |     |   |     |           |      |                                         |
|-----------------------------------------------------------------------------------|-------|--------|-----|-----|-----|---|-----|-----------|------|-----------------------------------------|
|  | W501F | HP     | 189 | 133 | 556 | 2 | 495 | 1 (2-2-1) | 2001 | Post Combustion<br>Assisted Circulation |
|                                                                                   |       | IP     | 33  | 32  | 315 |   |     |           |      |                                         |
|                                                                                   |       | LP     | 37  | 5   | 291 |   |     |           |      |                                         |
|                                                                                   |       | Reheat | 215 | 29  | 555 |   |     |           |      |                                         |

### Odessa Ector Power Plant | USA

|                                                                                   |     |        |     |     |     |   |      |           |      |                                        |
|-----------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|------|-----------|------|----------------------------------------|
|  | 7FA | HP     | 239 | 125 | 568 | 4 | 1000 | 2 (2-2-1) | 2001 | Post Combustion<br>Natural circulation |
|                                                                                   |     | IP     | 21  | 30  | 338 |   |      |           |      |                                        |
|                                                                                   |     | LP     | 11  | 3   | 333 |   |      |           |      |                                        |
|                                                                                   |     | Reheat | 260 | 28  | 566 |   |      |           |      |                                        |

### Green Country Energy Jenks | USA

|                                                                                   |     |        |     |     |     |   |     |           |      |                                               |
|-----------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|-----------------------------------------------|
|  | 7FA | HP     | 257 | 132 | 566 | 3 | 825 | 1 (1-1-1) | 2001 | Post Combustion<br>SCR<br>Natural circulation |
|                                                                                   |     | IP     | 20  | 33  | 340 |   |     |           |      |                                               |
|                                                                                   |     | LP     | 15  | 4   | 306 |   |     |           |      |                                               |
|                                                                                   |     | Reheat | 282 | 30  | 566 |   |     |           |      |                                               |

### Whiting Cogen | USA

|                                                                                     |     |        |     |    |     |   |     |           |      |                                                        |
|-------------------------------------------------------------------------------------|-----|--------|-----|----|-----|---|-----|-----------|------|--------------------------------------------------------|
|  | 7FA | HP     | 520 | 91 | 465 | 2 | 525 | 1 (2-2-1) | 2001 | Cogen<br>Post Combustion<br>SCR<br>Natural circulation |
|                                                                                     |     | IP     | 2   | 0  | 0   |   |     |           |      |                                                        |
|                                                                                     |     | LP     | 0   | 0  | 0   |   |     |           |      |                                                        |
|                                                                                     |     | Reheat | 0   | 0  | 0   |   |     |           |      |                                                        |

### Rathdrum Generating Plant | USA

|                                                                                     |     |        |     |     |     |   |     |           |      |                                                     |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|-----------------------------------------------------|
|  | 7FA | HP     | 246 | 126 | 566 | 1 | 270 | 1 (1-1-1) | 2001 | Post Combustion<br>SCR<br>CO<br>Natural circulation |
|                                                                                     |     | IP     | 20  | 31  | 337 |   |     |           |      |                                                     |
|                                                                                     |     | LP     | 16  | 4   | 299 |   |     |           |      |                                                     |
|                                                                                     |     | Reheat | 266 | 28  | 566 |   |     |           |      |                                                     |

### Kissimmee Utility Authority Intercession City | USA

|                                                                                     |     |        |     |     |     |   |     |           |      |                                        |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|-----------|------|----------------------------------------|
|  | 7FA | HP     | 208 | 135 | 567 | 1 | 250 | 1 (1-1-1) | 2001 | Post Combustion<br>Natural circulation |
|                                                                                     |     | IP     | 25  | 26  | 321 |   |     |           |      |                                        |
|                                                                                     |     | LP     | 19  | 3   | 320 |   |     |           |      |                                        |
|                                                                                     |     | Reheat | 230 | 24  | 566 |   |     |           |      |                                        |

| PROJECT | GT Type | H.R.S.G |      |   |  | Qty | PLANT |        | Commissioning | Features |
|---------|---------|---------|------|---|--|-----|-------|--------|---------------|----------|
|         |         | t/h     | barA | C |  |     | MW    | Layout |               |          |

### San Miguel de Tucuman | Argentina

|                                                                                   |    |        |     |    |     |   |     |           |      |                      |
|-----------------------------------------------------------------------------------|----|--------|-----|----|-----|---|-----|-----------|------|----------------------|
|  | 9E | HP     | 220 | 87 | 518 | 2 | 374 | 1 (2-2-1) | 2001 | Add-on               |
|                                                                                   |    | IP     | 32  | 5  | 211 |   |     |           |      | Post Combustion      |
|                                                                                   |    | LP     | 0   | 0  | 0   |   |     |           |      | Assisted Circulation |
|                                                                                   |    | Reheat | 0   | 0  | 0   |   |     |           |      |                      |

### Hamakua Cogen Facility Honoka'a | USA

|                                                                                   |        |        |    |    |     |   |    |           |      |                     |
|-----------------------------------------------------------------------------------|--------|--------|----|----|-----|---|----|-----------|------|---------------------|
|  | LM2500 | HP     | 30 | 64 | 512 | 2 | 65 | 1 (2-2-1) | 2001 | Cogen               |
|                                                                                   |        | IP     | 5  | 5  | 191 |   |    |           |      | Post Combustion     |
|                                                                                   |        | LP     | 0  | 0  | 0   |   |    |           |      | SCR                 |
|                                                                                   |        | Reheat | 0  | 0  | 0   |   |    |           |      | Natural circulation |

### Solvay Tavaux | France

|                                                                                   |        |        |    |     |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|--------|--------|----|-----|-----|---|-----|-----------|------|---------------------|
|  | LM6000 | HP     | 95 | 111 | 520 | 2 | 100 | 1 (2-2-1) | 2000 | Cogen               |
|                                                                                   |        | IP     | 5  | 11  | 220 |   |     |           |      | Post Combustion     |
|                                                                                   |        | LP     | 0  | 0   | 0   |   |     |           |      | Natural circulation |
|                                                                                   |        | Reheat | 0  | 0   | 0   |   |     |           |      |                     |

### Jemeppe | Belgium

|                                                                                     |        |        |     |    |     |   |    |           |      |                     |
|-------------------------------------------------------------------------------------|--------|--------|-----|----|-----|---|----|-----------|------|---------------------|
|  | LM6000 | HP     | 100 | 34 | 365 | 2 | 80 | 1 (2-2-0) | 2000 | Cogen               |
|                                                                                     |        | IP     | 10  | 4  | 160 |   |    |           |      | Post Combustion     |
|                                                                                     |        | LP     | 0   | 0  | 0   |   |    |           |      | Natural circulation |
|                                                                                     |        | Reheat | 0   | 0  | 0   |   |    |           |      |                     |

### Kovaya | India

|                                                                                     |         |    |    |    |     |   |    |           |      |                               |
|-------------------------------------------------------------------------------------|---------|----|----|----|-----|---|----|-----------|------|-------------------------------|
|  | PG6551B | HP | 70 | 75 | 508 | 1 | 50 | 1 (1-1-1) | 2000 | Post Combustion               |
|                                                                                     |         | IP | 4  | 4  | 195 |   |    |           |      | Assisted Circulation          |
|                                                                                     |         | LP | 11 | 4  | 0   |   |    |           |      | Fresh air firing with FD fans |

### Guadalupe Power | USA

|                                                                                     |     |        |     |     |     |   |      |           |      |                     |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|------|-----------|------|---------------------|
|  | 7FA | HP     | 226 | 124 | 568 | 4 | 1000 | 2 (2-2-1) | 2001 | Post Combustion     |
|                                                                                     |     | IP     | 29  | 29  | 331 |   |      |           |      | Natural circulation |
|                                                                                     |     | LP     | 16  | 4   | 330 |   |      |           |      |                     |
|                                                                                     |     | Reheat | 256 | 26  | 567 |   |      |           |      |                     |

| PROJECT | GT<br>Type | H.R.S.G |      |   | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |     | MW    | Layout |               |          |

### Pont Brule / Vilvoorde | Belgium

|                                                                                   |        |        |     |     |     |   |     |           |      |                            |
|-----------------------------------------------------------------------------------|--------|--------|-----|-----|-----|---|-----|-----------|------|----------------------------|
|  | V94.3A | HP     | 268 | 125 | 550 | 1 | 380 | 1 (1-1-1) | 2000 | <u>Natural circulation</u> |
|                                                                                   |        | IP     | 76  | 6   | 330 |   |     |           |      |                            |
|                                                                                   |        | LP     | 268 | 34  | 560 |   |     |           |      |                            |
|                                                                                   |        | Reheat | 0   | 0   | 0   |   |     |           |      |                            |

### Lamar Cogen, Paris | USA

|                                                                                   |     |        |     |     |     |   |      |           |      |                                                                      |
|-----------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|------|-----------|------|----------------------------------------------------------------------|
|  | 7FA | HP     | 226 | 124 | 568 | 4 | 1000 | 2 (2-2-1) | 2000 | <u>Cogen</u><br><u>Post Combustion</u><br><u>Natural circulation</u> |
|                                                                                   |     | IP     | 29  | 28  | 331 |   |      |           |      |                                                                      |
|                                                                                   |     | LP     | 16  | 4   | 330 |   |      |           |      |                                                                      |
|                                                                                   |     | Reheat | 256 | 26  | 567 |   |      |           |      |                                                                      |

### Ford Rouge Plant | USA

|                                                                                   |     |        |     |    |     |   |     |           |      |                            |
|-----------------------------------------------------------------------------------|-----|--------|-----|----|-----|---|-----|-----------|------|----------------------------|
|  | 7FA | HP     | 240 | 90 | 526 | 2 | 550 | 1 (1-1-1) | 2000 | <u>Natural circulation</u> |
|                                                                                   |     | IP     | 27  | 20 | 328 |   |     |           |      |                            |
|                                                                                   |     | LP     | 0   | 0  | 0   |   |     |           |      |                            |
|                                                                                   |     | Reheat | 0   | 0  | 0   |   |     |           |      |                            |

### Al Taweelah | UAE

|                                                                                     |    |        |     |    |     |   |     |           |      |                                                      |
|-------------------------------------------------------------------------------------|----|--------|-----|----|-----|---|-----|-----------|------|------------------------------------------------------|
|  | 9E | HP     | 420 | 91 | 540 | 2 | 710 | 1 (2-2-1) | 2000 | <u>Post Combustion</u><br><u>Natural circulation</u> |
|                                                                                     |    | IP     | 0   | 0  | 0   |   |     |           |      |                                                      |
|                                                                                     |    | LP     | 0   | 0  | 0   |   |     |           |      |                                                      |
|                                                                                     |    | Reheat | 0   | 0  | 0   |   |     |           |      |                                                      |

### Condor, Jebel Ali | UAE

|                                                                                     |         |        |     |    |     |   |     |           |      |                             |
|-------------------------------------------------------------------------------------|---------|--------|-----|----|-----|---|-----|-----------|------|-----------------------------|
|  | PG9171E | HP     | 180 | 73 | 521 | 4 | 664 | 2 (2-2-1) | 2000 | <u>Assisted Circulation</u> |
|                                                                                     |         | IP     | 36  | 6  | 207 |   |     |           |      |                             |
|                                                                                     |         | LP     | 0   | 0  | 0   |   |     |           |      |                             |
|                                                                                     |         | Reheat | 0   | 0  | 0   |   |     |           |      |                             |

### Piombino Project | Italy

|                                                                                     |         |        |     |    |     |   |     |           |      |                            |
|-------------------------------------------------------------------------------------|---------|--------|-----|----|-----|---|-----|-----------|------|----------------------------|
|  | MS9001E | HP     | 157 | 89 | 497 | 1 | 250 | 1 (1-1-1) | 2000 | <u>Natural circulation</u> |
|                                                                                     |         | IP     | 37  | 21 | 286 |   |     |           |      |                            |
|                                                                                     |         | LP     | 27  | 0  | 200 |   |     |           |      |                            |
|                                                                                     |         | Reheat | 0   | 0  | 0   |   |     |           |      |                            |

| PROJECT | GT<br>Type | H.R.S.G |      |   |    | Qty | PLANT  |  | Commissioning | Features |
|---------|------------|---------|------|---|----|-----|--------|--|---------------|----------|
|         |            | t/h     | barA | C | MW |     | Layout |  |               |          |

### Nong, Khae | Thailand

|                                                                                   |    |        |     |     |     |   |     |           |      |                                        |
|-----------------------------------------------------------------------------------|----|--------|-----|-----|-----|---|-----|-----------|------|----------------------------------------|
|  | 6B | HP     | 107 | 103 | 506 | 2 | 125 | 1 (2-2-1) | 2000 | Post Combustion<br>Natural circulation |
|                                                                                   |    | IP     | 11  | 10  | 210 |   |     |           |      |                                        |
|                                                                                   |    | LP     | 0   | 0   | 0   |   |     |           |      |                                        |
|                                                                                   |    | Reheat | 0   | 0   | 0   |   |     |           |      |                                        |

### Irving Oil Ltd St. John | Canada

|                                                                                   |         |        |     |    |     |   |    |           |      |                                                           |
|-----------------------------------------------------------------------------------|---------|--------|-----|----|-----|---|----|-----------|------|-----------------------------------------------------------|
|  | Frame 5 | HP     | 114 | 43 | 329 | 2 | 78 | 1 (2-2-1) | 2000 | Post Combustion<br>Natural circulation<br>Fresh air fired |
|                                                                                   |         | IP     | 0   | 0  | 0   |   |    |           |      |                                                           |
|                                                                                   |         | LP     | 0   | 0  | 0   |   |    |           |      |                                                           |
|                                                                                   |         | Reheat | 0   | 0  | 0   |   |    |           |      |                                                           |

### Tocopilla | Chile

|                                                                                   |      |        |     |     |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|------|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | GT26 | HP     | 299 | 118 | 568 | 1 | 400 | 1 (1-1-1) | 1999 | Natural circulation |
|                                                                                   |      | IP     | 35  | 29  | 319 |   |     |           |      |                     |
|                                                                                   |      | LP     | 28  | 5   | 0   |   |     |           |      |                     |
|                                                                                   |      | Reheat | 329 | 27  | 568 |   |     |           |      |                     |

### El Ameriya II | Egypt

|                                                                                     |      |        |    |    |     |   |    |           |      |                      |
|-------------------------------------------------------------------------------------|------|--------|----|----|-----|---|----|-----------|------|----------------------|
|  | GT8C | HP     | 78 | 45 | 475 | 1 | 60 | 1 (2-2-1) | 1999 | Assisted Circulation |
|                                                                                     |      | IP     | 13 | 3  | 138 |   |    |           |      |                      |
|                                                                                     |      | LP     | 0  | 0  | 0   |   |    |           |      |                      |
|                                                                                     |      | Reheat | 0  | 0  | 0   |   |    |           |      |                      |

### Fina Antwerp | Belgium

|                                                                                     |        |        |    |    |     |   |     |           |      |                                                  |
|-------------------------------------------------------------------------------------|--------|--------|----|----|-----|---|-----|-----------|------|--------------------------------------------------|
|  | LM6000 | HP     | 93 | 72 | 425 | 3 | 180 | 1 (3-3-1) | 1999 | Cogen<br>Post Combustion<br>Assisted Circulation |
|                                                                                     |        | IP     | 10 | 17 | 225 |   |     |           |      |                                                  |
|                                                                                     |        | LP     | 0  | 0  | 0   |   |     |           |      |                                                  |
|                                                                                     |        | Reheat | 0  | 0  | 0   |   |     |           |      |                                                  |

### Teesside | UK

|                                                                                     |        |        |    |    |     |   |    |           |      |                                           |
|-------------------------------------------------------------------------------------|--------|--------|----|----|-----|---|----|-----------|------|-------------------------------------------|
|  | LM6000 | HP     | 48 | 24 | 312 | 1 | 70 | 1 (1-1-1) | 1999 | Natural circulation<br>Blackstart project |
|                                                                                     |        | IP     | 0  | 0  | 0   |   |    |           |      |                                           |
|                                                                                     |        | LP     | 0  | 0  | 0   |   |    |           |      |                                           |
|                                                                                     |        | Reheat | 0  | 0  | 0   |   |    |           |      |                                           |

| PROJECT | GT<br>Type | H.R.S.G |      |   | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |     | MW    | Layout |               |          |

### Bosen Cogen | Turkey

|                                                                                   |      |        |    |    |     |   |     |           |      |                              |
|-----------------------------------------------------------------------------------|------|--------|----|----|-----|---|-----|-----------|------|------------------------------|
|  | W251 | HP     | 76 | 84 | 509 | 1 | 126 | 1 (1-1-1) | 1999 | Cogen<br>Natural circulation |
|                                                                                   |      | IP     | 21 | 3  | 213 |   |     |           |      |                              |
|                                                                                   |      | LP     | 0  | 0  | 0   |   |     |           |      |                              |
|                                                                                   |      | Reheat | 0  | 0  | 0   |   |     |           |      |                              |

### Baudour | Belgium

|                                                                                   |          |        |     |     |     |   |     |           |      |                         |
|-----------------------------------------------------------------------------------|----------|--------|-----|-----|-----|---|-----|-----------|------|-------------------------|
|  | MS9001FA | HP     | 259 | 112 | 566 | 1 | 360 | 1 (1-1-1) | 1999 | Assisted<br>Circulation |
|                                                                                   |          | IP     | 42  | 32  | 314 |   |     |           |      |                         |
|                                                                                   |          | LP     | 43  | 5   | 267 |   |     |           |      |                         |
|                                                                                   |          | Reheat | 289 | 29  | 566 |   |     |           |      |                         |

### Takoradi | Ghana

|                                                                                   |         |        |     |    |     |   |     |           |      |                                               |
|-----------------------------------------------------------------------------------|---------|--------|-----|----|-----|---|-----|-----------|------|-----------------------------------------------|
|  | PG9171E | HP     | 187 | 58 | 527 | 2 | 300 | 1 (2-2-1) | 1999 | TRD<br>Light Crude Oil<br>Natural circulation |
|                                                                                   |         | IP     | 0   | 0  | 0   |   |     |           |      |                                               |
|                                                                                   |         | LP     | 0   | 0  | 0   |   |     |           |      |                                               |
|                                                                                   |         | Reheat | 0   | 0  | 0   |   |     |           |      |                                               |

### BASF Freeport | USA

|                                                                                     |     |        |     |    |     |   |    |           |      |                                        |
|-------------------------------------------------------------------------------------|-----|--------|-----|----|-----|---|----|-----------|------|----------------------------------------|
|  | 7EA | HP     | 353 | 46 | 400 | 1 | 92 | 1 (1-1-1) | 1999 | Post Combustion<br>Natural circulation |
|                                                                                     |     | IP     | 15  | 4  | 0   |   |    |           |      |                                        |
|                                                                                     |     | LP     | 0   | 0  | 0   |   |    |           |      |                                        |
|                                                                                     |     | Reheat | 0   | 0  | 0   |   |    |           |      |                                        |

### Saha Cogen Co. Ltd | Thailand

|                                                                                     |        |        |    |    |     |   |     |           |      |                                                 |
|-------------------------------------------------------------------------------------|--------|--------|----|----|-----|---|-----|-----------|------|-------------------------------------------------|
|  | LM6000 | HP     | 83 | 67 | 499 | 2 | 120 | 1 (2-2-1) | 1999 | Cogen<br>Post Combustion<br>Natural circulation |
|                                                                                     |        | IP     | 11 | 2  | 241 |   |     |           |      |                                                 |
|                                                                                     |        | LP     | 0  | 0  | 0   |   |     |           |      |                                                 |
|                                                                                     |        | Reheat | 0  | 0  | 0   |   |     |           |      |                                                 |

### Rojana Power Cy | Thailand

|                                                                                     |        |        |    |    |     |   |     |           |      |                                        |
|-------------------------------------------------------------------------------------|--------|--------|----|----|-----|---|-----|-----------|------|----------------------------------------|
|  | LM6000 | HP     | 85 | 69 | 389 | 2 | 120 | 1 (2-2-1) | 1999 | Post Combustion<br>Natural circulation |
|                                                                                     |        | IP     | 11 | 2  | 204 |   |     |           |      |                                        |
|                                                                                     |        | LP     | 0  | 0  | 0   |   |     |           |      |                                        |
|                                                                                     |        | Reheat | 0  | 0  | 0   |   |     |           |      |                                        |

| PROJECT | GT<br>Type | H.R.S.G |      |   | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |     | MW    | Layout |               |          |

### Fauji Fertilizer | Pakistan

|                                                                                   |         |        |    |    |     |   |    |      |                            |
|-----------------------------------------------------------------------------------|---------|--------|----|----|-----|---|----|------|----------------------------|
|  | Frame 5 | HP     | 96 | 41 | 380 | 1 | 40 | 1999 | <u>Natural circulation</u> |
|                                                                                   |         | IP     | 0  | 0  | 0   |   |    |      |                            |
|                                                                                   |         | LP     | 0  | 0  | 0   |   |    |      |                            |
|                                                                                   |         | Reheat | 0  | 0  | 0   |   |    |      |                            |

### Sth Humber Bank 2 | UK

|                                                                                   |        |        |     |    |     |   |     |           |      |                             |
|-----------------------------------------------------------------------------------|--------|--------|-----|----|-----|---|-----|-----------|------|-----------------------------|
|  | GT13E2 | HP     | 207 | 95 | 514 | 2 | 511 | 1 (2-2-1) | 1998 | <u>Assisted Circulation</u> |
|                                                                                   |        | IP     | 45  | 20 | 513 |   |     |           |      |                             |
|                                                                                   |        | LP     | 28  | 4  | 147 |   |     |           |      |                             |
|                                                                                   |        | Reheat | 0   | 0  | 0   |   |     |           |      |                             |

### Sarmato P.S. Milan | Italy

|                                                                                   |         |        |     |    |     |   |     |           |      |                            |
|-----------------------------------------------------------------------------------|---------|--------|-----|----|-----|---|-----|-----------|------|----------------------------|
|  | MS9001E | HP     | 172 | 76 | 485 | 1 | 145 | 1 (1-1-1) | 1998 | <u>Natural circulation</u> |
|                                                                                   |         | IP     | 26  | 6  | 195 |   |     |           |      |                            |
|                                                                                   |         | LP     | 0   | 0  | 0   |   |     |           |      |                            |
|                                                                                   |         | Reheat | 0   | 0  | 0   |   |     |           |      |                            |

### Aalst | Belgium

|                                                                                     |        |        |     |     |     |   |    |           |      |                                                       |
|-------------------------------------------------------------------------------------|--------|--------|-----|-----|-----|---|----|-----------|------|-------------------------------------------------------|
|  | LM6000 | HP     | 100 | 100 | 500 | 1 | 50 | 1 (1-1-1) | 1998 | <u>Post Combustion</u><br><u>Assisted Circulation</u> |
|                                                                                     |        | IP     | 0   | 0   | 0   |   |    |           |      |                                                       |
|                                                                                     |        | LP     | 0   | 0   | 0   |   |    |           |      |                                                       |
|                                                                                     |        | Reheat | 0   | 0   | 0   |   |    |           |      |                                                       |

### Karamay | China

|                                                                                     |         |        |    |    |     |   |    |           |      |                             |
|-------------------------------------------------------------------------------------|---------|--------|----|----|-----|---|----|-----------|------|-----------------------------|
|  | PG6551B | HP     | 65 | 38 | 450 | 1 | 60 | 1 (1-1-1) | 1998 | <u>Assisted Circulation</u> |
|                                                                                     |         | IP     | 0  | 0  | 0   |   |    |           |      |                             |
|                                                                                     |         | LP     | 0  | 0  | 0   |   |    |           |      |                             |
|                                                                                     |         | Reheat | 0  | 0  | 0   |   |    |           |      |                             |

### Riyadh P.P.9 | Saudi Arabia

|                                                                                     |     |    |     |    |     |    |      |           |      |                                                 |
|-------------------------------------------------------------------------------------|-----|----|-----|----|-----|----|------|-----------|------|-------------------------------------------------|
|  | 7EA | HP | 108 | 60 | 506 | 16 | 1296 | 4 (4-4-1) | 2000 | <u>Crude Oil</u><br><u>Assisted Circulation</u> |
|                                                                                     |     | LP | 16  | 8  | 207 |    |      |           |      |                                                 |

| PROJECT | GT Type | H.R.S.G |      |   |  | Qty | PLANT |        | Commissioning | Features |
|---------|---------|---------|------|---|--|-----|-------|--------|---------------|----------|
|         |         | t/h     | barA | C |  |     | MW    | Layout |               |          |

### Samalayuca | Mexico

|                                                                                   |    |        |     |     |     |   |     |           |      |                            |
|-----------------------------------------------------------------------------------|----|--------|-----|-----|-----|---|-----|-----------|------|----------------------------|
|  | 7F | HP     | 158 | 102 | 532 | 3 | 770 | 1 (3-3-1) | 1998 | <u>Natural circulation</u> |
|                                                                                   |    | IP     | 25  | 25  | 309 |   |     |           |      |                            |
|                                                                                   |    | LP     | 20  | 3   | 261 |   |     |           |      |                            |
|                                                                                   |    | Reheat | 173 | 22  | 535 |   |     |           |      |                            |

### MapTaPhut | Thailand

|                                                                                   |     |        |     |     |     |   |     |  |      |                            |
|-----------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|-----|--|------|----------------------------|
|  | 6FA | HP     | 187 | 105 | 540 | 1 | 114 |  | 1998 | <u>Natural circulation</u> |
|                                                                                   |     | IP     | 0   | 0   | 0   |   |     |  |      |                            |
|                                                                                   |     | LP     | 0   | 0   | 0   |   |     |  |      |                            |
|                                                                                   |     | Reheat | 0   | 0   | 0   |   |     |  |      |                            |

### Wing Tiek | Pakistan

|                                                                                   |      |        |     |    |     |   |     |  |      |                            |
|-----------------------------------------------------------------------------------|------|--------|-----|----|-----|---|-----|--|------|----------------------------|
|  | W251 | HP     | 143 | 98 | 510 | 4 | 258 |  | 1998 | <u>Natural circulation</u> |
|                                                                                   |      | IP     | 27  | 2  | 0   |   |     |  |      |                            |
|                                                                                   |      | LP     | 0   | 0  | 0   |   |     |  |      |                            |
|                                                                                   |      | Reheat | 0   | 0  | 0   |   |     |  |      |                            |

### Fauji Kabirwala Power Co | Pakistan

|                                                                                     |      |        |    |    |     |   |     |  |      |                                                      |
|-------------------------------------------------------------------------------------|------|--------|----|----|-----|---|-----|--|------|------------------------------------------------------|
|  | W251 | HP     | 85 | 82 | 499 | 2 | 160 |  | 1998 | <u>Post Combustion</u><br><u>Natural circulation</u> |
|                                                                                     |      | IP     | 17 | 10 | 241 |   |     |  |      |                                                      |
|                                                                                     |      | LP     | 0  | 0  | 0   |   |     |  |      |                                                      |
|                                                                                     |      | Reheat | 0  | 0  | 0   |   |     |  |      |                                                      |

### Yale University | USA

|                                                                                     |      |        |    |    |   |   |    |           |      |                                                      |
|-------------------------------------------------------------------------------------|------|--------|----|----|---|---|----|-----------|------|------------------------------------------------------|
|  | PGT5 | HP     | 36 | 17 | 0 | 3 | 23 | 1 (1-1-1) | 1998 | <u>Post Combustion</u><br><u>Natural circulation</u> |
|                                                                                     |      | IP     | 0  | 0  | 0 |   |    |           |      |                                                      |
|                                                                                     |      | LP     | 0  | 0  | 0 |   |    |           |      |                                                      |
|                                                                                     |      | Reheat | 0  | 0  | 0 |   |    |           |      |                                                      |

### Gresik C.C.P.P. | Indonesia

|                                                                                     |      |        |    |    |     |   |    |  |      |                                                      |
|-------------------------------------------------------------------------------------|------|--------|----|----|-----|---|----|--|------|------------------------------------------------------|
|  | Mars | HP     | 37 | 44 | 353 | 3 | 53 |  | 1998 | <u>Post Combustion</u><br><u>Natural circulation</u> |
|                                                                                     |      | IP     | 0  | 0  | 0   |   |    |  |      |                                                      |
|                                                                                     |      | LP     | 0  | 0  | 0   |   |    |  |      |                                                      |
|                                                                                     |      | Reheat | 0  | 0  | 0   |   |    |  |      |                                                      |

| PROJECT | GT<br>Type | H.R.S.G |      |   | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |     | MW    | Layout |               |          |

### Liberty P.P. | Pakistan

|                                                                                   |       |        |     |    |     |   |     |           |      |             |
|-----------------------------------------------------------------------------------|-------|--------|-----|----|-----|---|-----|-----------|------|-------------|
|  | V94.2 | HP     | 225 | 83 | 525 | 1 | 235 | 1 (1-1-1) | 1997 | TRD         |
|                                                                                   |       | IP     | 49  | 5  | 276 |   |     |           |      | Assisted    |
|                                                                                   |       | LP     | 0   | 0  | 0   |   |     |           |      | Circulation |
|                                                                                   |       | Reheat | 0   | 0  | 0   |   |     |           |      |             |

### Dahej | India

|                                                                                   |         |        |    |    |     |   |    |           |      |             |
|-----------------------------------------------------------------------------------|---------|--------|----|----|-----|---|----|-----------|------|-------------|
|  | PG6541B | HP     | 61 | 84 | 514 | 2 | 96 | 1 (2-2-1) | 1997 | Assisted    |
|                                                                                   |         | IP     | 11 | 16 | 0   |   |    |           |      | Circulation |
|                                                                                   |         | LP     | 0  | 0  | 0   |   |    |           |      |             |
|                                                                                   |         | Reheat | 0  | 0  | 0   |   |    |           |      |             |

### Marmara Ereğlisi | Turkey

|                                                                                   |        |        |     |    |     |   |     |           |      |             |
|-----------------------------------------------------------------------------------|--------|--------|-----|----|-----|---|-----|-----------|------|-------------|
|  | GT13E2 | HP     | 224 | 62 | 515 | 2 | 480 | 1 (2-2-1) | 1998 | TRD         |
|                                                                                   |        | IP     | 49  | 7  | 213 |   |     |           |      | Assisted    |
|                                                                                   |        | LP     | 0   | 0  | 0   |   |     |           |      | Circulation |
|                                                                                   |        | Reheat | 0   | 0  | 0   |   |     |           |      |             |

### Dragon Bay Thermal | China

|                                                                                     |         |        |     |    |     |   |     |           |      |             |
|-------------------------------------------------------------------------------------|---------|--------|-----|----|-----|---|-----|-----------|------|-------------|
|  | MS9001E | HP     | 174 | 60 | 515 | 2 | 300 | 1 (2-2-1) | 1998 | TRD         |
|                                                                                     |         | IP     | 0   | 0  | 0   |   |     |           |      | Crude Oil   |
|                                                                                     |         | LP     | 0   | 0  | 0   |   |     |           |      | Assisted    |
|                                                                                     |         | Reheat | 0   | 0  | 0   |   |     |           |      | Circulation |

### Gent | Belgium

|                                                                                     |          |        |     |     |     |   |     |           |      |                     |
|-------------------------------------------------------------------------------------|----------|--------|-----|-----|-----|---|-----|-----------|------|---------------------|
|  | MS9001FA | HP     | 275 | 113 | 536 | 1 | 360 | 1 (1-1-1) | 1997 | TRD                 |
|                                                                                     |          | IP     | 37  | 30  | 300 |   |     |           |      | Natural circulation |
|                                                                                     |          | LP     | 41  | 5   | 271 |   |     |           |      |                     |
|                                                                                     |          | Reheat | 298 | 29  | 535 |   |     |           |      |                     |

### Brugge Herdersbrug | Belgium

|                                                                                     |       |        |     |    |     |   |     |           |      |             |
|-------------------------------------------------------------------------------------|-------|--------|-----|----|-----|---|-----|-----------|------|-------------|
|  | V94.2 | HP     | 235 | 83 | 525 | 2 | 460 | 1 (2-2-1) | 1997 | TRD         |
|                                                                                     |       | IP     | 51  | 8  | 213 |   |     |           |      | Assisted    |
|                                                                                     |       | LP     | 0   | 0  | 0   |   |     |           |      | Circulation |
|                                                                                     |       | Reheat | 0   | 0  | 0   |   |     |           |      |             |

| PROJECT                                                                             | GT<br>Type | H.R.S.G |      |     |     | Qty | PLANT  |           | Commissioning | Features             |
|-------------------------------------------------------------------------------------|------------|---------|------|-----|-----|-----|--------|-----------|---------------|----------------------|
|                                                                                     |            | t/h     | barA | C   |     | MW  | Layout |           |               |                      |
| Dunamenti   Hungary                                                                 |            |         |      |     |     |     |        |           |               |                      |
|    | V94.2      | HP      | 230  | 82  | 520 | 1   | 230    | 1 (1-1-1) | 1997          | Cogen                |
|                                                                                     |            | IP      | 41   | 18  | 340 |     |        |           |               | District Heating     |
|                                                                                     |            | LP      | 0    | 0   | 0   |     |        |           |               | TRD                  |
|                                                                                     |            | Reheat  | 0    | 0   | 0   |     |        |           |               | Assisted Circulation |
| HELCO   USA                                                                         |            |         |      |     |     |     |        |           |               |                      |
|    | W251       | HP      | 34   | 43  | 430 | 2   | 160    | 1 (2-2-1) | 1997          | Natural circulation  |
|                                                                                     |            | IP      | 2    | 1   | 122 |     |        |           |               |                      |
|                                                                                     |            | LP      | 0    | 0   | 0   |     |        |           |               |                      |
|                                                                                     |            | Reheat  | 0    | 0   | 0   |     |        |           |               |                      |
| St Petersburg   Russia                                                              |            |         |      |     |     |     |        |           |               |                      |
|    | V94.2      | HP      | 237  | 80  | 515 | 4   | 900    | 2 (2-2-1) | 1999          | District Heating     |
|                                                                                     |            | IP      | 61   | 7   | 200 |     |        |           |               | TRD                  |
|                                                                                     |            | LP      | 0    | 0   | 0   |     |        |           |               | Natural circulation  |
|                                                                                     |            | Reheat  | 0    | 0   | 0   |     |        |           |               |                      |
| South Bangkok 2   Thailand                                                          |            |         |      |     |     |     |        |           |               |                      |
|  | MS9001FA   | HP      | 326  | 88  | 540 | 2   | 600    | 1 (2-2-1) | 1997          | TRD                  |
|                                                                                     |            | IP      | 34   | 7   | 215 |     |        |           |               | Assisted             |
|                                                                                     |            | LP      | 0    | 0   | 0   |     |        |           |               | Circulation          |
|                                                                                     |            | Reheat  | 0    | 0   | 0   |     |        |           |               |                      |
| Grati   Indonesia                                                                   |            |         |      |     |     |     |        |           |               |                      |
|  | MW701D     | HP      | 182  | 76  | 510 | 3   | 545    | 1 (3-3-1) | 1997          | TRD                  |
|                                                                                     |            | IP      | 49   | 6   | 165 |     |        |           |               | NG / Light Fuel      |
|                                                                                     |            | LP      | 0    | 0   | 0   |     |        |           |               | Assisted             |
|                                                                                     |            | Reheat  | 0    | 0   | 0   |     |        |           |               | Circulation          |
| King's Lynn   UK                                                                    |            |         |      |     |     |     |        |           |               |                      |
|  | V94.3      | HP      | 231  | 101 | 520 | 1   | 350    | 1 (1-1-1) | 1996          | TRD                  |
|                                                                                     |            | IP      | 42   | 27  | 316 |     |        |           |               | Assisted             |
|                                                                                     |            | LP      | 54   | 5   | 224 |     |        |           |               | Circulation          |
|                                                                                     |            | Reheat  | 270  | 26  | 518 |     |        |           |               |                      |

| PROJECT | GT<br>Type | H.R.S.G |      |   | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |     | MW    | Layout |               |          |

### South Humber Bank | UK

|                                                                                   |        |        |     |    |     |   |     |           |      |                             |
|-----------------------------------------------------------------------------------|--------|--------|-----|----|-----|---|-----|-----------|------|-----------------------------|
|  | GT13E2 | HP     | 207 | 95 | 514 | 3 | 750 | 1 (3-3-1) | 1996 | TRD<br>Assisted Circulation |
|                                                                                   |        | IP     | 45  | 20 | 513 |   |     |           |      |                             |
|                                                                                   |        | LP     | 28  | 4  | 147 |   |     |           |      |                             |
|                                                                                   |        | Reheat | 0   | 0  | 0   |   |     |           |      |                             |

### Meishi Ext. B | China

|                                                                                   |        |        |     |    |     |   |     |           |      |                                               |
|-----------------------------------------------------------------------------------|--------|--------|-----|----|-----|---|-----|-----------|------|-----------------------------------------------|
|  | GT13E2 | HP     | 232 | 46 | 513 | 1 | 230 | 1 (1-1-1) | 1996 | TRD<br>Distilated Oil<br>Assisted Circulation |
|                                                                                   |        | IP     | 0   | 0  | 0   |   |     |           |      |                                               |
|                                                                                   |        | LP     | 0   | 0  | 0   |   |     |           |      |                                               |
|                                                                                   |        | Reheat | 0   | 0  | 0   |   |     |           |      |                                               |

### ADNOC, BabHabashan | UAE

|                                                                                   |         |        |     |    |     |   |    |           |      |                                                           |
|-----------------------------------------------------------------------------------|---------|--------|-----|----|-----|---|----|-----------|------|-----------------------------------------------------------|
|  | Frame 6 | HP     | 124 | 42 | 400 | 1 | 63 | 1 (1-1-1) | 1996 | Post Combustion<br>Natural circulation<br>Diverter damper |
|                                                                                   |         | IP     | 0   | 0  | 0   |   |    |           |      |                                                           |
|                                                                                   |         | LP     | 0   | 0  | 0   |   |    |           |      |                                                           |
|                                                                                   |         | Reheat | 0   | 0  | 0   |   |    |           |      |                                                           |

### BP Kwinana Refinery | Australia

|                                                                                     |    |        |    |    |   |   |    |           |      |                                        |
|-------------------------------------------------------------------------------------|----|--------|----|----|---|---|----|-----------|------|----------------------------------------|
|  | 6B | HP     | 11 | 20 | 0 | 1 | 63 | 1 (1-1-1) | 1996 | Post Combustion<br>Natural circulation |
|                                                                                     |    | IP     | 0  | 0  | 0 |   |    |           |      |                                        |
|                                                                                     |    | LP     | 0  | 0  | 0 |   |    |           |      |                                        |
|                                                                                     |    | Reheat | 0  | 0  | 0 |   |    |           |      |                                        |

### Choon Chung, Incheon | South Korea

|                                                                                     |     |        |    |   |   |   |    |           |      |                                        |
|-------------------------------------------------------------------------------------|-----|--------|----|---|---|---|----|-----------|------|----------------------------------------|
|  | THM | HP     | 26 | 7 | 0 | 2 | 30 | 1 (2-2-1) | 1996 | Natural circulation<br>Fresh air fired |
|                                                                                     |     | IP     | 0  | 0 | 0 |   |    |           |      |                                        |
|                                                                                     |     | LP     | 0  | 0 | 0 |   |    |           |      |                                        |
|                                                                                     |     | Reheat | 0  | 0 | 0 |   |    |           |      |                                        |

### Corelca Las Flores | Colombia

|                                                                                     |       |        |     |    |     |   |     |           |      |                     |
|-------------------------------------------------------------------------------------|-------|--------|-----|----|-----|---|-----|-----------|------|---------------------|
|  | W501D | HP     | 161 | 75 | 512 | 1 | 200 | 1 (1-1-1) | 1995 | Natural circulation |
|                                                                                     |       | IP     | 35  | 7  | 0   |   |     |           |      |                     |
|                                                                                     |       | LP     | 0   | 0  | 0   |   |     |           |      |                     |
|                                                                                     |       | Reheat | 0   | 0  | 0   |   |     |           |      |                     |

| PROJECT | GT Type | H.R.S.G |      |   | Qty | PLANT |        | Commissioning | Features |
|---------|---------|---------|------|---|-----|-------|--------|---------------|----------|
|         |         | t/h     | barA | C |     | MW    | Layout |               |          |

### IP Riverdale, Selma | USA

|                                                                                   |         |        |     |    |     |   |    |           |      |                                                |
|-----------------------------------------------------------------------------------|---------|--------|-----|----|-----|---|----|-----------|------|------------------------------------------------|
|  | Frame 6 | HP     | 237 | 80 | 515 | 1 | 63 | 2 (2-2-1) | 1995 | Post Combustion<br>TRD<br>Assisted Circulation |
|                                                                                   |         | IP     | 61  | 7  | 200 |   |    |           |      |                                                |
|                                                                                   |         | LP     | 0   | 0  | 0   |   |    |           |      |                                                |
|                                                                                   |         | Reheat | 0   | 0  | 0   |   |    |           |      |                                                |

### Orange Cogen, Bartow | USA

|                                                                                   |        |        |    |    |     |   |     |  |      |                              |
|-----------------------------------------------------------------------------------|--------|--------|----|----|-----|---|-----|--|------|------------------------------|
|  | LM2500 | HP     | 46 | 43 | 460 | 2 | 103 |  | 1995 | Cogen<br>Natural circulation |
|                                                                                   |        | IP     | 14 | 5  | 221 |   |     |  |      |                              |
|                                                                                   |        | LP     | 3  | 0  | 0   |   |     |  |      |                              |
|                                                                                   |        | Reheat | 0  | 0  | 0   |   |     |  |      |                              |

### Yazoo City | USA

|                                                                                   |         |        |    |    |     |   |    |           |      |                                        |
|-----------------------------------------------------------------------------------|---------|--------|----|----|-----|---|----|-----------|------|----------------------------------------|
|  | Frame 5 | HP     | 44 | 44 | 443 | 1 | 40 | 1 (1-1-1) | 1994 | Natural circulation<br>Diverter damper |
|                                                                                   |         | IP     | 7  | 0  | 0   |   |    |           |      |                                        |
|                                                                                   |         | LP     | 0  | 0  | 0   |   |    |           |      |                                        |
|                                                                                   |         | Reheat | 0  | 0  | 0   |   |    |           |      |                                        |

### Clarksdale | USA

|                                                                                     |         |        |    |    |     |   |    |           |      |                                        |
|-------------------------------------------------------------------------------------|---------|--------|----|----|-----|---|----|-----------|------|----------------------------------------|
|  | Frame 5 | HP     | 44 | 44 | 443 | 1 | 40 | 1 (1-1-1) | 1994 | Natural circulation<br>Diverter damper |
|                                                                                     |         | IP     | 7  | 0  | 0   |   |    |           |      |                                        |
|                                                                                     |         | LP     | 0  | 0  | 0   |   |    |           |      |                                        |
|                                                                                     |         | Reheat | 0  | 0  | 0   |   |    |           |      |                                        |

### Tanjung Priok | Indonesia

|                                                                                     |        |        |     |    |     |   |      |           |      |                                                |
|-------------------------------------------------------------------------------------|--------|--------|-----|----|-----|---|------|-----------|------|------------------------------------------------|
|  | GT13E2 | HP     | 204 | 65 | 484 | 6 | 1220 | 2 (3-3-1) | 1995 | TRD<br>NG / Light Fuel<br>Assisted Circulation |
|                                                                                     |        | IP     | 58  | 5  | 150 |   |      |           |      |                                                |
|                                                                                     |        | LP     | 0   | 0  | 0   |   |      |           |      |                                                |
|                                                                                     |        | Reheat | 0   | 0  | 0   |   |      |           |      |                                                |

### Cardinal Cogen | Canada

|                                                                                     |       |        |     |    |     |   |     |           |      |                              |
|-------------------------------------------------------------------------------------|-------|--------|-----|----|-----|---|-----|-----------|------|------------------------------|
|  | W501D | HP     | 108 | 74 | 507 | 1 | 150 | 1 (1-1-1) | 1994 | Cogen<br>Natural circulation |
|                                                                                     |       | IP     | 46  | 4  | 208 |   |     |           |      |                              |
|                                                                                     |       | LP     | 0   | 0  | 0   |   |     |           |      |                              |
|                                                                                     |       | Reheat | 0   | 0  | 0   |   |     |           |      |                              |

| PROJECT | GT<br>Type | H.R.S.G |      |   | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |     | MW    | Layout |               |          |

### Deeside | UK

|                                                                                   |        |        |     |     |     |   |     |           |      |                                |
|-----------------------------------------------------------------------------------|--------|--------|-----|-----|-----|---|-----|-----------|------|--------------------------------|
|  | GT13E2 | HP     | 205 | 105 | 505 | 2 | 500 | 1 (2-2-1) | 1994 | TRD<br>Assisted<br>Circulation |
|                                                                                   |        | IP     | 52  | 20  | 505 |   |     |           |      |                                |
|                                                                                   |        | LP     | 27  | 0   | 0   |   |     |           |      |                                |
|                                                                                   |        | Reheat | 0   | 0   | 0   |   |     |           |      |                                |

### Khanom | Thailand

|                                                                                   |         |        |     |    |     |   |     |           |      |                                |
|-----------------------------------------------------------------------------------|---------|--------|-----|----|-----|---|-----|-----------|------|--------------------------------|
|  | MS9001E | HP     | 178 | 92 | 517 | 4 | 665 | 1 (4-4-1) | 1994 | TRD<br>Assisted<br>Circulation |
|                                                                                   |         | IP     | 40  | 10 | 235 |   |     |           |      |                                |
|                                                                                   |         | LP     | 0   | 0  | 0   |   |     |           |      |                                |
|                                                                                   |         | Reheat | 0   | 0  | 0   |   |     |           |      |                                |

### South Bangkok | Thailand

|                                                                                   |         |        |     |    |     |   |     |           |      |                                |
|-----------------------------------------------------------------------------------|---------|--------|-----|----|-----|---|-----|-----------|------|--------------------------------|
|  | MS9001E | HP     | 172 | 84 | 520 | 2 | 300 | 1 (2-2-1) | 1994 | TRD<br>Assisted<br>Circulation |
|                                                                                   |         | IP     | 41  | 9  | 234 |   |     |           |      |                                |
|                                                                                   |         | LP     | 0   | 0  | 0   |   |     |           |      |                                |
|                                                                                   |         | Reheat | 0   | 0  | 0   |   |     |           |      |                                |

### Longview | USA

|                                                                                     |    |        |     |    |     |   |     |           |      |                            |
|-------------------------------------------------------------------------------------|----|--------|-----|----|-----|---|-----|-----------|------|----------------------------|
|  | 7B | HP     | 111 | 57 | 393 | 1 | 128 | 1 (1-1-1) | 1994 | SCR<br>Natural circulation |
|                                                                                     |    | IP     | 14  | 20 | 261 |   |     |           |      |                            |
|                                                                                     |    | LP     | 11  | 0  | 0   |   |     |           |      |                            |
|                                                                                     |    | Reheat | 0   | 0  | 0   |   |     |           |      |                            |

### Vineland Cogen | USA

|                                                                                     |        |        |    |    |     |   |    |  |      |                                                 |
|-------------------------------------------------------------------------------------|--------|--------|----|----|-----|---|----|--|------|-------------------------------------------------|
|  | LM6000 | HP     | 63 | 52 | 401 | 1 | 63 |  | 1994 | Cogen<br>Post Combustion<br>Natural circulation |
|                                                                                     |        | IP     | 12 | 3  | 213 |   |    |  |      |                                                 |
|                                                                                     |        | LP     | 5  | 0  | 0   |   |    |  |      |                                                 |
|                                                                                     |        | Reheat | 0  | 0  | 0   |   |    |  |      |                                                 |

### Ogdensburg Cogen | USA

|                                                                                     |        |        |    |    |     |   |    |           |      |                                                        |
|-------------------------------------------------------------------------------------|--------|--------|----|----|-----|---|----|-----------|------|--------------------------------------------------------|
|  | LM6000 | HP     | 58 | 48 | 407 | 1 | 56 | 1 (1-1-1) | 1994 | Cogen<br>Post Combustion<br>SCR<br>Natural circulation |
|                                                                                     |        | IP     | 10 | 4  | 175 |   |    |           |      |                                                        |
|                                                                                     |        | LP     | 0  | 0  | 0   |   |    |           |      |                                                        |
|                                                                                     |        | Reheat | 0  | 0  | 0   |   |    |           |      |                                                        |

| PROJECT | GT<br>Type | H.R.S.G |      |   |    | Qty | PLANT  |  | Commissioning | Features |
|---------|------------|---------|------|---|----|-----|--------|--|---------------|----------|
|         |            | t/h     | barA | C | MW |     | Layout |  |               |          |

### Indeck Olean | USA

|                                                                                   |         |        |     |     |     |   |    |           |      |                                        |
|-----------------------------------------------------------------------------------|---------|--------|-----|-----|-----|---|----|-----------|------|----------------------------------------|
|  | Frame 6 | HP     | 151 | 111 | 523 | 1 | 79 | 1 (1-1-1) | 1994 | Post Combustion<br>Natural circulation |
|                                                                                   |         | IP     | 0   | 0   | 0   |   |    |           |      |                                        |
|                                                                                   |         | LP     | 0   | 0   | 0   |   |    |           |      |                                        |
|                                                                                   |         | Reheat | 0   | 0   | 0   |   |    |           |      |                                        |

### Rensselaer | USA

|                                                                                   |      |        |     |     |     |   |    |           |      |                                               |
|-----------------------------------------------------------------------------------|------|--------|-----|-----|-----|---|----|-----------|------|-----------------------------------------------|
|  | W251 | HP     | 120 | 102 | 512 | 1 | 65 | 1 (1-1-1) | 1994 | Post Combustion<br>SCR<br>Natural circulation |
|                                                                                   |      | IP     | 10  | 13  | 268 |   |    |           |      |                                               |
|                                                                                   |      | LP     | 0   | 0   | 0   |   |    |           |      |                                               |
|                                                                                   |      | Reheat | 0   | 0   | 0   |   |    |           |      |                                               |

### Greenwood | USA

|                                                                                   |         |        |    |    |     |   |    |           |      |                                               |
|-----------------------------------------------------------------------------------|---------|--------|----|----|-----|---|----|-----------|------|-----------------------------------------------|
|  | Frame 5 | HP     | 44 | 44 | 443 | 1 | 40 | 1 (1-1-1) | 1994 | TRD<br>Natural circulation<br>Diverter damper |
|                                                                                   |         | IP     | 7  | 0  | 0   |   |    |           |      |                                               |
|                                                                                   |         | LP     | 0  | 0  | 0   |   |    |           |      |                                               |
|                                                                                   |         | Reheat | 0  | 0  | 0   |   |    |           |      |                                               |

### City of Farmington | USA

|                                                                                     |      |        |    |    |     |   |    |           |      |                                              |
|-------------------------------------------------------------------------------------|------|--------|----|----|-----|---|----|-----------|------|----------------------------------------------|
|  | GT10 | HP     | 34 | 27 | 401 | 1 | 35 | 1 (1-1-1) | 1994 | CO<br>Natural circulation<br>Diverter damper |
|                                                                                     |      | IP     | 0  | 0  | 0   |   |    |           |      |                                              |
|                                                                                     |      | LP     | 0  | 0  | 0   |   |    |           |      |                                              |
|                                                                                     |      | Reheat | 0  | 0  | 0   |   |    |           |      |                                              |

### Ogdensburg Cogen | USA

|                                                                                     |        |        |    |    |     |   |    |           |      |                                                        |
|-------------------------------------------------------------------------------------|--------|--------|----|----|-----|---|----|-----------|------|--------------------------------------------------------|
|  | LM2500 | HP     | 58 | 48 | 407 | 1 | 80 | 1 (1-1-1) | 1994 | Cogen<br>Post Combustion<br>SCR<br>Natural circulation |
|                                                                                     |        | IP     | 10 | 4  | 175 |   |    |           |      |                                                        |
|                                                                                     |        | LP     | 0  | 0  | 0   |   |    |           |      |                                                        |
|                                                                                     |        | Reheat | 0  | 0  | 0   |   |    |           |      |                                                        |

### Alba Phase 3 | Bahrain

|                                                                                     |       |        |     |    |     |   |     |           |      |                      |
|-------------------------------------------------------------------------------------|-------|--------|-----|----|-----|---|-----|-----------|------|----------------------|
|  | GT13D | HP     | 154 | 43 | 490 | 6 | 850 | 2 (3-3-1) | 1993 | Assisted Circulation |
|                                                                                     |       | IP     | 13  | 3  | 127 |   |     |           |      |                      |
|                                                                                     |       | LP     | 0   | 0  | 0   |   |     |           |      |                      |
|                                                                                     |       | Reheat | 0   | 0  | 0   |   |     |           |      |                      |

| PROJECT | GT<br>Type | H.R.S.G |      |   | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |     | MW    | Layout |               |          |

### Seraing | Belgium

|                                                                                   |       |        |     |    |     |   |     |           |      |                                |
|-----------------------------------------------------------------------------------|-------|--------|-----|----|-----|---|-----|-----------|------|--------------------------------|
|  | V94.2 | HP     | 233 | 80 | 525 | 2 | 450 | 1 (2-2-1) | 1994 | NBN<br>Assisted<br>Circulation |
|                                                                                   |       | IP     | 55  | 7  | 213 |   |     |           |      |                                |
|                                                                                   |       | LP     | 0   | 0  | 0   |   |     |           |      |                                |
|                                                                                   |       | Reheat | 0   | 0  | 0   |   |     |           |      |                                |

### Gresik | Indonesia

|                                                                                   |       |        |     |    |     |   |      |           |      |                         |
|-----------------------------------------------------------------------------------|-------|--------|-----|----|-----|---|------|-----------|------|-------------------------|
|  | M701D | HP     | 182 | 77 | 507 | 9 | 1578 | 3 (3-3-1) | 1994 | Assisted<br>Circulation |
|                                                                                   |       | IP     | 49  | 6  | 165 |   |      |           |      |                         |
|                                                                                   |       | LP     | 0   | 0  | 0   |   |      |           |      |                         |
|                                                                                   |       | Reheat | 0   | 0  | 0   |   |      |           |      |                         |

### Faisalabad | Pakistan

|                                                                                   |         |        |    |    |     |   |     |           |      |                                                |
|-----------------------------------------------------------------------------------|---------|--------|----|----|-----|---|-----|-----------|------|------------------------------------------------|
|  | Frame 5 | HP     | 43 | 42 | 475 | 4 | 150 | 1 (4-4-1) | 1994 | Add-on<br>Light Oil<br>Assisted<br>Circulation |
|                                                                                   |         | IP     | 7  | 4  | 138 |   |     |           |      |                                                |
|                                                                                   |         | LP     | 0  | 0  | 0   |   |     |           |      |                                                |
|                                                                                   |         | Reheat | 0  | 0  | 0   |   |     |           |      |                                                |

### Kotri | Pakistan

|                                                                                     |         |        |    |    |     |   |     |           |      |                                                |
|-------------------------------------------------------------------------------------|---------|--------|----|----|-----|---|-----|-----------|------|------------------------------------------------|
|  | Frame 5 | HP     | 43 | 42 | 475 | 4 | 150 | 1 (4-4-1) | 1994 | Add-on<br>Light Oil<br>Assisted<br>Circulation |
|                                                                                     |         | IP     | 7  | 4  | 138 |   |     |           |      |                                                |
|                                                                                     |         | LP     | 0  | 0  | 0   |   |     |           |      |                                                |
|                                                                                     |         | Reheat | 0  | 0  | 0   |   |     |           |      |                                                |

### Drogenbos 2 | Belgium

|                                                                                     |       |        |     |    |     |   |     |           |      |                                |
|-------------------------------------------------------------------------------------|-------|--------|-----|----|-----|---|-----|-----------|------|--------------------------------|
|  | V94.2 | HP     | 233 | 80 | 525 | 2 | 450 | 1 (2-2-1) | 1993 | NBN<br>Assisted<br>Circulation |
|                                                                                     |       | IP     | 55  | 7  | 213 |   |     |           |      |                                |
|                                                                                     |       | LP     | 0   | 0  | 0   |   |     |           |      |                                |
|                                                                                     |       | Reheat | 0   | 0  | 0   |   |     |           |      |                                |

### Kawas | India

|                                                                                     |         |        |     |    |     |   |     |           |      |                         |
|-------------------------------------------------------------------------------------|---------|--------|-----|----|-----|---|-----|-----------|------|-------------------------|
|  | MS9001E | HP     | 174 | 70 | 520 | 4 | 600 | 2 (2-2-1) | 1993 | Assisted<br>Circulation |
|                                                                                     |         | IP     | 40  | 7  | 195 |   |     |           |      |                         |
|                                                                                     |         | LP     | 0   | 0  | 0   |   |     |           |      |                         |
|                                                                                     |         | Reheat | 0   | 0  | 0   |   |     |           |      |                         |

| PROJECT | GT<br>Type | H.R.S.G |      |   |  | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|--|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |  |     | MW    | Layout |               |          |

### Peterborough | UK

|                                                                                   |         |        |     |    |     |   |     |           |      |                                |
|-----------------------------------------------------------------------------------|---------|--------|-----|----|-----|---|-----|-----------|------|--------------------------------|
|  | MS9001E | HP     | 179 | 68 | 510 | 2 | 360 | 1 (2-2-1) | 1993 | TRD<br>Assisted<br>Circulation |
|                                                                                   |         | IP     | 48  | 6  | 221 |   |     |           |      |                                |
|                                                                                   |         | LP     | 0   | 0  | 0   |   |     |           |      |                                |
|                                                                                   |         | Reheat | 0   | 0  | 0   |   |     |           |      |                                |

### Rayong 4 | Thailand

|                                                                                   |         |        |     |    |     |   |     |           |      |                                |
|-----------------------------------------------------------------------------------|---------|--------|-----|----|-----|---|-----|-----------|------|--------------------------------|
|  | MS9001E | HP     | 168 | 72 | 510 | 2 | 310 | 1 (2-2-1) | 1993 | TRD<br>Assisted<br>Circulation |
|                                                                                   |         | IP     | 40  | 7  | 214 |   |     |           |      |                                |
|                                                                                   |         | LP     | 0   | 0  | 0   |   |     |           |      |                                |
|                                                                                   |         | Reheat | 0   | 0  | 0   |   |     |           |      |                                |

### Rabigh | Saudi Arabia

|                                                                                   |       |        |     |    |     |   |     |           |      |                                                |
|-----------------------------------------------------------------------------------|-------|--------|-----|----|-----|---|-----|-----------|------|------------------------------------------------|
|  | GT11N | HP     | 118 | 52 | 488 | 8 | 660 | 2 (4-4-1) | 1993 | Add-on<br>Crude Oil<br>Assisted<br>Circulation |
|                                                                                   |       | IP     | 28  | 6  | 160 |   |     |           |      |                                                |
|                                                                                   |       | LP     | 0   | 0  | 0   |   |     |           |      |                                                |
|                                                                                   |       | Reheat | 0   | 0  | 0   |   |     |           |      |                                                |

### Masspower Inc., Indian Orchard | USA

|                                                                                     |    |        |     |    |     |   |     |           |      |                            |
|-------------------------------------------------------------------------------------|----|--------|-----|----|-----|---|-----|-----------|------|----------------------------|
|  | 7E | HP     | 130 | 90 | 496 | 2 | 240 | 1 (2-2-1) | 1993 | SCR<br>Natural circulation |
|                                                                                     |    | IP     | 44  | 6  | 0   |   |     |           |      |                            |
|                                                                                     |    | LP     | 12  | 0  | 0   |   |     |           |      |                            |
|                                                                                     |    | Reheat | 0   | 0  | 0   |   |     |           |      |                            |

### Pasco Cogeneration | USA

|                                                                                     |        |        |    |    |     |   |     |           |      |                                                 |
|-------------------------------------------------------------------------------------|--------|--------|----|----|-----|---|-----|-----------|------|-------------------------------------------------|
|  | LM6000 | HP     | 68 | 62 | 482 | 2 | 127 | 1 (2-2-1) | 1993 | Cogen<br>Post Combustion<br>Natural circulation |
|                                                                                     |        | IP     | 16 | 5  | 0   |   |     |           |      |                                                 |
|                                                                                     |        | LP     | 5  | 0  | 0   |   |     |           |      |                                                 |
|                                                                                     |        | Reheat | 0  | 0  | 0   |   |     |           |      |                                                 |

### Lake Cogeneration, Umatilla | USA

|                                                                                     |        |        |    |    |     |   |     |           |      |                                                 |
|-------------------------------------------------------------------------------------|--------|--------|----|----|-----|---|-----|-----------|------|-------------------------------------------------|
|  | LM6000 | HP     | 78 | 62 | 482 | 2 | 111 | 1 (2-2-1) | 1993 | Cogen<br>Post Combustion<br>Natural circulation |
|                                                                                     |        | IP     | 16 | 5  | 0   |   |     |           |      |                                                 |
|                                                                                     |        | LP     | 5  | 0  | 0   |   |     |           |      |                                                 |
|                                                                                     |        | Reheat | 0  | 0  | 0   |   |     |           |      |                                                 |

| PROJECT | GT Type | H.R.S.G |      |   |  | Qty | PLANT |        | Commissioning | Features |
|---------|---------|---------|------|---|--|-----|-------|--------|---------------|----------|
|         |         | t/h     | barA | C |  |     | MW    | Layout |               |          |

### Onodoga | USA

|                                                                                   |        |        |    |    |     |   |    |           |      |                      |
|-----------------------------------------------------------------------------------|--------|--------|----|----|-----|---|----|-----------|------|----------------------|
|  | LM6000 | HP     | 38 | 62 | 408 | 2 | 80 | 1 (2-2-1) | 1993 | SCR                  |
|                                                                                   |        | IP     | 16 | 5  | 193 |   |    |           |      | Natural circulation  |
|                                                                                   |        | LP     | 0  | 0  | 0   |   |    |           |      | CO converter housing |
|                                                                                   |        | Reheat | 0  | 0  | 0   |   |    |           |      |                      |

### Antwerp | Belgium

|                                                                                   |         |        |     |    |     |   |    |           |      |                      |
|-----------------------------------------------------------------------------------|---------|--------|-----|----|-----|---|----|-----------|------|----------------------|
|  | PG6541B | HP     | 170 | 42 | 400 | 1 | 40 | 1 (1-1-1) | 1993 | Post Combustion      |
|                                                                                   |         | IP     | 0   | 0  | 0   |   |    |           |      | Assisted Circulation |
|                                                                                   |         | LP     | 0   | 0  | 0   |   |    |           |      |                      |
|                                                                                   |         | Reheat | 0   | 0  | 0   |   |    |           |      |                      |

### Babralla | India

|                                                                                   |         |        |    |     |     |   |    |           |      |                         |
|-----------------------------------------------------------------------------------|---------|--------|----|-----|-----|---|----|-----------|------|-------------------------|
|  | Frame 5 | HP     | 98 | 113 | 520 | 2 | 40 | 1 (2-2-1) | 1993 | Cogen                   |
|                                                                                   |         | IP     | 0  | 0   | 0   |   |    |           |      | Post Combustion         |
|                                                                                   |         | LP     | 0  | 0   | 0   |   |    |           |      | Assisted Circulation    |
|                                                                                   |         | Reheat | 0  | 0   | 0   |   |    |           |      | 2 levels of duct burner |

### Hess Oil | US Virgin Islands

|                                                                                     |         |        |    |    |     |   |    |  |      |                     |
|-------------------------------------------------------------------------------------|---------|--------|----|----|-----|---|----|--|------|---------------------|
|  | Frame 5 | HP     | 51 | 43 | 373 | 1 | 40 |  | 1993 | Natural circulation |
|                                                                                     |         | IP     | 0  | 0  | 0   |   |    |  |      |                     |
|                                                                                     |         | LP     | 0  | 0  | 0   |   |    |  |      |                     |
|                                                                                     |         | Reheat | 0  | 0  | 0   |   |    |  |      |                     |

### Connaught Bridge | Malaysia

|                                                                                     |       |        |     |    |     |   |     |           |      |                      |
|-------------------------------------------------------------------------------------|-------|--------|-----|----|-----|---|-----|-----------|------|----------------------|
|  | V94.2 | HP     | 197 | 39 | 480 | 2 | 300 | 1 (2-2-1) | 1992 | Add-on               |
|                                                                                     |       | IP     | 0   | 0  | 0   |   |     |           |      | Assisted Circulation |
|                                                                                     |       | LP     | 0   | 0  | 0   |   |     |           |      |                      |
|                                                                                     |       | Reheat | 0   | 0  | 0   |   |     |           |      |                      |

### Killingholme A | UK

|                                                                                     |       |        |     |    |     |   |     |           |      |                      |
|-------------------------------------------------------------------------------------|-------|--------|-----|----|-----|---|-----|-----------|------|----------------------|
|  | GT13E | HP     | 206 | 69 | 510 | 3 | 670 | 1 (3-3-1) | 1993 | TRD                  |
|                                                                                     |       | IP     | 63  | 7  | 165 |   |     |           |      | Assisted Circulation |
|                                                                                     |       | LP     | 0   | 0  | 0   |   |     |           |      |                      |
|                                                                                     |       | Reheat | 0   | 0  | 0   |   |     |           |      |                      |

| PROJECT | GT<br>Type | H.R.S.G |      |   | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |     | MW    | Layout |               |          |

### Guddu | Pakistan

|                                                                                   |       |        |     |    |     |   |     |           |      |             |
|-----------------------------------------------------------------------------------|-------|--------|-----|----|-----|---|-----|-----------|------|-------------|
|  | V94.2 | HP     | 236 | 60 | 530 | 2 | 415 | 1 (2-2-1) | 1992 | TRD         |
|                                                                                   |       | IP     | 0   | 0  | 0   |   |     |           |      | Light Oil   |
|                                                                                   |       | LP     | 0   | 0  | 0   |   |     |           |      | Assisted    |
|                                                                                   |       | Reheat | 0   | 0  | 0   |   |     |           |      | Circulation |

### Rayong 1/2/3 | Thailand

|                                                                                   |         |        |     |    |     |   |     |           |      |             |
|-----------------------------------------------------------------------------------|---------|--------|-----|----|-----|---|-----|-----------|------|-------------|
|  | MS9001E | HP     | 168 | 72 | 510 | 6 | 930 | 3 (2-2-1) | 1992 | TRD         |
|                                                                                   |         | IP     | 40  | 7  | 214 |   |     |           |      | Assisted    |
|                                                                                   |         | LP     | 0   | 0  | 0   |   |     |           |      | Circulation |
|                                                                                   |         | Reheat | 0   | 0  | 0   |   |     |           |      |             |

### Selkirk Cogen | USA

|                                                                                   |    |        |     |    |     |   |     |           |      |                     |
|-----------------------------------------------------------------------------------|----|--------|-----|----|-----|---|-----|-----------|------|---------------------|
|  | 7E | HP     | 176 | 89 | 510 | 1 | 345 | 1 (1-1-1) | 1992 | Cogen               |
|                                                                                   |    | IP     | 20  | 22 | 254 |   |     |           |      | Post Combustion     |
|                                                                                   |    | LP     | 13  | 0  | 0   |   |     |           |      | Natural circulation |
|                                                                                   |    | Reheat | 0   | 0  | 0   |   |     |           |      |                     |

### Cogen Partners of America, Vineland | USA

|                                                                                     |    |        |     |    |     |   |     |           |      |                     |
|-------------------------------------------------------------------------------------|----|--------|-----|----|-----|---|-----|-----------|------|---------------------|
|  | 7E | HP     | 170 | 59 | 483 | 1 | 120 | 1 (1-1-1) | 1992 | Cogen               |
|                                                                                     |    | IP     | 23  | 23 | 258 |   |     |           |      | Post Combustion     |
|                                                                                     |    | LP     | 22  | 0  | 108 |   |     |           |      | SCR                 |
|                                                                                     |    | Reheat | 0   | 0  | 0   |   |     |           |      | Natural circulation |

### Alcoa Cogen, Massena | USA

|                                                                                     |     |        |     |     |     |   |    |           |      |                     |
|-------------------------------------------------------------------------------------|-----|--------|-----|-----|-----|---|----|-----------|------|---------------------|
|  | GT8 | HP     | 146 | 104 | 510 | 1 | 79 | 1 (1-1-1) | 1992 | Cogen               |
|                                                                                     |     | IP     | 10  | 16  | 246 |   |    |           |      | Post Combustion     |
|                                                                                     |     | LP     | 10  | 0   | 0   |   |    |           |      | SCR                 |
|                                                                                     |     | Reheat | 0   | 0   | 0   |   |    |           |      | Natural circulation |

### Oneida Cogen | USA

|                                                                                     |         |        |    |    |     |   |    |           |      |                     |
|-------------------------------------------------------------------------------------|---------|--------|----|----|-----|---|----|-----------|------|---------------------|
|  | Frame 6 | HP     | 66 | 63 | 485 | 1 | 63 | 1 (1-1-1) | 1992 | Cogen               |
|                                                                                     |         | IP     | 11 | 12 | 196 |   |    |           |      | Natural circulation |
|                                                                                     |         | LP     | 0  | 0  | 0   |   |    |           |      |                     |
|                                                                                     |         | Reheat | 0  | 0  | 0   |   |    |           |      |                     |

| PROJECT | GT<br>Type | H.R.S.G |      |   |  | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|--|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |  |     | MW    | Layout |               |          |

### Sithe Batavia | USA

|                                                                                   |         |        |    |    |     |   |    |           |      |                     |
|-----------------------------------------------------------------------------------|---------|--------|----|----|-----|---|----|-----------|------|---------------------|
|  | Frame 6 | HP     | 66 | 63 | 485 | 1 | 58 | 1 (1-1-1) | 1992 | Natural circulation |
|                                                                                   |         | IP     | 11 | 12 | 196 |   |    |           |      |                     |
|                                                                                   |         | LP     | 0  | 0  | 0   |   |    |           |      |                     |
|                                                                                   |         | Reheat | 0  | 0  | 0   |   |    |           |      |                     |

### Ilion Cogen | USA

|                                                                                   |         |        |    |    |     |   |    |           |      |                                                 |
|-----------------------------------------------------------------------------------|---------|--------|----|----|-----|---|----|-----------|------|-------------------------------------------------|
|  | Frame 6 | HP     | 78 | 63 | 485 | 1 | 56 | 1 (1-1-1) | 1992 | Cogen<br>Post Combustion<br>Natural circulation |
|                                                                                   |         | IP     | 12 | 10 | 0   |   |    |           |      |                                                 |
|                                                                                   |         | LP     | 0  | 0  | 0   |   |    |           |      |                                                 |
|                                                                                   |         | Reheat | 0  | 0  | 0   |   |    |           |      |                                                 |

### Fulton Cogen | USA

|                                                                                   |    |        |    |    |     |   |    |           |      |                                                 |
|-----------------------------------------------------------------------------------|----|--------|----|----|-----|---|----|-----------|------|-------------------------------------------------|
|  | 6B | HP     | 27 | 44 | 312 | 1 | 50 | 1 (1-1-1) | 1992 | Cogen<br>Post Combustion<br>Natural circulation |
|                                                                                   |    | IP     | 72 | 15 | 248 |   |    |           |      |                                                 |
|                                                                                   |    | LP     | 13 | 0  | 108 |   |    |           |      |                                                 |
|                                                                                   |    | Reheat | 0  | 0  | 0   |   |    |           |      |                                                 |

### Nevada Cogen, Las Vegas | USA

|                                                                                     |        |        |    |    |     |   |     |           |      |                                                              |
|-------------------------------------------------------------------------------------|--------|--------|----|----|-----|---|-----|-----------|------|--------------------------------------------------------------|
|  | LM2500 | HP     | 34 | 60 | 487 | 3 | 138 | 1 (3-3-1) | 1992 | Cogen<br>Post Combustion<br>SCR<br>CO<br>Natural circulation |
|                                                                                     |        | IP     | 8  | 31 | 287 |   |     |           |      |                                                              |
|                                                                                     |        | LP     | 6  | 0  | 0   |   |     |           |      |                                                              |
|                                                                                     |        | Reheat | 0  | 0  | 0   |   |     |           |      |                                                              |

### Nevada Cogen, Las Vegas | USA

|                                                                                     |        |        |    |    |     |   |     |           |      |                                                              |
|-------------------------------------------------------------------------------------|--------|--------|----|----|-----|---|-----|-----------|------|--------------------------------------------------------------|
|  | LM2500 | HP     | 34 | 60 | 487 | 3 | 138 | 1 (3-3-1) | 1992 | Cogen<br>Post Combustion<br>SCR<br>CO<br>Natural circulation |
|                                                                                     |        | IP     | 8  | 31 | 287 |   |     |           |      |                                                              |
|                                                                                     |        | LP     | 0  | 0  | 0   |   |     |           |      |                                                              |
|                                                                                     |        | Reheat | 0  | 0  | 0   |   |     |           |      |                                                              |

### Hawaii Electric, Maalaea | USA

|                                                                                     |        |        |    |    |     |   |    |           |      |                                               |
|-------------------------------------------------------------------------------------|--------|--------|----|----|-----|---|----|-----------|------|-----------------------------------------------|
|  | LM2500 | HP     | 34 | 43 | 430 | 2 | 92 | 1 (2-2-1) | 1992 | Post Combustion<br>SCR<br>Natural circulation |
|                                                                                     |        | IP     | 2  | 1  | 122 |   |    |           |      |                                               |
|                                                                                     |        | LP     | 0  | 0  | 0   |   |    |           |      |                                               |
|                                                                                     |        | Reheat | 0  | 0  | 0   |   |    |           |      |                                               |

| PROJECT | GT<br>Type | H.R.S.G |      |   |  | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|--|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |  |     | MW    | Layout |               |          |

### University of Colorado, Boulder | USA

|                                                                                   |       |        |    |    |     |   |    |  |      |                                        |
|-----------------------------------------------------------------------------------|-------|--------|----|----|-----|---|----|--|------|----------------------------------------|
|  | MF111 | HP     | 34 | 21 | 246 | 2 | 76 |  | 1992 | Post Combustion<br>Natural circulation |
|                                                                                   |       | IP     | 0  | 0  | 0   |   |    |  |      |                                        |
|                                                                                   |       | LP     | 0  | 0  | 0   |   |    |  |      |                                        |
|                                                                                   |       | Reheat | 0  | 0  | 0   |   |    |  |      |                                        |

### Roosecote | UK

|                                                                                   |       |        |     |    |     |   |     |           |      |                                |
|-----------------------------------------------------------------------------------|-------|--------|-----|----|-----|---|-----|-----------|------|--------------------------------|
|  | GT13E | HP     | 217 | 64 | 495 | 1 | 225 | 1 (1-1-1) | 1991 | TRD<br>Assisted<br>Circulation |
|                                                                                   |       | IP     | 64  | 5  | 158 |   |     |           |      |                                |
|                                                                                   |       | LP     | 0   | 0  | 0   |   |     |           |      |                                |
|                                                                                   |       | Reheat | 0   | 0  | 0   |   |     |           |      |                                |

### Bang Pakong | Thailand

|                                                                                   |         |        |     |    |     |   |     |           |      |                                |
|-----------------------------------------------------------------------------------|---------|--------|-----|----|-----|---|-----|-----------|------|--------------------------------|
|  | MS9001E | HP     | 169 | 85 | 512 | 4 | 620 | 2 (2-2-1) | 1991 | TRD<br>Assisted<br>Circulation |
|                                                                                   |         | IP     | 40  | 10 | 235 |   |     |           |      |                                |
|                                                                                   |         | LP     | 0   | 0  | 0   |   |     |           |      |                                |
|                                                                                   |         | Reheat | 0   | 0  | 0   |   |     |           |      |                                |

### Indeck, Silver Springs | USA

|                                                                                     |         |        |    |    |     |   |    |           |      |                                        |
|-------------------------------------------------------------------------------------|---------|--------|----|----|-----|---|----|-----------|------|----------------------------------------|
|  | Frame 6 | HP     | 90 | 64 | 482 | 1 | 58 | 1 (1-1-1) | 1991 | Post Combustion<br>Natural circulation |
|                                                                                     |         | IP     | 6  | 23 | 245 |   |    |           |      |                                        |
|                                                                                     |         | LP     | 8  | 0  | 108 |   |    |           |      |                                        |
|                                                                                     |         | Reheat | 0  | 0  | 0   |   |    |           |      |                                        |

### Kingsburg Cogen | USA

|                                                                                     |        |        |    |    |     |   |    |           |      |                                                              |
|-------------------------------------------------------------------------------------|--------|--------|----|----|-----|---|----|-----------|------|--------------------------------------------------------------|
|  | LM2500 | HP     | 61 | 57 | 454 | 1 | 35 | 1 (1-1-1) | 1991 | Cogen<br>Post Combustion<br>SCR<br>CO<br>Natural circulation |
|                                                                                     |        | IP     | 6  | 2  | 138 |   |    |           |      |                                                              |
|                                                                                     |        | LP     | 0  | 0  | 0   |   |    |           |      |                                                              |
|                                                                                     |        | Reheat | 0  | 0  | 0   |   |    |           |      |                                                              |

### Nevada Power Clark Station, Las Vegas | USA

|                                                                                     |      |        |     |    |     |   |     |           |      |                                        |
|-------------------------------------------------------------------------------------|------|--------|-----|----|-----|---|-----|-----------|------|----------------------------------------|
|  | W501 | HP     | 131 | 85 | 510 | 2 | 740 | 1 (2-2-1) | 1990 | Natural circulation<br>Diverter damper |
|                                                                                     |      | IP     | 34  | 6  | 0   |   |     |           |      |                                        |
|                                                                                     |      | LP     | 0   | 0  | 0   |   |     |           |      |                                        |
|                                                                                     |      | Reheat | 0   | 0  | 0   |   |     |           |      |                                        |

| PROJECT | GT<br>Type | H.R.S.G |      |   |    | Qty | PLANT  |  | Commissioning | Features |
|---------|------------|---------|------|---|----|-----|--------|--|---------------|----------|
|         |            | t/h     | barA | C | MW |     | Layout |  |               |          |

### Indeck Oswego | USA

|                                                                                   |         |        |    |    |     |   |    |           |      |                                        |
|-----------------------------------------------------------------------------------|---------|--------|----|----|-----|---|----|-----------|------|----------------------------------------|
|  | Frame 6 | HP     | 63 | 67 | 482 | 1 | 56 | 1 (1-1-1) | 1990 | Post Combustion<br>Natural circulation |
|                                                                                   |         | IP     | 14 | 8  | 0   |   |    |           |      |                                        |
|                                                                                   |         | LP     | 0  | 0  | 0   |   |    |           |      |                                        |
|                                                                                   |         | Reheat | 0  | 0  | 0   |   |    |           |      |                                        |

### Indeck Tonawanda | USA

|                                                                                   |         |        |    |    |     |   |    |           |      |                                        |
|-----------------------------------------------------------------------------------|---------|--------|----|----|-----|---|----|-----------|------|----------------------------------------|
|  | Frame 6 | HP     | 68 | 88 | 512 | 1 | 53 | 1 (1-1-1) | 1990 | Post Combustion<br>Natural circulation |
|                                                                                   |         | IP     | 15 | 4  | 194 |   |    |           |      |                                        |
|                                                                                   |         | LP     | 0  | 0  | 0   |   |    |           |      |                                        |
|                                                                                   |         | Reheat | 0  | 0  | 0   |   |    |           |      |                                        |

### Amway, Ada | USA

|                                                                                   |        |        |    |    |     |   |    |           |      |                                        |
|-----------------------------------------------------------------------------------|--------|--------|----|----|-----|---|----|-----------|------|----------------------------------------|
|  | LM2500 | HP     | 47 | 63 | 482 | 1 | 30 | 1 (1-1-1) | 1990 | Post Combustion<br>Natural circulation |
|                                                                                   |        | IP     | 0  | 0  | 0   |   |    |           |      |                                        |
|                                                                                   |        | LP     | 0  | 0  | 0   |   |    |           |      |                                        |
|                                                                                   |        | Reheat | 0  | 0  | 0   |   |    |           |      |                                        |

### Nevada Power Clark Station, Las Vegas | USA

|                                                                                     |      |        |    |    |     |   |     |           |      |                     |
|-------------------------------------------------------------------------------------|------|--------|----|----|-----|---|-----|-----------|------|---------------------|
|  | W501 | HP     | 68 | 88 | 512 | 2 | 740 | 1 (2-2-1) | 1990 | Natural circulation |
|                                                                                     |      | IP     | 15 | 4  | 194 |   |     |           |      |                     |
|                                                                                     |      | LP     | 0  | 0  | 0   |   |     |           |      |                     |
|                                                                                     |      | Reheat | 0  | 0  | 0   |   |     |           |      |                     |

### Trakya C & D | Turkey

|                                                                                     |       |        |     |    |     |   |     |           |      |                                                |
|-------------------------------------------------------------------------------------|-------|--------|-----|----|-----|---|-----|-----------|------|------------------------------------------------|
|  | GT13D | HP     | 155 | 52 | 480 | 4 | 600 | 2 (2-2-1) | 1989 | TRD<br>Assisted Circulation<br>Diverter damper |
|                                                                                     |       | IP     | 37  | 5  | 200 |   |     |           |      |                                                |
|                                                                                     |       | LP     | 0   | 0  | 0   |   |     |           |      |                                                |
|                                                                                     |       | Reheat | 0   | 0  | 0   |   |     |           |      |                                                |

### Smith Cogen, OklahomaCity | USA

|                                                                                     |    |        |     |    |     |   |     |           |      |                                                 |
|-------------------------------------------------------------------------------------|----|--------|-----|----|-----|---|-----|-----------|------|-------------------------------------------------|
|  | 7E | HP     | 156 | 91 | 510 | 1 | 128 | 1 (1-1-1) | 1989 | Cogen<br>Post Combustion<br>Natural circulation |
|                                                                                     |    | IP     | 17  | 22 | 284 |   |     |           |      |                                                 |
|                                                                                     |    | LP     | 15  | 0  | 118 |   |     |           |      |                                                 |
|                                                                                     |    | Reheat | 0   | 0  | 0   |   |     |           |      |                                                 |

| PROJECT | GT<br>Type | H.R.S.G |      |   |    | Qty | PLANT  |  | Commissioning | Features |
|---------|------------|---------|------|---|----|-----|--------|--|---------------|----------|
|         |            | t/h     | barA | C | MW |     | Layout |  |               |          |

### IP Camden | USA

|                                                                                   |         |        |     |    |     |   |    |  |      |                                        |
|-----------------------------------------------------------------------------------|---------|--------|-----|----|-----|---|----|--|------|----------------------------------------|
|  | Frame 6 | HP     | 136 | 29 | 385 | 1 | 63 |  | 1989 | Post Combustion<br>Natural circulation |
|                                                                                   |         | IP     | 0   | 0  | 0   |   |    |  |      |                                        |
|                                                                                   |         | LP     | 0   | 0  | 0   |   |    |  |      |                                        |
|                                                                                   |         | Reheat | 0   | 0  | 0   |   |    |  |      |                                        |

### EMI Pepperell | USA

|                                                                                   |         |        |    |    |     |   |    |  |      |                                        |
|-----------------------------------------------------------------------------------|---------|--------|----|----|-----|---|----|--|------|----------------------------------------|
|  | Frame 5 | HP     | 46 | 62 | 443 | 1 | 40 |  | 1989 | Post Combustion<br>Natural circulation |
|                                                                                   |         | IP     | 10 | 17 | 343 |   |    |  |      |                                        |
|                                                                                   |         | LP     | 9  | 44 | 0   |   |    |  |      |                                        |
|                                                                                   |         | Reheat | 0  | 0  | 0   |   |    |  |      |                                        |

### University of Michigan, Ann Arbor | USA

|                                                                                   |         |        |    |    |     |   |     |  |      |                                        |
|-----------------------------------------------------------------------------------|---------|--------|----|----|-----|---|-----|--|------|----------------------------------------|
|  | Centaur | HP     | 29 | 27 | 398 | 2 | 120 |  | 1989 | Post Combustion<br>Natural circulation |
|                                                                                   |         | IP     | 0  | 0  | 0   |   |     |  |      |                                        |
|                                                                                   |         | LP     | 0  | 0  | 0   |   |     |  |      |                                        |
|                                                                                   |         | Reheat | 0  | 0  | 0   |   |     |  |      |                                        |

### Hartford | USA

|                                                                                     |         |        |     |    |     |   |    |  |      |                                        |
|-------------------------------------------------------------------------------------|---------|--------|-----|----|-----|---|----|--|------|----------------------------------------|
|  | Frame 6 | HP     | 112 | 92 | 528 | 1 | 63 |  | 1988 | Post Combustion<br>Natural circulation |
|                                                                                     |         | IP     | 17  | 21 | 237 |   |    |  |      |                                        |
|                                                                                     |         | LP     | 11  | 1  | 0   |   |    |  |      |                                        |
|                                                                                     |         | Reheat | 0   | 0  | 0   |   |    |  |      |                                        |

### West Point | USA

|                                                                                     |         |        |    |   |   |   |    |  |      |                                        |
|-------------------------------------------------------------------------------------|---------|--------|----|---|---|---|----|--|------|----------------------------------------|
|  | Frame 5 | HP     | 68 | 2 | 0 | 1 | 40 |  | 1988 | Post Combustion<br>Natural circulation |
|                                                                                     |         | IP     | 0  | 0 | 0 |   |    |  |      |                                        |
|                                                                                     |         | LP     | 0  | 0 | 0 |   |    |  |      |                                        |
|                                                                                     |         | Reheat | 0  | 0 | 0 |   |    |  |      |                                        |

### Mid Sun Cogen, Bakersfield | USA

|                                                                                     |        |        |    |    |     |   |    |           |      |                                           |
|-------------------------------------------------------------------------------------|--------|--------|----|----|-----|---|----|-----------|------|-------------------------------------------|
|  | LM2500 | HP     | 35 | 37 | 357 | 1 | 45 | 1 (1-1-1) | 1988 | Cogen<br>SCR<br>CO<br>Natural circulation |
|                                                                                     |        | IP     | 6  | 0  | 113 |   |    |           |      |                                           |
|                                                                                     |        | LP     | 0  | 0  | 0   |   |    |           |      |                                           |
|                                                                                     |        | Reheat | 0  | 0  | 0   |   |    |           |      |                                           |

| PROJECT | GT<br>Type | H.R.S.G |      |   |    | Qty | PLANT  |  | Commissioning | Features |
|---------|------------|---------|------|---|----|-----|--------|--|---------------|----------|
|         |            | t/h     | barA | C | MW |     | Layout |  |               |          |

### Duliajan | India

|                                                                                   |       |        |    |    |     |   |    |           |      |                                                                                     |
|-----------------------------------------------------------------------------------|-------|--------|----|----|-----|---|----|-----------|------|-------------------------------------------------------------------------------------|
|  | W191G | HP     | 36 | 20 | 413 | 1 | 22 | 1 (1-1-1) | 1988 | Add-on<br>Assisted Circulation<br>1 HP level to ST. 1<br>HP level for<br>deaeration |
|                                                                                   |       | IP     | 0  | 0  | 0   |   |    |           |      |                                                                                     |
|                                                                                   |       | LP     | 0  | 0  | 0   |   |    |           |      |                                                                                     |
|                                                                                   |       | Reheat | 0  | 0  | 0   |   |    |           |      |                                                                                     |

### Battle Creek | USA

|                                                                                   |  |        |    |    |     |   |    |  |      |                     |
|-----------------------------------------------------------------------------------|--|--------|----|----|-----|---|----|--|------|---------------------|
|  |  | HP     | 32 | 18 | 304 | 1 | 15 |  | 1988 | Natural circulation |
|                                                                                   |  | IP     | 0  | 0  | 0   |   |    |  |      |                     |
|                                                                                   |  | LP     | 0  | 0  | 0   |   |    |  |      |                     |
|                                                                                   |  | Reheat | 0  | 0  | 0   |   |    |  |      |                     |

### Ivex Paper, Joilet | USA

|                                                                                   |         |        |    |    |   |   |    |  |      |                                        |
|-----------------------------------------------------------------------------------|---------|--------|----|----|---|---|----|--|------|----------------------------------------|
|  | Centaur | HP     | 36 | 10 | 0 | 1 | 60 |  | 1988 | Post Combustion<br>Natural circulation |
|                                                                                   |         | IP     | 0  | 0  | 0 |   |    |  |      |                                        |
|                                                                                   |         | LP     | 0  | 0  | 0 |   |    |  |      |                                        |
|                                                                                   |         | Reheat | 0  | 0  | 0 |   |    |  |      |                                        |

### Trakya A & B | Turkey

|                                                                                     |       |        |     |    |     |   |     |           |      |                             |
|-------------------------------------------------------------------------------------|-------|--------|-----|----|-----|---|-----|-----------|------|-----------------------------|
|  | GT13D | HP     | 155 | 52 | 480 | 4 | 600 | 2 (2-2-1) | 1987 | TRD<br>Assisted Circulation |
|                                                                                     |       | IP     | 37  | 5  | 200 |   |     |           |      |                             |
|                                                                                     |       | LP     | 0   | 0  | 0   |   |     |           |      |                             |
|                                                                                     |       | Reheat | 0   | 0  | 0   |   |     |           |      |                             |

### Amoco Texas City | USA

|                                                                                     |    |        |     |    |     |   |     |  |      |                                        |
|-------------------------------------------------------------------------------------|----|--------|-----|----|-----|---|-----|--|------|----------------------------------------|
|  | 7E | HP     | 272 | 88 | 510 | 2 | 255 |  | 1985 | Post Combustion<br>Natural circulation |
|                                                                                     |    | IP     | 13  | 18 | 293 |   |     |  |      |                                        |
|                                                                                     |    | LP     | 0   | 0  | 0   |   |     |  |      |                                        |
|                                                                                     |    | Reheat | 0   | 0  | 0   |   |     |  |      |                                        |

### Amoco Texas City | USA

|                                                                                     |         |        |     |    |     |   |    |  |      |                     |
|-------------------------------------------------------------------------------------|---------|--------|-----|----|-----|---|----|--|------|---------------------|
|  | Frame 5 | HP     | 272 | 88 | 510 | 1 | 40 |  | 1985 | Natural circulation |
|                                                                                     |         | IP     | 13  | 18 | 293 |   |    |  |      |                     |
|                                                                                     |         | LP     | 0   | 0  | 0   |   |    |  |      |                     |
|                                                                                     |         | Reheat | 0   | 0  | 0   |   |    |  |      |                     |

| PROJECT | GT<br>Type | H.R.S.G |      |   |  | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|--|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |  |     | MW    | Layout |               |          |

### Muscate | Oman

|                                                                                   |      |        |    |   |     |   |    |           |      |                                  |
|-----------------------------------------------------------------------------------|------|--------|----|---|-----|---|----|-----------|------|----------------------------------|
|  | GT35 | HP     | 17 | 9 | 203 | 2 | 26 | 1 (2-2-1) | 1985 | Cogen<br>Assisted<br>Circulation |
|                                                                                   |      | IP     | 0  | 0 | 0   |   |    |           |      |                                  |
|                                                                                   |      | LP     | 0  | 0 | 0   |   |    |           |      |                                  |
|                                                                                   |      | Reheat | 0  | 0 | 0   |   |    |           |      |                                  |

### Coastal States, Corpus Christi | USA

|                                                                                   |         |        |    |    |     |   |    |  |      |                     |
|-----------------------------------------------------------------------------------|---------|--------|----|----|-----|---|----|--|------|---------------------|
|  | Frame 5 | HP     | 48 | 31 | 315 | 1 | 40 |  | 1984 | Natural circulation |
|                                                                                   |         | IP     | 0  | 0  | 0   |   |    |  |      |                     |
|                                                                                   |         | LP     | 0  | 0  | 0   |   |    |  |      |                     |
|                                                                                   |         | Reheat | 0  | 0  | 0   |   |    |  |      |                     |

### Thermo Electron Miami | USA

|                                                                                   |  |        |    |    |     |   |    |  |      |                     |
|-----------------------------------------------------------------------------------|--|--------|----|----|-----|---|----|--|------|---------------------|
|  |  | HP     | 43 | 43 | 432 | 1 | 30 |  | 1984 | Natural circulation |
|                                                                                   |  | IP     | 9  | 1  | 0   |   |    |  |      |                     |
|                                                                                   |  | LP     | 0  | 0  | 0   |   |    |  |      |                     |
|                                                                                   |  | Reheat | 0  | 0  | 0   |   |    |  |      |                     |

### North Wall | Ireland

|                                                                                     |         |        |     |    |     |   |     |           |      |                                                                               |
|-------------------------------------------------------------------------------------|---------|--------|-----|----|-----|---|-----|-----------|------|-------------------------------------------------------------------------------|
|  | MS9001E | HP     | 208 | 30 | 430 | 1 | 165 | 1 (1-1-3) | 1983 | Repowering<br>TRD<br>Light Oil<br>Assisted<br>Circulation<br>3 steam turbines |
|                                                                                     |         | IP     | 0   | 0  | 0   |   |     |           |      |                                                                               |
|                                                                                     |         | LP     | 0   | 0  | 0   |   |     |           |      |                                                                               |
|                                                                                     |         | Reheat | 0   | 0  | 0   |   |     |           |      |                                                                               |

### Burbank | USA

|                                                                                     |  |        |    |    |   |   |    |  |      |                     |
|-------------------------------------------------------------------------------------|--|--------|----|----|---|---|----|--|------|---------------------|
|  |  | HP     | 46 | 43 | 0 | 1 | 35 |  | 1983 | Natural circulation |
|                                                                                     |  | IP     | 13 | 2  | 0 |   |    |  |      |                     |
|                                                                                     |  | LP     | 0  | 0  | 0 |   |    |  |      |                     |
|                                                                                     |  | Reheat | 0  | 0  | 0 |   |    |  |      |                     |

### Tulsa | USA

|                                                                                     |         |        |    |    |     |   |    |  |      |                     |
|-------------------------------------------------------------------------------------|---------|--------|----|----|-----|---|----|--|------|---------------------|
|  | Frame 3 | HP     | 24 | 42 | 371 | 1 | 15 |  | 1982 | Natural circulation |
|                                                                                     |         | IP     | 0  | 0  | 0   |   |    |  |      |                     |
|                                                                                     |         | LP     | 0  | 0  | 0   |   |    |  |      |                     |
|                                                                                     |         | Reheat | 0  | 0  | 0   |   |    |  |      |                     |

| PROJECT | GT<br>Type | H.R.S.G |      |   | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |     | MW    | Layout |               |          |

### Union Tribune San Diego | USA

|                                                                                   |         |        |   |   |   |   |    |      |                            |
|-----------------------------------------------------------------------------------|---------|--------|---|---|---|---|----|------|----------------------------|
|  | Centaur | HP     | 7 | 1 | 0 | 1 | 60 | 1982 | <u>Natural circulation</u> |
|                                                                                   |         | IP     | 0 | 0 | 0 |   |    |      |                            |
|                                                                                   |         | LP     | 0 | 0 | 0 |   |    |      |                            |
|                                                                                   |         | Reheat | 0 | 0 | 0 |   |    |      |                            |

### Tulsa | USA

|                                                                                   |         |        |    |    |     |   |    |      |                            |
|-----------------------------------------------------------------------------------|---------|--------|----|----|-----|---|----|------|----------------------------|
|  | Frame 3 | HP     | 24 | 42 | 371 | 1 | 15 | 1980 | <u>Natural circulation</u> |
|                                                                                   |         | IP     | 0  | 0  | 0   |   |    |      |                            |
|                                                                                   |         | LP     | 0  | 0  | 0   |   |    |      |                            |
|                                                                                   |         | Reheat | 0  | 0  | 0   |   |    |      |                            |

### Marina | Ireland

|                                                                                   |         |        |     |    |     |   |     |           |      |                                                                          |
|-----------------------------------------------------------------------------------|---------|--------|-----|----|-----|---|-----|-----------|------|--------------------------------------------------------------------------|
|  | MS9001B | HP     | 155 | 45 | 458 | 1 | 120 | 1 (1-1-1) | 1978 | <u>Repowering</u><br><u>TRD</u><br><u>Assisted</u><br><u>Circulation</u> |
|                                                                                   |         | IP     | 0   | 0  | 0   |   |     |           |      |                                                                          |
|                                                                                   |         | LP     | 0   | 0  | 0   |   |     |           |      |                                                                          |
|                                                                                   |         | Reheat | 0   | 0  | 0   |   |     |           |      |                                                                          |

### Sarakhs | Iran

|                                                                                     |  |        |    |   |   |   |    |      |                            |
|-------------------------------------------------------------------------------------|--|--------|----|---|---|---|----|------|----------------------------|
|  |  | HP     | 23 | 5 | 0 | 3 | 45 | 1978 | <u>Natural circulation</u> |
|                                                                                     |  | IP     | 0  | 0 | 0 |   |    |      |                            |
|                                                                                     |  | LP     | 0  | 0 | 0 |   |    |      |                            |
|                                                                                     |  | Reheat | 0  | 0 | 0 |   |    |      |                            |

### Socolie 2-3 | Belgium

|                                                                                     |      |        |    |    |     |   |     |           |      |                                                     |
|-------------------------------------------------------------------------------------|------|--------|----|----|-----|---|-----|-----------|------|-----------------------------------------------------|
|  | W251 | HP     | 62 | 31 | 425 | 2 | 115 | 1 (2-2-1) | 1977 | <u>NBN</u><br><u>Assisted</u><br><u>Circulation</u> |
|                                                                                     |      | IP     | 0  | 0  | 0   |   |     |           |      |                                                     |
|                                                                                     |      | LP     | 0  | 0  | 0   |   |     |           |      |                                                     |
|                                                                                     |      | Reheat | 0  | 0  | 0   |   |     |           |      |                                                     |

### Applied Energy San Diego | USA

|                                                                                     |         |        |    |    |   |   |    |      |                            |
|-------------------------------------------------------------------------------------|---------|--------|----|----|---|---|----|------|----------------------------|
|  | Frame 5 | HP     | 65 | 14 | 0 | 1 | 40 | 1977 | <u>Natural circulation</u> |
|                                                                                     |         | IP     | 0  | 0  | 0 |   |    |      |                            |
|                                                                                     |         | LP     | 0  | 0  | 0 |   |    |      |                            |
|                                                                                     |         | Reheat | 0  | 0  | 0 |   |    |      |                            |

| PROJECT | GT<br>Type | H.R.S.G |      |   | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |     | MW    | Layout |               |          |

### Borger | USA

|                                                                                   |         |        |    |    |     |   |    |      |                            |
|-----------------------------------------------------------------------------------|---------|--------|----|----|-----|---|----|------|----------------------------|
|  | Frame 3 | HP     | 20 | 31 | 316 | 2 | 30 | 1977 | <u>Natural circulation</u> |
|                                                                                   |         | IP     | 0  | 0  | 0   |   |    |      |                            |
|                                                                                   |         | LP     | 0  | 0  | 0   |   |    |      |                            |
|                                                                                   |         | Reheat | 0  | 0  | 0   |   |    |      |                            |

### Jertovec | Croatia

|                                                                                   |      |        |    |    |     |   |     |           |      |                                                  |
|-----------------------------------------------------------------------------------|------|--------|----|----|-----|---|-----|-----------|------|--------------------------------------------------|
|  | W251 | HP     | 58 | 42 | 441 | 2 | 111 | 1 (2-2-1) | 1976 | <u>Repowering</u><br><u>Assisted Circulation</u> |
|                                                                                   |      | IP     | 0  | 0  | 0   |   |     |           |      |                                                  |
|                                                                                   |      | LP     | 0  | 0  | 0   |   |     |           |      |                                                  |
|                                                                                   |      | Reheat | 0  | 0  | 0   |   |     |           |      |                                                  |

### Baytown | USA

|                                                                                   |         |        |    |    |     |   |    |      |                            |
|-----------------------------------------------------------------------------------|---------|--------|----|----|-----|---|----|------|----------------------------|
|  | Frame 5 | HP     | 69 | 44 | 371 | 1 | 40 | 1976 | <u>Natural circulation</u> |
|                                                                                   |         | IP     | 0  | 0  | 0   |   |    |      |                            |
|                                                                                   |         | LP     | 0  | 0  | 0   |   |    |      |                            |
|                                                                                   |         | Reheat | 0  | 0  | 0   |   |    |      |                            |

### Amoco Texas City | USA

|                                                                                     |         |        |     |    |     |   |    |      |                            |
|-------------------------------------------------------------------------------------|---------|--------|-----|----|-----|---|----|------|----------------------------|
|  | Frame 5 | HP     | 272 | 88 | 510 | 1 | 40 | 1976 | <u>Natural circulation</u> |
|                                                                                     |         | IP     | 13  | 18 | 293 |   |    |      |                            |
|                                                                                     |         | LP     | 0   | 0  | 0   |   |    |      |                            |
|                                                                                     |         | Reheat | 0   | 0  | 0   |   |    |      |                            |

### Drogenbos 1 | Belgium

|                                                                                     |       |        |     |    |     |   |     |           |      |                                                                |
|-------------------------------------------------------------------------------------|-------|--------|-----|----|-----|---|-----|-----------|------|----------------------------------------------------------------|
|  | W1101 | HP     | 125 | 51 | 460 | 1 | 120 | 1 (1-1-1) | 1975 | <u>Repowering</u><br><u>NBN</u><br><u>Assisted Circulation</u> |
|                                                                                     |       | IP     | 0   | 0  | 0   |   |     |           |      |                                                                |
|                                                                                     |       | LP     | 0   | 0  | 0   |   |     |           |      |                                                                |
|                                                                                     |       | Reheat | 0   | 0  | 0   |   |     |           |      |                                                                |

### Baytown | USA

|                                                                                     |         |        |    |    |     |   |    |      |                            |
|-------------------------------------------------------------------------------------|---------|--------|----|----|-----|---|----|------|----------------------------|
|  | Frame 5 | HP     | 69 | 44 | 371 | 1 | 40 | 1975 | <u>Natural circulation</u> |
|                                                                                     |         | IP     | 0  | 0  | 0   |   |    |      |                            |
|                                                                                     |         | LP     | 0  | 0  | 0   |   |    |      |                            |
|                                                                                     |         | Reheat | 0  | 0  | 0   |   |    |      |                            |

| PROJECT | GT<br>Type | H.R.S.G |      |   |  | Qty | PLANT |        | Commissioning | Features |
|---------|------------|---------|------|---|--|-----|-------|--------|---------------|----------|
|         |            | t/h     | barA | C |  |     | MW    | Layout |               |          |

Solvay | Belgium

|                                                                                   |     |        |    |    |     |   |    |           |      |                      |
|-----------------------------------------------------------------------------------|-----|--------|----|----|-----|---|----|-----------|------|----------------------|
|  | TTG | HP     | 34 | 33 | 287 | 1 | 25 | 1 (1-1-1) | 1971 | Cogen                |
|                                                                                   |     | IP     | 0  | 0  | 300 |   |    |           |      | NBN                  |
|                                                                                   |     | LP     | 0  | 0  | 0   |   |    |           |      | Assisted Circulation |
|                                                                                   |     | Reheat | 0  | 0  | 0   |   |    |           |      |                      |

Solvay | Belgium

|                                                                                   |     |        |    |    |     |   |    |           |      |                      |
|-----------------------------------------------------------------------------------|-----|--------|----|----|-----|---|----|-----------|------|----------------------|
|  | TTG | HP     | 34 | 33 | 287 | 1 | 25 | 1 (1-1-1) | 1970 | Cogen                |
|                                                                                   |     | IP     | 0  | 0  | 300 |   |    |           |      | NBN                  |
|                                                                                   |     | LP     | 0  | 0  | 0   |   |    |           |      | Assisted Circulation |
|                                                                                   |     | Reheat | 0  | 0  | 0   |   |    |           |      |                      |

Socolie 1 | Belgium

|                                                                                   |       |        |     |    |     |   |    |           |      |                      |
|-----------------------------------------------------------------------------------|-------|--------|-----|----|-----|---|----|-----------|------|----------------------|
|  | N-110 | HP     | 50  | 38 | 350 | 1 | 35 | 1 (1-1-1) | 1969 | Post Combustion      |
|                                                                                   |       | IP     | 100 | 0  | 450 |   |    |           |      | Light Oil            |
|                                                                                   |       | LP     | 0   | 0  | 0   |   |    |           |      | Assisted Circulation |
|                                                                                   |       | Reheat | 0   | 0  | 0   |   |    |           |      |                      |

# We give you the Power!

## The Power to Change the World!



**John Cockerill's expertise** in steam production dates back to 1817. Its know-how as a **designer** and **green solutions provider** is recognized worldwide. Resolutely turned towards the future, entrepreneurship is key at John Cockerill and our moto is **responding to the needs of our times** by developing innovative solutions to encourage access to energy, **reducing emissions** and help you produce **sustainably**.

### John Cockerill Energy Worldwide:

Belgium – France – Spain – United Kingdom – Saudi Arabia – India – Vietnam – Indonesia – South Korea – USA – Brazil

Rue Jean Potier, 1  
BE 4100 Seraing  
Belgium

+32 4 330 22 41  
[heat.recovery.systems@johncockerill.com](mailto:heat.recovery.systems@johncockerill.com)

[johncockerill.com/en/energy/heat-recovery-steam-generators](http://johncockerill.com/en/energy/heat-recovery-steam-generators)

